

SERVICE PARTS LIST FOR MITSUBISHI ELECTRIC PACKAGED AIR-CONDITIONERS

Series : PFFY-P•VLRMM-E


Dec. 2007

BWE07260

INDEX
PFFY-P20VLRMM-E PFFY-P25VLRMM-E PFFY-P32VLRMM-E PFFY-P40VLRMM-E PFFY-P50VLRMM-E PFFY-P63VLRMM-E

PFFY-P20,P25,P32VLRMM-E
PFFY-P40,P50,P63VLRMM-E

EXTERNAL PARTS

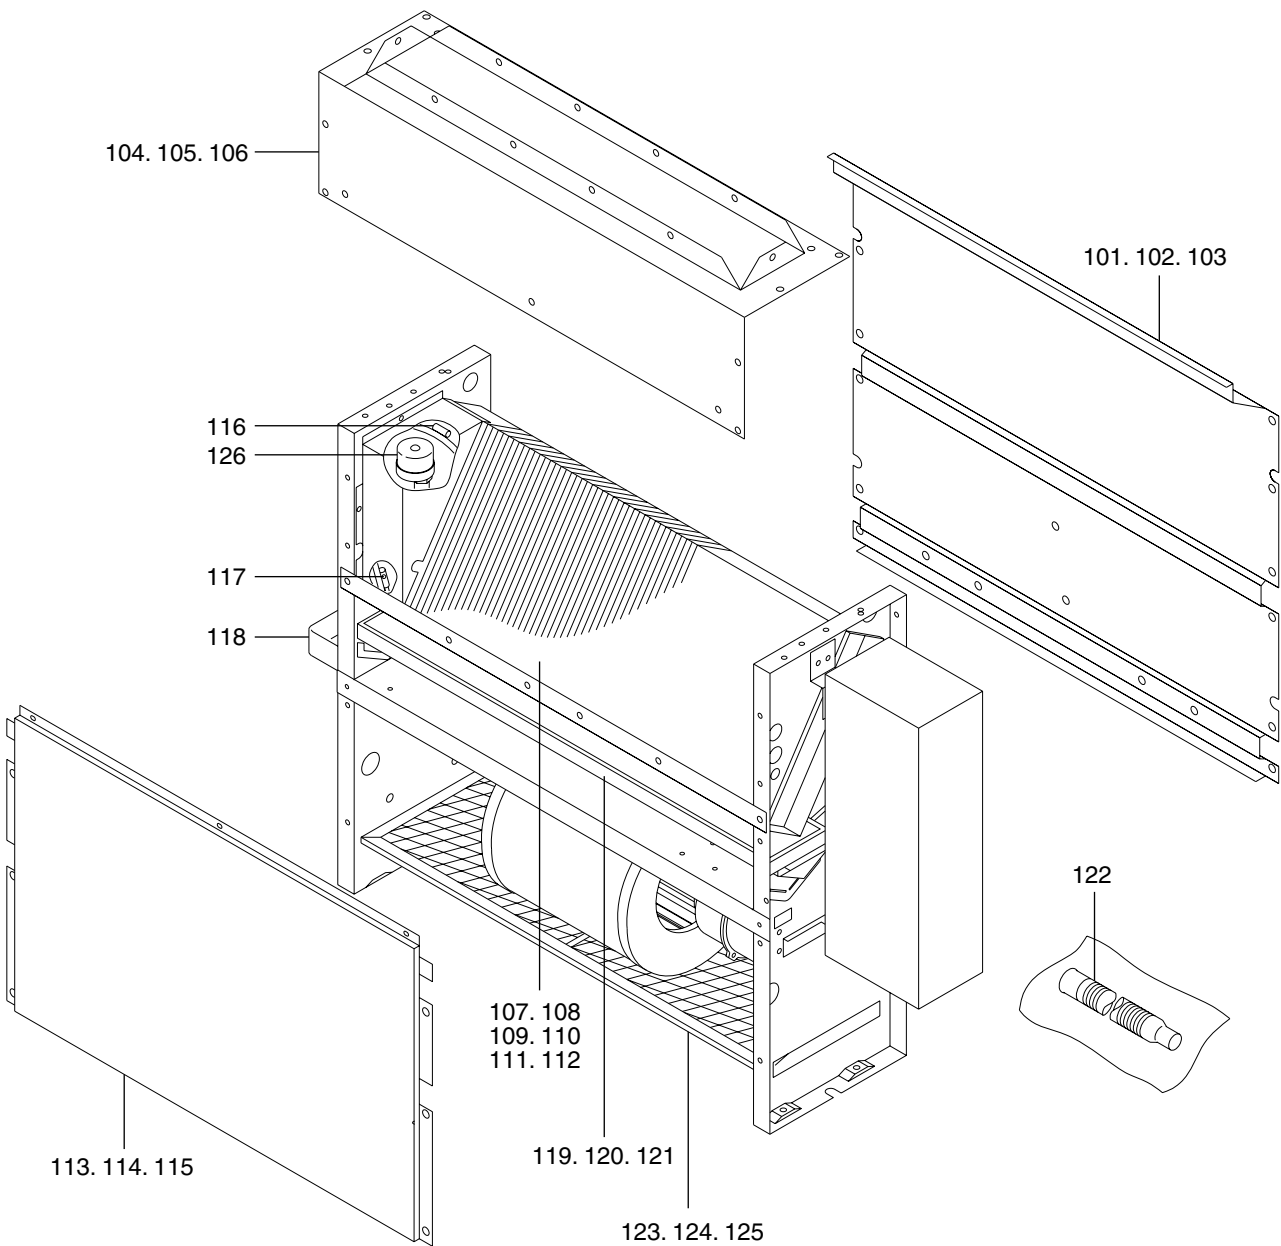


PFFY-P20,P25,P32VLRMM-E
PFFY-P40,P50,P63VLRMM-E


EXTERNAL PARTS

[illegible]

BLOWER PARTS (1)

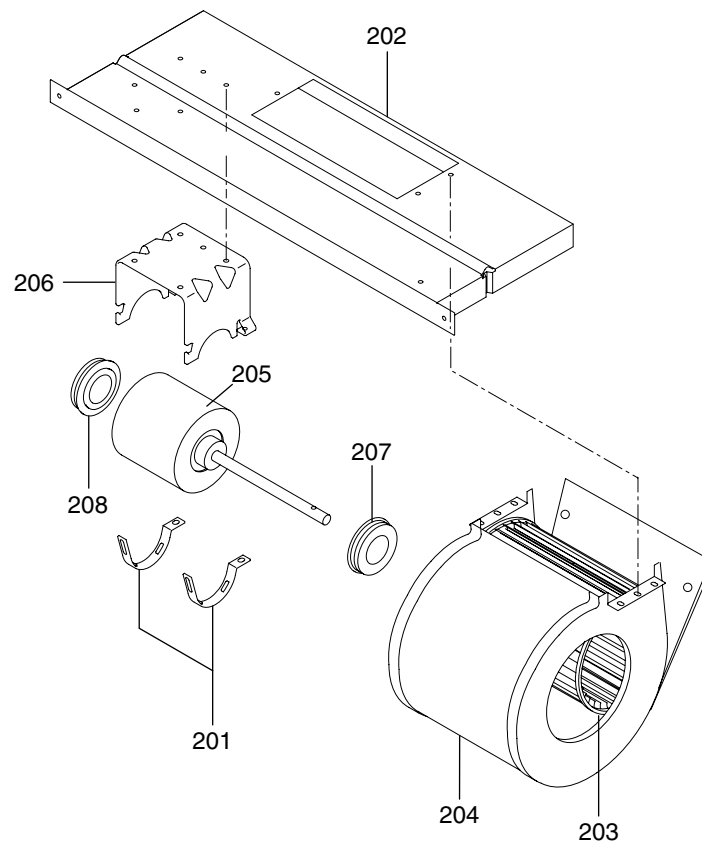
[illegible]

BLOWER PARTS (2)

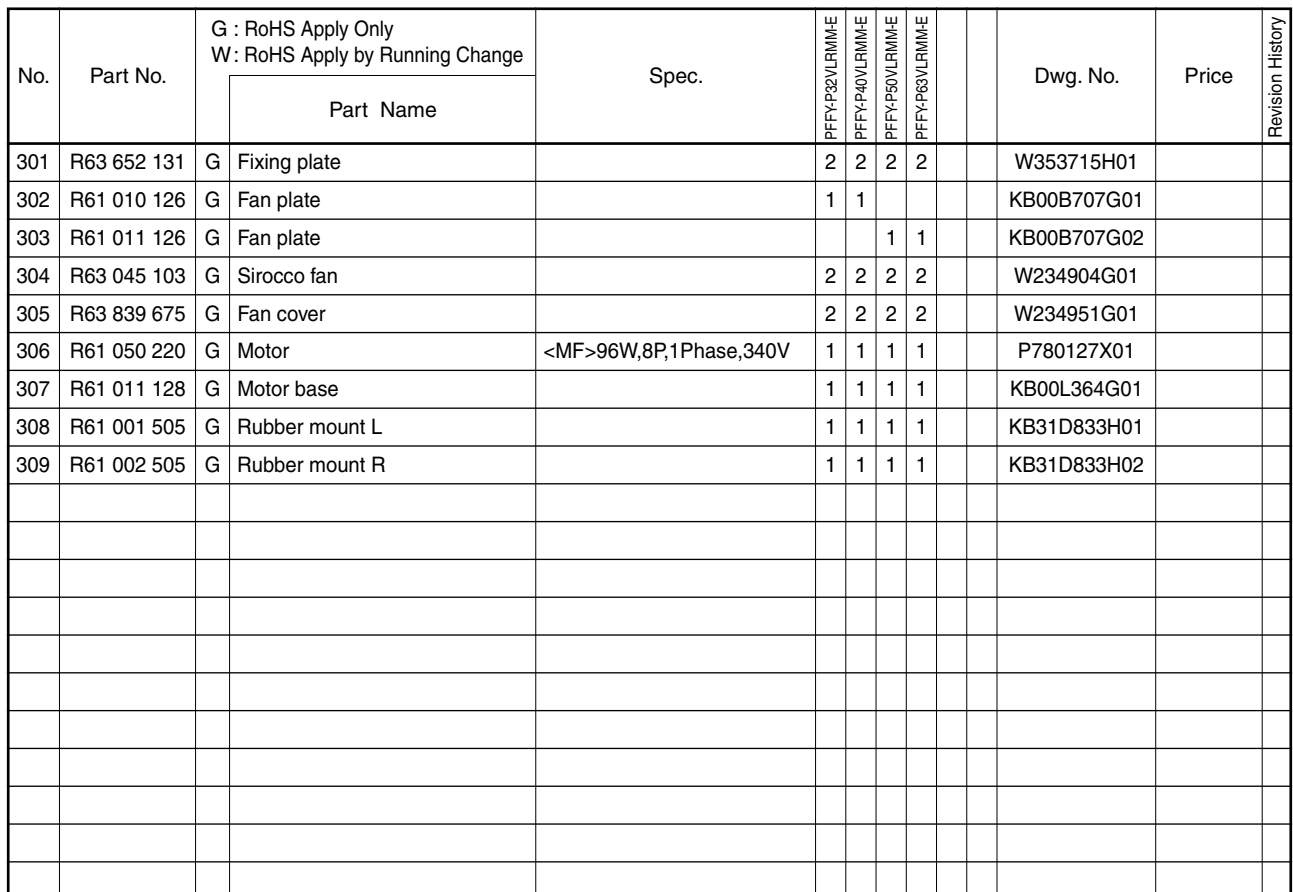

PFFY-P20,P25,P32VLRMM-E
PFFY-P40,P50,P63VLRMM-E

CONTROL BOX PARTS

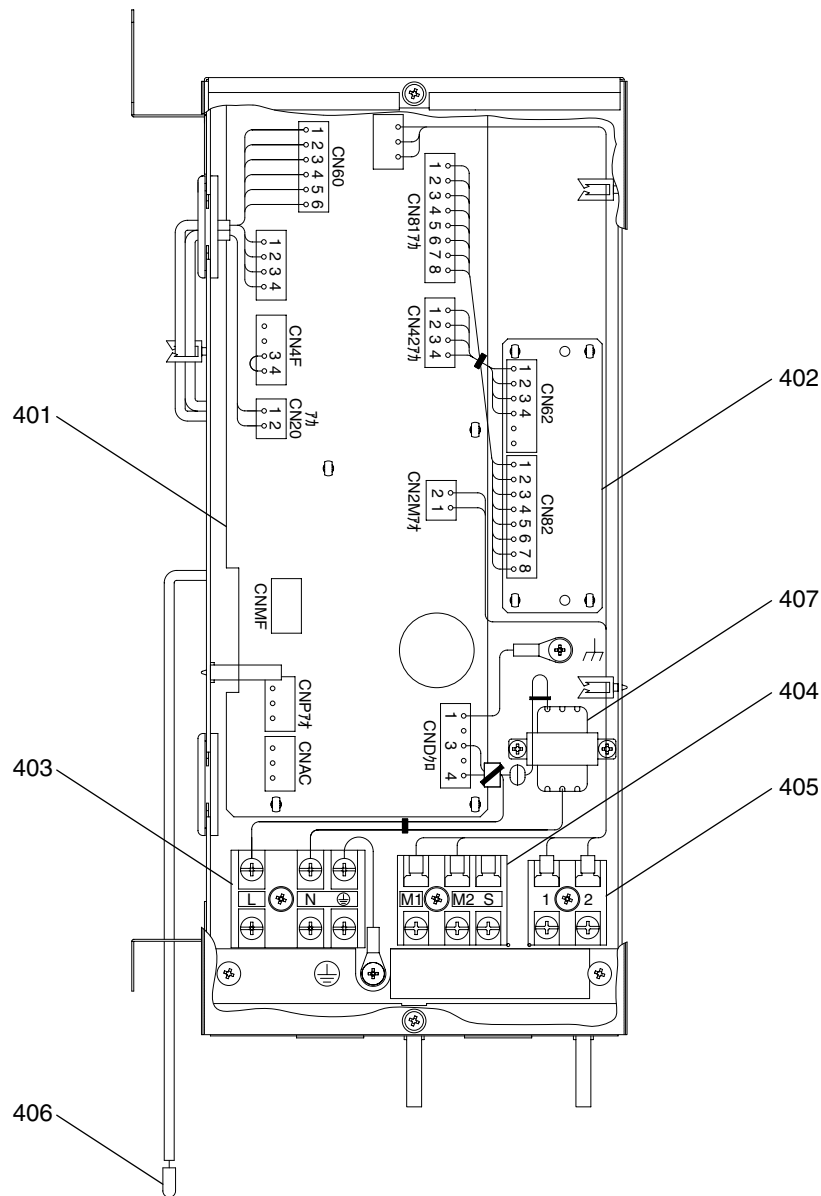

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change		Spec.	PFFY-P20VLRMM-E	PFFY-P25VLRMM-E	PFFY-P32VLRMM-E	PFFY-P40VLRMM-E	PFFY-P50VLRMM-E	PFFY-P63VLRMM-E	Dwg. No.	Price	Revision History
		Part Name											
401	R61 055 280	G	PCA board assy	INDOOR	1	1	1	1	1	1	KE00D204G09		
402	R61 008 280	G	PCA board assy	AD D	1	1	1	1	1	1	KE00D123G03		
403	R61 002 246	G	Terminal block	<TB2>	1	1	1	1	1	1	BG00R200G26		
404	R61 003 246	G	Terminal block	<TB5>	1	1	1	1	1	1	BG00R200G45		
405	R61 004 246	G	Terminal block	<TB15>	1	1	1	1	1	1	BG00R200G15		
406	R61 042 200	G	Thermistor	inlet <RED>	1	1	1	1	1	1	RG71J628H05		
407	R61 006 259	G	Reactor							1	P715434X01		

