Air Conditioning

Product Information

PUHY-P950YSKB-A1 Heat Pump Outdoor Unit Making a World of Difference

CITYMULTI



The City Multi Y Series makes use of a two pipe refrigerant circuit throughout, with branch pipes feeding indoor units, allowing manual changeover from cooling to heating to ensure that a constant indoor climate is maintained.

Key Features

- Designed from day 1 for seasonal efficiency
- New energy-saving inverter driven compressor with very low start currents
- Reduced standby power by up to 50% using induction heated compressor
- By changing the system evaporating temperature, there are various options for indoor units to offer increased air off temperatures, higher SHF and improved comfort, with the benefit of energy saving

A choice of standard reverse defrost or a continued supply of heating during the defrost cycle



Air Conditioning | Heating Ventilation | Controls



Air Conditioning

Product Information


PUHY-P950YSKB-A1 Heat Pump Outdoor Unit Making a World of Difference


PUHY - OUTDOOR UNIT		PUHY-P950YSKB-A1
CAPACITY (kW)	Heating (nominal)	119.5
	Cooling (nominal)	108.0
	High Performance Heating (UK)	113.5
	COP Priority Heating (UK)	105.2
	Cooling (UK)	95.9
POWER INPUT (kW) Heating (nominal)		30.40
	Cooling (nominal)	30.25
	High Performance Heating (UK)	40.58
	COP Priority Heating (UK)	27.66
	Cooling (UK)	18.45
COP / EER (nominal)		3.93 / 3.57
SCOP / SEER (system)		5.39 / 6.91
MAX No. OF CONNECTABLE INDOOR UNITS		50
MAX CONNECTABLE CAPACITY		50-130% OU Capacity
AIRFLOW (m ³ /min)	High	210/210/175
PIPE SIZE mm (in)	Gas	41.28 (1-5/8")
	Liquid	19.05 (3/4")
SOUND PRESSURE LEVEL (dBA)		66.5
SOUND POWER LEVEL (dBA)		87
WEIGHT (kg)		251 + 251 + 199
DIMENSIONS (mm		1220 + 1220 + 920
	Depth	740
(1650mm without legs) Height		1710
ELECTRICAL SUPPLY*		380-415v, 50Hz
PHASE*		Three
STARTING CURRENT (A)*		8/8/8
NOMINAL SYSTEM RUNNING CURRENT (A)*		48.7 / 48.5 [32.7+22.1+17.8]
Heating / Cooling [MAX]		
GUARANTEED OPERATING RANGE (°C)		-20~15.5 / -5~52
Heating / Cooling		
FUSE RATING (MCB sizes BS EN 60947-2) - (A)*		1 x 40 / 1 x 25 / 1 x 20
MAINS CABLE No. Cores*		4 + earth

Note: * A separate power supply is required for each module. Where more than one figure

is quoted there are multiple modules.

DIMENSIONS

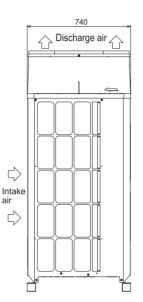

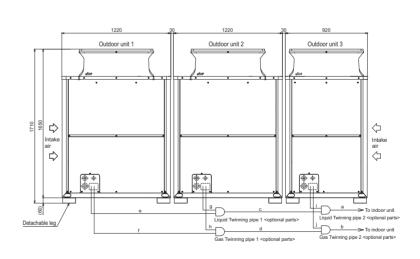



Telephone: 01707 282880

email: air.conditioning@meuk.mee.com web: www.airconditioning.mitsubishielectric.co.uk

UNITED KINGDOM Mitsubishi Electric Europe Living Environmental Systems Division

Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England General Enquiries Telephone: 01707 282880 Fax: 01707 278881 IRELAND Mitsubishi Electric Europe Westgate Business Park, Ballymount, Dublin 24, Ireland Telephone: Dublin (01) 419 8800 Fax: Dublin (01) 419 8890 International code: (003531)

Country of origin: United Kingdom – Japan – Thalland – Malaysia. @Mitsubishi Electric Europe 2015. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe R.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public amouncement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication resent only general practiculars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a cooy of which is available on request. Third-party noduct and brand remes may be trademarks or presendent owners.



Mitsubishi Electric UK's commitment to the environment



You mitsubishielectric2

Note: The fuse rating is for guidance only. Please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electriciar/electricial engineer to select the correct cable size and fuse rating based on current regulation and sile specific conditions. Misubishi Electricis air conditioning and heat pump systems contain fluorinated greenhouse gases R410A, R407C and R134A.

Effective as of April 2015