

**OUTDOOR UNITS**

1. SPECIFICATIONS .....	2 - 278
2. EXTERNAL DIMENSIONS .....	2 - 289
3. CENTER OF GRAVITY .....	2 - 300
4. ELECTRICAL WIRING DIAGRAMS .....	2 - 301
5. SOUND LEVELS .....	2 - 303
6. CAPACITY TABLES .....	2 - 308
6-1. Correction by temperature .....	2 - 308
6-2. Correction by total indoor .....	2 - 316
6-3. Correction by refrigerant piping length .....	2 - 323
6-4. Correction by port counts of the BC controller .....	2 - 326
6-5. Correction at frost and defrost .....	2 - 326
6-6. Operation temperature range .....	2 - 327
7. OPTIONAL PARTS .....	2 - 328
7-1. JOINT .....	2 - 328
7-2. OUTDOOR TWINNING KIT .....	2 - 329
7-3. JOINT KIT CMY-R160-J1 FOR BC CONTROLLER .....	2 - 331

# 1. SPECIFICATIONS

DATA G8

Model			PURY-EP200YJM-A(-BS)	PURY-EP250YJM-A(-BS)	
Power source			3-phase 4-wire 380-400-415V 50/60Hz	3-phase 4-wire 380-400-415V 50/60Hz	
Cooling capacity (Nominal)	*1	kW	22.4	28.0	
	*1	kcal / h	19,300	24,100	
	*1	BTU / h	76,400	95,500	
		Power input	kW	5.07	6.76
		Current input	A	8.5-8.1-7.8	11.4-10.8-10.4
		COP	kW / kW	4.41	4.14
Temp. range of cooling	*3	Indoor	W.B.	15.0~24.0°C(59~75°F)	15.0~24.0°C(59~75°F)
		Outdoor	D.B.	-5.0~46.0°C(23~115°F)	-5.0~46.0°C(23~115°F)
Heating capacity (Nominal)	*2	kW	25.0	31.5	
	*2	kcal / h	21,500	27,100	
	*2	BTU / h	85,300	107,500	
		Power input	kW	5.56	7.15
		Current input	A	9.3-8.9-8.5	12.0-11.4-11.0
		COP	kW / kW	4.49	4.40
Temp. range of heating	*3	Indoor	D.B.	15.0~27.0°C(59~81°F)	15.0~27.0°C(59~81°F)
		Outdoor	W.B.	-20.0~15.5°C(-4~60°F)	-20.0~15.5°C(-4~60°F)
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity	50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 1~20	P15~P250 / 1~25	
Sound pressure level (measured in anechoic room)		dB <A>	57	60	
Power pressure level (measured in anechoic room)		dB <A>	77	80	
Refrigerant piping diameter	High pressure		mm (in.)	15.88(5/8) Brazed	19.05(3/4) Brazed
	Low pressure		mm (in.)	19.05(3/4) Brazed	22.2(7/8) Brazed
FAN	Type x Quantity		Propeller fan x 1		
	Air flow rate	m <sup>3</sup> / min		185	225
		L/s		3,083	3,750
		cfm		6,532	7,945
	Control, Driving mechanism		Inverter-control, Direct-driven by motor		
	Motor output		kW	0.92 x 1	0.92 x 1
*4 External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)	
Compressor	Type x Quantity		Inverter scroll hermetic compressor		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter		
	Motor output		kW	5.4	6.8
	Case heater		kW	0.035(240 V)	0.045(240 V)
	Lubricant		MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD		mm	1,710(1,650 without legs) x 920 x 760	1,710(1,650 without legs) x 1,220 x 760	
		in.	67-3/8(65 without legs) x 36-1/4 x 29-15/16	67-3/8(65 without legs) x 48-1/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		
	Compressor		Over-heat protection		
	Fan motor		Thermal switch		
Refrigerant	Type x original charge		R410A x 9.5kg (21lbs)		
	Control		Indoor LEV and BC controller		
Net weight		kg (lbs)	240(530)	270(596)	
Heat exchanger			Salt-resistant cross fin & copper tube		
HIC circuit (HIC: Heat Inter-Changer)			-		
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)		
Drawing	External		WKD94G054		
	Wiring		WYN B0-7952		
Standard attachment	Document		Installation Manual		
	Accessory		Refrigerant conn. pipe		
Optional parts			Joint: CMY-Y102S-G2,CMY-Y102L-G2,CMY-R160-J1 BC controller: CMB-P104,105,106,108,1010,1013,1016V-G1 Main BC controller: CMB-P108,1010,1013,1016V-GA1 Sub BC controller: CMB-P104,108V-GB1,CMB-P1016V-HB1	Joint: CMY-Y102S-G2,CMY-Y102L-G2,CMY-R160-J1 BC controller: CMB-P104,105,106,108,1010,1013,1016V-G1 Main BC controller: CMB-P108,1010,1013,1016V-GA1 Sub BC controller: CMB-P104,108V-GB1,CMB-P1016V-HB1	
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice.		

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536
*Above specification data is subject to rounding variation.	

# 1. SPECIFICATIONS

DATA G8

Model		PURY-EP300YJM-A(-BS)		PURY-EP350YJM-A(-BS)		
Power source		3-phase 4-wire 380-400-415V 50/60Hz		3-phase 4-wire 380-400-415V 50/60Hz		
Cooling capacity (Nominal)	*1	kW	33.5	40.0		
	*1	kcal / h	28,800	34,400		
	*1	BTU / h	114,300	136,500		
		Power input	kW	8.25	10.28	
		Current input	A	13.9-13.2-12.7	17.3-16.4-15.8	
		COP	kW / kW	4.06	3.89	
Temp. range of cooling	*3	Indoor	W.B.	15.0~24.0°C(59~75°F)		
		Outdoor	D.B.	-5.0~46.0°C(23~115°F)		
Heating capacity (Nominal)	*2	kW	37.5	45.0		
	*2	kcal / h	32,300	38,700		
	*2	BTU / h	128,000	153,500		
		Power input	kW	8.60	10.58	
		Current input	A	14.5-13.7-13.2	17.8-16.9-16.3	
		COP	kW / kW	4.36	4.25	
Temp. range of heating	*3	Indoor	D.B.	15.0~27.0°C(59~81°F)		
		Outdoor	W.B.	-20.0~15.5°C(-4~60°F)		
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity		50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 1~30		P15~P250 / 1~35	
Sound pressure level (measured in anechoic room)	dB <A>		60		61	
Power pressure level (measured in anechoic room)	dB <A>		80		81	
Refrigerant piping diameter	High pressure		mm (in.)		19.05(3/4) Brazed	
	Low pressure		mm (in.)		22.2(7/8) Brazed	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 2	
	Air flow rate	m <sup>3</sup> / min		225		360
		L/s		3,750		6,000
		cfm		7,945		12,712
	Control, Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
	Motor output		kW		0.92 x 1	0.92 x 2
*4 External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output		kW		7.8	9.9
	Case heater		kW		0.045(240 V)	0.045(240 V)
	Lubricant		MEL32		MEL32	
External finish		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		
External dimension HxWxD		mm		1,710(1,650 without legs) x 1,220 x 760		
		in.		67-3/8(65 without legs) x 48-1/16 x 29-15/16		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller		Indoor LEV and BC controller	
Net weight		kg (lbs)		270(596)		
Heat exchanger		Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube		
HIC circuit (HIC: Heat Inter-Changer)						
Defrosting method		Auto-defrost mode (Reversed refrigerant cycle)		Auto-defrost mode (Reversed refrigerant cycle)		
Drawing	External		WKD94G055		WKD94G056	
	Wiring		WYN B0-7952		WYN B0-7952	
Standard attachment	Document		Installation Manual		Installation Manual	
	Accessory		Refrigerant conn. pipe		Refrigerant conn. pipe	
Optional parts		Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 BC controller: CMB-P104, 105, 106, 108, 1010, 1013, 1016V-G1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1		Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 BC controller: CMB-P104, 105, 106, 108, 1010, 1013, 1016V-G1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1		
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice.		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice.		

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 3-5°CDB. (23°FDB.)-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter	
kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536
*Above specification data is subject to rounding variation.	

# 1. SPECIFICATIONS

Model			PURY-EP400YSJM-A(-BS)		
Power source			3-phase 4-wire 380-400-415V 50/60Hz		
Cooling capacity (Nominal)	*1	kW	45.0		
	*1	kcal / h	38,700		
	*1	BTU / h	153,500		
		Power input	kW		
		Current input	A		
		COP	kW / kW		
			4.32		
Temp. range of cooling	*3	Indoor	W.B.		
		Outdoor	D.B.		
			15.0~24.0°C(59~75°F)		
			-5.0~46.0°C(23~115°F)		
Heating capacity (Nominal)	*2	kW	50.0		
	*2	kcal / h	43,000		
	*2	BTU / h	170,600		
		Power input	kW		
		Current input	A		
		COP	kW / kW		
			4.40		
Temp. range of heating	*3	Indoor	D.B.		
		Outdoor	W.B.		
			15.0~27.0°C(59~81°F)		
			-20.0~15.5°C(-4~60°F)		
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity		
	Model / Quantity		P15~P250 / 1~40		
Sound pressure level (measured in anechoic room)			dB <A>		
			60		
Power pressure level (measured in anechoic room)			dB <A>		
			80		
Refrigerant piping diameter	High pressure		mm (in.)		
	Low pressure		mm (in.)		
				22.2(7/8) Brazed	
				28.58(1-1/8) Brazed	

Set Model			PURY-EP200YJM-A(-BS)		PURY-EP200YJM-A(-BS)	
Model			Propeller fan x 1		Propeller fan x 1	
FAN	Type x Quantity		185		185	
	Air flow rate	m <sup>3</sup> / min	3,083		3,083	
		L/s	6,532		6,532	
		cfm	Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
	Control, Driving mechanism		0.92 x 1		0.92 x 1	
*4	Motor output	0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
External static press.						
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	5.4		5.4	
	Case heater	kW	0.035(240 V)		0.035(240 V)	
Lubricant		MEL32		MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD			mm		mm	
			1,710(1,650 without legs) x 920 x 760		1,710(1,650 without legs) x 920 x 760	
			in.		in.	
			67-3/8(65 without legs) x 36-1/4 x 29-15/16		67-3/8(65 without legs) x 36-1/4 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 9.5kg (21lbs)		R410A x 9.5kg (21lbs)	
	Control		Indoor LEV and BC controller			
Net weight		kg (lbs)	240(530)		240(530)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)			-			
Pipe between unit and distributor	High pressure	mm (in.)	15.88(5/8) Brazed		15.88(5/8) Brazed	
	Low pressure	mm (in.)	19.05(3/4) Brazed		-	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G057			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory					
Optional parts			Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

Notes :	Unit converter
1.Nominal cooling conditions(subject to JIS B8615-1) Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	kcal =kW x 860
2.Nominal heating conditions(subject to JIS B8615-1) Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	BTU/h =kW x 3,412
3.-5°CDB. (23°FDB.)-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.) with cooling/heating mixed operation.	cfm =m <sup>3</sup> /min x 35.31
4.External static pressure option is available (30Pa, 60Pa / 3.1mmH <sub>2</sub> O, 6.1mmH <sub>2</sub> O).	lb =kg / 0.4536
	*Above specification data is subject to rounding variation.

# 1. SPECIFICATIONS

DATA G8

Model			PURY-EP450YSJM-A(-BS)	
Power source	3-phase 4-wire 380-400-415V 50/60Hz			
Cooling capacity (Nominal)	*1	kW	50.0	
	*1	kcal / h	43,000	
	*1	BTU / h	170,600	
		Power input	kW	11.99
		Current input	A	
		COP	kW / kW	
Temp. range of cooling	*3	Indoor	W.B.	
		Outdoor	D.B.	
Heating capacity (Nominal)	*2	kW	56.0	
	*2	kcal / h	48,200	
	*2	BTU / h	191,100	
		Power input	kW	12.87
		Current input	A	
		COP	kW / kW	
Temp. range of heating	*3	Indoor	D.B.	
		Outdoor	W.B.	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 1~45	
Sound pressure level (measured in anechoic room)	dB <A>		62	
Power pressure level (measured in anechoic room)	dB <A>		82	
Refrigerant piping diameter	High pressure		mm (in.)	
	Low pressure		mm (in.)	

Set Model			PURY-EP200YJM-A(-BS)		PURY-EP250YJM-A(-BS)	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 1	
	Air flow rate	m <sup>3</sup> / min	185		225	
		L/s	3,083		3,750	
		cfm	6,532		7,945	
	Control , Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
*4	Motor output	kW	0.92 x 1		0.92 x 1	
External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	5.4		6.8	
	Case heater	kW	0.035(240 V)		0.045(240 V)	
	Lubricant		MEL32		MEL32	
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD			mm 1,710(1,650 without legs) x 920 x 760		mm 1,710(1,650 without legs) x 1,220 x 760	
			in. 67-3/8(65 without legs) x 36-1/4 x 29-15/16		in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 9.5kg (21lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight	kg (lbs)		240(530)		270(596)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)						
Pipe between unit and distributor	High pressure		mm (in.)		mm (in.)	
	Low pressure		mm (in.)		mm (in.)	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G058			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts			Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

Notes :	Unit converter
1.Nominal cooling conditions(subject to JIS B8615-1) Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	kcal =kW x 860
2.Nominal heating conditions(subject to JIS B8615-1) Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	BTU/h =kW x 3,412
3.-5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.) with cooling/heating mixed operation.	cfm =m <sup>3</sup> /min x 35.31
4.External static pressure option is available (30Pa, 60Pa / 3.1mmH <sub>2</sub> O, 6.1mmH <sub>2</sub> O).	lb =kg / 0.4536
	*Above specification data is subject to rounding variation.

# 1. SPECIFICATIONS

Model			PURY-EP500YSJM-A(-BS)		
Power source	3-phase 4-wire 380-400-415V 50/60Hz				
Cooling capacity (Nominal)	*1	kW	56.0		
	*1	kcal / h	48,200		
	*1	BTU / h	191,100		
		Power input	kW	13.62	
		Current input	A	22.9-21.8-21.0	
	COP	kW / kW	4.11		
Temp. range of cooling	*3	Indoor	W.B.	15.0~24.0°C(59~75°F)	
		Outdoor	D.B.	-5.0~46.0°C(23~115°F)	
Heating capacity (Nominal)	*2	kW	63.0		
	*2	kcal / h	54,200		
	*2	BTU / h	215,000		
		Power input	kW	14.38	
		Current input	A	24.2-23.0-22.2	
	COP	kW / kW	4.38		
Temp. range of heating	*3	Indoor	D.B.	15.0~27.0°C(59~81°F)	
		Outdoor	W.B.	-20.0~15.5°C(-4~60°F)	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity		
	Model / Quantity		P15~P250 / 1~50		
Sound pressure level (measured in anechoic room)	dB <A>		62		
Power pressure level (measured in anechoic room)	dB <A>		82		
Refrigerant piping diameter	High pressure		22.2(7/8) Brazed		
	Low pressure		28.58(1-1/8) Brazed		

Set Model

Model			PURY-EP200YJM-A(-BS)		PURY-EP300YJM-A(-BS)	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 1	
	Air flow rate	m <sup>3</sup> / min	185		225	
		L/s	3,083		3,750	
		cfm	6,532		7,945	
	Control , Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
*4	Motor output	kW	0.92 x 1		0.92 x 1	
External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	5.4		7.8	
	Case heater	kW	0.035(240 V)		0.045(240 V)	
Lubricant		MEL32		MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD		mm	1,710(1,650 without legs) x 920 x 760		1,710(1,650 without legs) x 1,220 x 760	
		in.	67-3/8(65 without legs) x 36-1/4 x 29-15/16		67-3/8(65 without legs) x 48-1/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 9.5kg (21lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight	kg (lbs)		240(530)		270(596)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)			-			
Pipe between unit and distributor	High pressure	mm (in.)	15.88(5/8) Brazed		19.05(3/4) Brazed	
	Low pressure	mm (in.)	19.05(3/4) Brazed		-	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G058			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts			Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2,CMY-Y102L-G2,CMY-R160-J1 Main BC controller: CMB-P108,1010,1013,1016V-GA1 Sub BC controller: CMB-P104,108V-GB1,CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536

\*Above specification data is subject to rounding variation.

# 1. SPECIFICATIONS

DATA G8

Model			<b>PURY-EP500YSJM-A1(-BS)</b>		
Power source			3-phase 4-wire 380-400-415V 50/60Hz		
Cooling capacity (Nominal)	*1	kW	56.0		
	*1	kcal / h	48,200		
	*1	BTU / h	191,100		
	Power input		kW		
Current input		A			
COP		kW / kW			
Temp. range of cooling	*3	Indoor	W.B. 15.0~24.0°C(59~75°F)		
		Outdoor	D.B. -5.0~46.0°C(23~115°F)		
Heating capacity (Nominal)	*2	kW	63.0		
	*2	kcal / h	54,200		
	*2	BTU / h	215,000		
	Power input		kW		
Current input		A			
COP		kW / kW			
Temp. range of heating	*3	Indoor	D.B. 15.0~27.0°C(59~81°F)		
		Outdoor	W.B. -20.0~15.5°C(-4~60°F)		
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity		
	Model / Quantity		P15~P250 / 1~50		
Sound pressure level (measured in anechoic room)			dB <A> 63		
Power pressure level (measured in anechoic room)			dB <A> 83		
Refrigerant piping diameter	High pressure		mm (in.) 22.2(7/8) Brazed		
	Low pressure		mm (in.) 28.58(1-1/8) Brazed		

Set Model

Model			<b>PURY-EP250YJM-A(-BS)</b>			<b>PURY-EP250YJM-A(-BS)</b>		
FAN	Type x Quantity		Propeller fan x 1			Propeller fan x 1		
	Air flow rate	m <sup>3</sup> / min	225			225		
		L/s	3,750			3,750		
		cfm	7,945			7,945		
	Control , Driving mechanism		Inverter-control, Direct-driven by motor			Inverter-control, Direct-driven by motor		
	Motor output		kW 0.92 x 1			0.92 x 1		
*4 External static press.		0 Pa (0 mmH <sub>2</sub> O)			0 Pa (0 mmH <sub>2</sub> O)			
Compressor	Type x Quantity		Inverter scroll hermetic compressor			Inverter scroll hermetic compressor		
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION			AC&R Works, MITSUBISHI ELECTRIC CORPORATION		
	Starting method		Inverter			Inverter		
	Motor output		kW 6.8			6.8		
	Case heater		kW 0.045(240 V)			0.045(240 V)		
	Lubricant		MEL32			MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		
External dimension HxWxD			mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16			mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)			High pressure sensor, High pressure switch at 4.15MPa (601 psi)		
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection			Over-heat protection, Over-current protection		
	Compressor		Over-heat protection			Over-heat protection		
	Fan motor		Thermal switch			Thermal switch		
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)			R410A x 11.8kg (27lbs)		
	Control		Indoor LEV and BC controller					
Net weight			kg (lbs) 270(596)			270(596)		
Heat exchanger			Salt-resistant cross fin & copper tube			Salt-resistant cross fin & copper tube		
HIC circuit (HIC: Heat Inter-Changer)			-					
Pipe between unit and distributor	High pressure		mm (in.) 19.05(3/4) Brazed			19.05(3/4) Brazed		
	Low pressure		mm (in.) 22.2(7/8) Brazed			-		
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)					
Drawing	External		WKD94G059					
	Wiring		WYN B0-7953			WYN B0-7953		
Standard attachment	Document		Installation Manual					
	Accessory		Refrigerant conn. pipe					
Optional parts			Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1					
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.					

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB, (23°FDB) / -6°CWB, (21°FWB) to 21°CDB, (70°FDB) / 15.5°CWB, (60°FWB)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536

\*Above specification data is subject to rounding variation.



# 1. SPECIFICATIONS

Model			PURY-EP550YSJM-A(-BS)	
Power source			3-phase 4-wire 380-400-415V 50/60Hz	
Cooling capacity (Nominal)	*1	kW	63.0	
	*1	kcal / h	54,200	
	*1	BTU / h	215,000	
		Power input	15.40	
		Current input	25.9-24.6-23.8	
	COP	4.09		
Temp. range of cooling	*3 Indoor	W.B.	15.0~24.0°C(59~75°F)	
	*3 Outdoor	D.B.	-5.0~46.0°C(23~115°F)	
Heating capacity (Nominal)	*2	kW	69.0	
	*2	kcal / h	59,300	
	*2	BTU / h	235,400	
		Power input	15.93	
		Current input	26.8-25.5-24.6	
	COP	4.33		
Temp. range of heating	*3 Indoor	D.B.	15.0~27.0°C(59~81°F)	
	*3 Outdoor	W.B.	-20.0~15.5°C(-4~60°F)	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 2~50	
Sound pressure level (measured in anechoic room)			dB <A>	
Power pressure level (measured in anechoic room)			83	
Refrigerant piping diameter	High pressure		28.58(1-1/8) Brazed	
	Low pressure		28.58(1-1/8) Brazed	

Set Model

Model			PURY-EP250YJM-A(-BS)		PURY-EP300YJM-A(-BS)	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 1	
	Air flow rate	m <sup>3</sup> / min	225		225	
		L/s	3,750		3,750	
		cfm	7,945		7,945	
	Control, Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
*4	Motor output	0.92 x 1		0.92 x 1		
External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	6.8		7.8	
	Case heater	kW	0.045(240 V)		0.045(240 V)	
Lubricant		MEL32		MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD			mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16		mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight			kg (lbs)		270(596)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)			-		-	
Pipe between unit and distributor	High pressure	mm (in.)	19.05(3/4) Brazed		19.05(3/4) Brazed	
	Low pressure	mm (in.)	22.2(7/8) Brazed		-	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G059			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts			Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536

\*Above specification data is subject to rounding variation.



# 1. SPECIFICATIONS

DATA G8

Model			<b>PURY-EP600YSJM-A(-BS)</b>			
Power source			3-phase 4-wire 380-400-415V 50/60Hz			
Cooling capacity (Nominal)	*1	kW	69.0			
	*1	kcal / h	59,300			
	*1	BTU / h	235,400			
	Power input		16.87			
Current input		A			28.4-27.0-26.0	
COP		kW / kW			4.09	
Temp. range of cooling	*3	Indoor	W.B.			15.0~24.0°C(59~75°F)
		Outdoor	D.B.			-5.0~46.0°C(23~115°F)
Heating capacity (Nominal)	*2	kW	76.5			
	*2	kcal / h	65,800			
	*2	BTU / h	261,000			
	Power input		17.38			
Current input		A			29.3-27.8-26.8	
COP		kW / kW			4.40	
Temp. range of heating	*3	Indoor	D.B.			15.0~27.0°C(59~81°F)
		Outdoor	W.B.			-20.0~15.5°C(-4~60°F)
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity			
	Model / Quantity		P15~P250 / 2~50			
Sound pressure level (measured in anechoic room)		dB <A>		63		
Power pressure level (measured in anechoic room)		dB <A>		83		
Refrigerant piping diameter	High pressure		mm (in.)			28.58(1-1/8) Brazed
	Low pressure		mm (in.)			28.58(1-1/8) Brazed

Set Model								
Model		<b>PURY-EP300YJM-A(-BS)</b>		<b>PURY-EP300YJM-A(-BS)</b>				
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 1			
	Air flow rate	m <sup>3</sup> / min		225		225		
		L/s		3,750		3,750		
		cfm		7,945		7,945		
	Control , Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor			
	Motor output		kW		0.92 x 1		0.92 x 1	
*4 External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)				
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor			
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION			
	Starting method		Inverter		Inverter			
	Motor output		kW		7.8		7.8	
	Case heater		kW		0.045(240 V)		0.045(240 V)	
	Lubricant		MEL32		MEL32			
External finish		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>				
External dimension HxWxD		mm		1,710(1,650 without legs) x 1,220 x 760		1,710(1,650 without legs) x 1,220 x 760		
		in.		67-3/8(65 without legs) x 48-1/16 x 29-15/16		67-3/8(65 without legs) x 48-1/16 x 29-15/16		
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)			
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection			
	Compressor		Over-heat protection		Over-heat protection			
	Fan motor		Thermal switch		Thermal switch			
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)			
	Control		Indoor LEV and BC controller					
Net weight		kg (lbs)		270(596)		270(596)		
Heat exchanger		Salt-resistant cross fin & copper tube				Salt-resistant cross fin & copper tube		
HIC circuit (HIC: Heat Inter-Changer)						-		
Pipe between unit and distributor	High pressure		mm (in.)		19.05(3/4) Brazed		19.05(3/4) Brazed	
	Low pressure		mm (in.)		22.2(7/8) Brazed		-	
Defrosting method		Auto-defrost mode (Reversed refrigerant cycle)						
Drawing	External		WKD94G059					
	Wiring		WYN B0-7953		WYN B0-7953			
Standard attachment	Document		Installation Manual					
	Accessory		Refrigerant conn. pipe					
Optional parts		Outdoor Twinning kit: CMY-R100VBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1						
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.						

Notes :			Unit converter		
1.Nominal cooling conditions(subject to JIS B8615-1) Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)			kcal =kW x 860		
2.Nominal heating conditions(subject to JIS B8615-1) Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)			BTU/h =kW x 3,412		
3.-5°CDB. (23°FDB.)-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.) with cooling/heating mixed operation.			cfm =m <sup>3</sup> /min x 35.31		
4.External static pressure option is available (30Pa, 60Pa / 3.1mmH <sub>2</sub> O, 6.1mmH <sub>2</sub> O).			lb =kg / 0.4536		
			*Above specification data is subject to rounding variation.		

# 1. SPECIFICATIONS

Model			PURY-EP600YSJM-A1(-BS)		
Power source	3-phase 4-wire 380-400-415V 50/60Hz				
Cooling capacity (Nominal)	*1	kW	69.0		
	*1	kcal / h	59,300		
	*1	BTU / h	235,400		
		Power input	kW	17.82	
		Current input	A	30.0-28.5-27.5	
	COP	kW / kW	3.87		
Temp. range of cooling	*3	Indoor	W.B.	15.0~24.0°C(59~75°F)	
		Outdoor	D.B.	-5.0~46.0°C(23~115°F)	
Heating capacity (Nominal)	*2	kW	76.5		
	*2	kcal / h	65,800		
	*2	BTU / h	261,000		
		Power input	kW	18.30	
		Current input	A	30.8-29.3-28.2	
	COP	kW / kW	4.18		
Temp. range of heating	*3	Indoor	D.B.	15.0~27.0°C(59~81°F)	
		Outdoor	W.B.	-20.0~15.5°C(-4~60°F)	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity		
	Model / Quantity		P15~P250 / 2~50		
Sound pressure level (measured in anechoic room)	dB <A>		63.5		
Power pressure level (measured in anechoic room)	dB <A>		83.5		
Refrigerant piping diameter	High pressure		28.58(1-1/8) Brazed		
	Low pressure		28.58(1-1/8) Brazed		

Set Model

Model			PURY-EP250YJM-A(-BS)		PURY-EP350YJM-A(-BS)	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 2	
	Air flow rate	m <sup>3</sup> / min	225		360	
		L/s	3,750		6,000	
		cfm	7,945		12,712	
	Control , Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
	Motor output	kW	0.92 x 1		0.92 x 2	
*4	External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)	
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output	kW	6.8		9.9	
	Case heater	kW	0.045(240 V)		0.045(240 V)	
Lubricant		MEL32		MEL32		
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD			mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16		mm 1,710(1,650 without legs) x 1,750 x 760 in. 67-3/8(65 without legs) x 68-15/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight	kg (lbs)		270(596)		320(706)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)			-		-	
Pipe between unit and distributor	High pressure	mm (in.)	19.05(3/4) Brazed		19.05(3/4) Brazed	
	Low pressure	mm (in.)	22.2(7/8) Brazed		-	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G060			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts			Outdoor Twinning kit: CMY-R100XLVBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536

\*Above specification data is subject to rounding variation.

# 1. SPECIFICATIONS

DATA G8

Model			PURY-EP650YSJM-A(-BS)	
Power source			3-phase 4-wire 380-400-415V 50/60Hz	
Cooling capacity (Nominal)	*1	kW	73.0	
	*1	kcal / h	62,800	
	*1	BTU / h	249,100	
	Power input		19.01	
Current input		A		32.0-30.4-29.3
COP		kW / kW		3.84
Temp. range of cooling	*3	Indoor	W.B. 15.0~24.0°C(59~75°F)	
		Outdoor	D.B. -5.0~46.0°C(23~115°F)	
Heating capacity (Nominal)	*2	kW	81.5	
	*2	kcal / h	70,100	
	*2	BTU / h	278,100	
	Power input		19.73	
Current input		A		33.3-31.6-30.4
COP		kW / kW		4.13
Temp. range of heating	*3	Indoor	D.B. 15.0~27.0°C(59~81°F)	
		Outdoor	W.B. -20.0~15.5°C(-4~60°F)	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 2~50	
Sound pressure level (measured in anechoic room)			dB <A> 63.5	
Power pressure level (measured in anechoic room)			dB <A> 83.5	
Refrigerant piping diameter	High pressure		mm (in.) 28.58(1-1/8) Brazed	
	Low pressure		mm (in.) 28.58(1-1/8) Brazed	

## Set Model

Model			PURY-EP300YJM-A(-BS)		PURY-EP350YJM-A(-BS)	
FAN	Type x Quantity		Propeller fan x 1		Propeller fan x 2	
	Air flow rate	m <sup>3</sup> / min	225		360	
		L/s	3,750		6,000	
		cfm	7,945		12,712	
	Control , Driving mechanism		Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
	Motor output		kW 0.92 x 1		0.92 x 2	
*4 External static press.		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
Compressor	Type x Quantity		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor	
	Manufacture		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter		Inverter	
	Motor output		kW 7.8		9.9	
	Case heater		kW 0.045(240 V)		0.045(240 V)	
	Lubricant		MEL32		MEL32	
External finish			Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>		Pre-coated galvanized steel sheets (+powder coating for -BS type) <MUNSELL 5Y 8/1 or similar>	
External dimension HxWxD			mm 1,710(1,650 without legs) x 1,220 x 760 in. 67-3/8(65 without legs) x 48-1/16 x 29-15/16		mm 1,710(1,650 without legs) x 1,750 x 760 in. 67-3/8(65 without legs) x 68-15/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight			kg (lbs) 270(596)		320(706)	
Heat exchanger			Salt-resistant cross fin & copper tube		Salt-resistant cross fin & copper tube	
HIC circuit (HIC: Heat Inter-Changer)						
Pipe between unit and distributor	High pressure		mm (in.) 19.05(3/4) Brazed		19.05(3/4) Brazed	
	Low pressure		mm (in.) 22.2(7/8) Brazed		-	
Defrosting method			Auto-defrost mode (Reversed refrigerant cycle)			
Drawing	External		WKD94G060			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts			Outdoor Twinning kit: CMY-R100XLVBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P108, 1010, 1013, 1016V-GA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1			
Remarks			Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.			

## Notes :

- Nominal cooling conditions(subject to JIS B8615-1)  
Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- Nominal heating conditions(subject to JIS B8615-1)  
Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB)  
Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)
- 5°CDB. (23°FDB.)/-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.)  
with cooling/heating mixed operation.
- External static pressure option is available (30Pa, 60Pa / 3.1mmH<sub>2</sub>O, 6.1mmH<sub>2</sub>O).

## Unit converter

kcal	=kW x 860
BTU/h	=kW x 3,412
cfm	=m <sup>3</sup> /min x 35.31
lb	=kg / 0.4536

\*Above specification data is subject to rounding variation.

# 1. SPECIFICATIONS


Model			PURY-EP700YSJM-A(-BS)	
Power source			3-phase 4-wire 380-400-415V 50/60Hz	
Cooling capacity (Nominal)	*1	kW	80.0	
	*1	kcal / h	68,800	
	*1	BTU / h	273,000	
		Power input	kW	
		Current input	A	
		COP	kW / kW	
			3.77	
Temp. range of cooling	*3	Indoor	W.B.	
		Outdoor	D.B.	
			15.0~24.0°C(59~75°F)	
			-5.0~46.0°C(23~115°F)	
Heating capacity (Nominal)	*2	kW	88.0	
	*2	kcal / h	75,700	
	*2	BTU / h	300,300	
		Power input	kW	
		Current input	A	
		COP	kW / kW	
			3.99	
Temp. range of heating	*3	Indoor	D.B.	
		Outdoor	W.B.	
			15.0~27.0°C(59~81°F)	
			-20.0~15.5°C(-4~60°F)	
Indoor unit connectable	Total capacity		50~150 % of outdoor unit capacity	
	Model / Quantity		P15~P250 / 2~50	
Sound pressure level (measured in anechoic room)		dB <A>	64	
Power pressure level (measured in anechoic room)		dB <A>	84	
Refrigerant piping diameter	High pressure		mm (in.)	
	Low pressure		mm (in.)	
			28.58(1-1/8) Brazed	
			34.93(1-3/8) Brazed	

Set Model			PURY-EP350YJM-A(-BS)		PURY-EP350YJM-A(-BS)	
Model			Propeller fan x 2		Propeller fan x 2	
FAN	Type x Quantity		360		360	
	Air flow rate	m <sup>3</sup> / min	6,000		6,000	
		L/s	12,712		12,712	
		cfm	Inverter-control, Direct-driven by motor		Inverter-control, Direct-driven by motor	
	Control, Driving mechanism		0.92 x 2		0.92 x 2	
Motor output		0 Pa (0 mmH <sub>2</sub> O)		0 Pa (0 mmH <sub>2</sub> O)		
*4 External static press.		Inverter scroll hermetic compressor		Inverter scroll hermetic compressor		
Compressor	Type x Quantity		AC&R Works, MITSUBISHI ELECTRIC CORPORATION		AC&R Works, MITSUBISHI ELECTRIC CORPORATION	
	Manufacture		Inverter		Inverter	
	Starting method		9.9		9.9	
	Motor output		0.045(240 V)		0.045(240 V)	
	Case heater		MEL32		MEL32	
Lubricant		Pre-coated galvanized steel sheets (+powder coating for -BS type)		Pre-coated galvanized steel sheets (+powder coating for -BS type)		
External finish		<MUNSELL 5Y 8/1 or similar>		<MUNSELL 5Y 8/1 or similar>		
External dimension HxWxD		mm	1,710(1,650 without legs) x 1,750 x 760		1,710(1,650 without legs) x 1,750 x 760	
		in.	67-3/8(65 without legs) x 68-15/16 x 29-15/16		67-3/8(65 without legs) x 68-15/16 x 29-15/16	
Protection devices	High pressure protection		High pressure sensor, High pressure switch at 4.15MPa (601 psi)		High pressure sensor, High pressure switch at 4.15MPa (601 psi)	
	Inverter circuit (COMP. / FAN)		Over-heat protection, Over-current protection		Over-heat protection, Over-current protection	
	Compressor		Over-heat protection		Over-heat protection	
	Fan motor		Thermal switch		Thermal switch	
Refrigerant	Type x original charge		R410A x 11.8kg (27lbs)		R410A x 11.8kg (27lbs)	
	Control		Indoor LEV and BC controller			
Net weight		kg (lbs)	320(706)		320(706)	
Heat exchanger		Salt-resistant cross fin & copper tube				
HIC circuit (HIC: Heat Inter-Changer)		-				
Pipe between unit and distributor	High pressure		mm (in.)		19.05(3/4) Brazed	
	Low pressure		mm (in.)		28.58(1-1/8) Brazed	
Defrosting method		Auto-defrost mode (Reversed refrigerant cycle)				
Drawing	External		WKD94G061			
	Wiring		WYN B0-7953		WYN B0-7953	
Standard attachment	Document		Installation Manual			
	Accessory		Refrigerant conn. pipe			
Optional parts		Outdoor Twinning kit: CMY-R100XLVBK Joint: CMY-Y102S-G2, CMY-Y102L-G2, CMY-R160-J1 Main BC controller: CMB-P1016V-HA1 Sub BC controller: CMB-P104, 108V-GB1, CMB-P1016V-HB1				
Remarks		Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual. Due to continuing improvement, above specifications may be subject to change without notice. Systems with considerably long pipe runs, in heating mode, may be subject to slightly louder than normal noise from the outdoor unit/s. The outdoor twinning kit(low pressure) should be connected to the low pressure side of the outdoor unit. If the connected units are of different capacities, the outdoor twinning kit(low pressure) should be installed in the unit with the largest capacity.				

Notes :	Unit converter
1.Nominal cooling conditions(subject to JIS B8615-1) Indoor:27°CDB/19°CWB(81°FDB/66°FWB), Outdoor:35°CDB(95°FDB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	kcal =kW x 860
2.Nominal heating conditions(subject to JIS B8615-1) Indoor:20°CDB(68°FDB), Outdoor:7°CDB/6°CWB(45°FDB/43°FWB) Pipe length:7.5m(24-9/16ft.), Level difference:0m(0ft.)	BTU/h =kW x 3,412
3.-5°CDB. (23°FDB.)-6°CWB. (21°FWB.) to 21°CDB. (70°FDB.)/15.5°CWB. (60°FWB.) with cooling/heating mixed operation.	cfm =m <sup>3</sup> /min x 35.31
4.External static pressure option is available (30Pa, 60Pa / 3.1mmH <sub>2</sub> O, 6.1mmH <sub>2</sub> O).	lb =kg / 0.4536
	*Above specification data is subject to rounding variation.

## PURY-EP200YJM-A(-BS)

Unit : mm

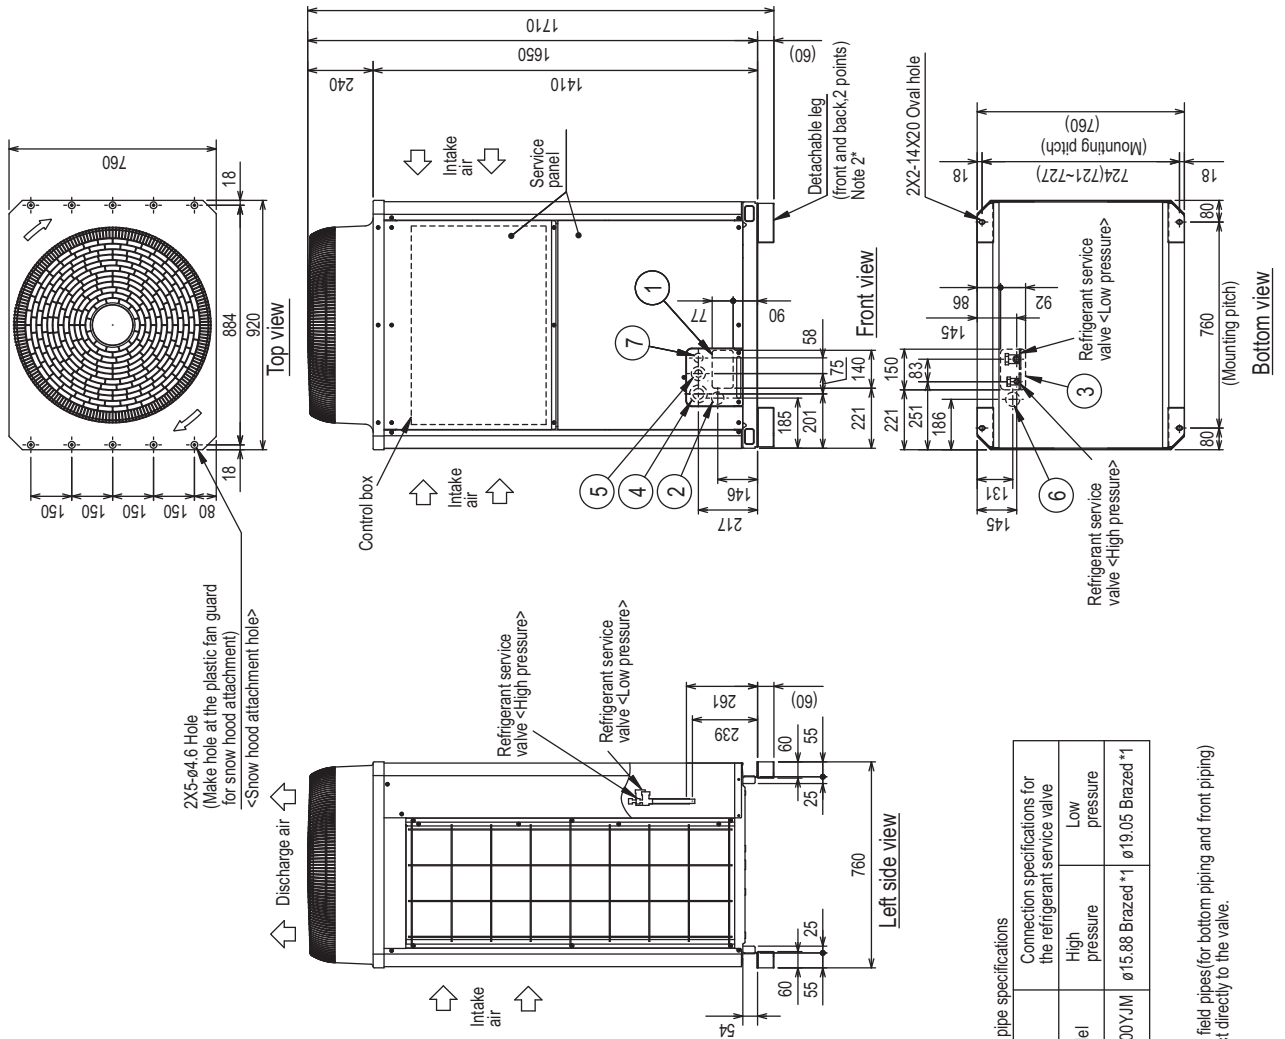

Note 1. Please refer to the next page for information regarding necessary spacing around the unit and foundation work.  
 2. The detachable leg can be removed at site.  
 3. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C.

NO.	Usage	Specifications
①	Front through hole	140X77 Knockout hole
②	Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole
③	Bottom through hole	150X92 Knockout hole
④	Front through hole	ø65 or ø40 Knockout hole
⑤	Front through hole	ø52 or ø27 Knockout hole
⑥	Bottom through hole	ø52 Knockout hole
⑦	For transmission cables	Front through hole ø34 Knockout hole

Connecting pipe specifications	
Connection specifications for the refrigerant service valve	
Model	Low pressure
PURY-EP200YJM	ø15.88 Brazed *1
	ø19.05 Brazed *1

\*1. Expand the field pipes (for bottom piping and front piping) and connect directly to the valve.

R2(HIGH COP)

PURY-EP200YJM-A(-BS)

Unit : mm


R2(HIGH COP)

1. Required space around the unit


● In case of single installation

① Secure enough space around the unit as shown in the figure below.

- With a space of at least 300mm to the wall on the back of the unit
- With a space of at least 100mm to the wall on the back of the unit

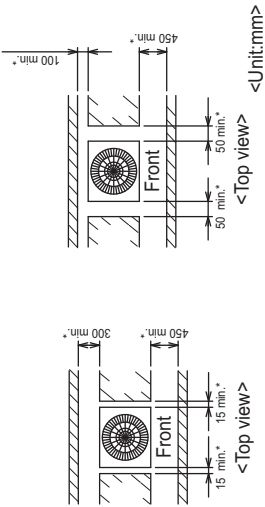


② When the height of the walls on the front, back or on the sides <H> exceeds the wall height limit as defined below add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.

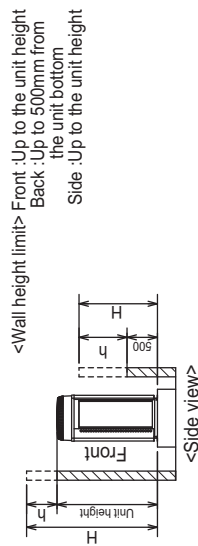

<Wall height limit> Front : Up to the unit height  
Back : Up to 500mm from the unit bottom  
Side : Up to the unit height

● In case of collective installation

- ① When multiple units are installed adjacent to each other, secure enough space to allow for air circulation and walkway between groups of units as shown in the figures below.
- ② At least two sides must be left open.
- ③ As with the single installation, add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.
- ④ If there is a wall at both the front and the rear of the unit, install up to six units consecutively in the side direction and provide a space of 1000mm or more as inlet space/ passage space for each six units.

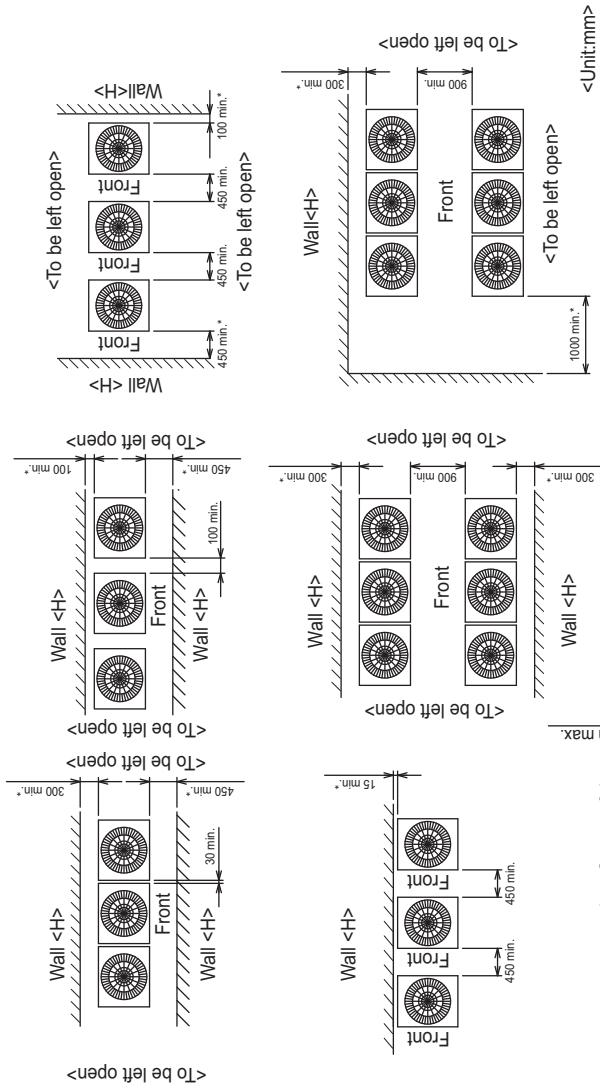

2. Foundation work

- ① Take into consideration the surface strength, water drainage route, piping route, and wiring route when preparing the installation site.  
<Note that the drain water comes out of the unit during operation.>
- ② Build the foundation in such way that the corner of the installation leg is securely supported as shown in the right figure. (Fig.A,B)  
When using a rubber isolating cushion, please ensure it is large enough to cover the entire width of each of the unit's legs.
- ③ The protrusion length of the anchor bolt must not exceed 30mm. (Fig.A,B)
- ④ Use four fixing plates as shown in the right figure <field supply required> when using post-installed anchor bolts. (Fig.C,D)
- ⑤ To prevent small animals and water and snow from entering the unit and damaging its parts, close the gap around the edges of through holes for pipes and wires with filler plates <field supply required>.
- ⑥ When the pipes or cables are routed at the bottom of the unit, make sure that the through hole at the base of the unit does not get blocked with the installation base.
- ⑦ Refer to the Installation Manual when installing units on an installation base.

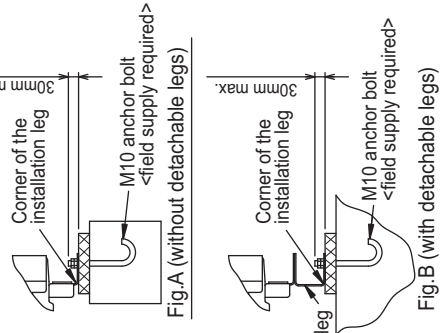



Fig.A (without detachable legs)  
Fig.C (without detachable legs)

Fig.B (with detachable legs)  
Fig.D (with detachable legs)



PURY-EP250,300YJM-A(-BS)

Unit : mm

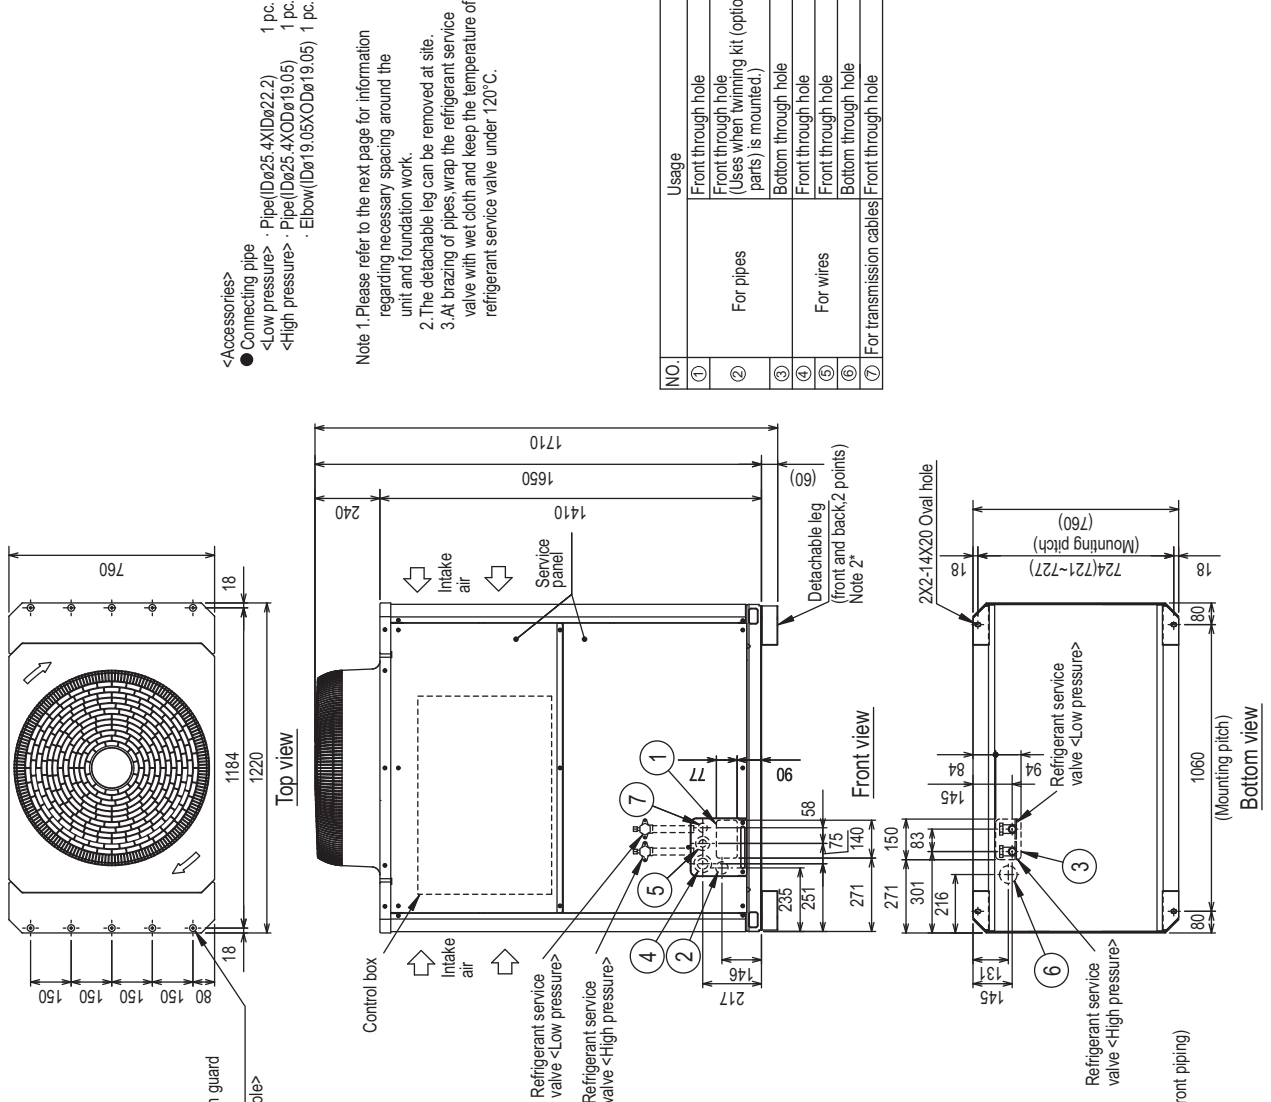

- <Accessories>
- Connecting pipe
  - <Low pressure> · Pipe(∅25.4X(D∅22.2) 1 pc.
  - <High pressure> · Pipe(∅25.4X(D∅19.05) 1 pc.
  - Elbow(∅19.05X(D∅19.05) 1 pc.

Note 1. Please refer to the next page for information regarding necessary spacing around the unit and foundation work.

2. The detachable leg can be removed at site.

3. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C.

NO.	Usage	Specifications
①	Front through hole	140X77 Knockout hole
②	For pipes	Front through hole (Uses when twinning kit (optional parts) is mounted.)
③	Bottom through hole	∅45 Knockout hole
④	For wires	150X94 Knockout hole
⑤	Front through hole	∅65 or ∅40 Knockout hole
⑥	Bottom through hole	∅62 or ∅27 Knockout hole
⑦	For transmission cables	∅65 Knockout hole
⑧	Front through hole	∅34 Knockout hole

Connecting pipe specifications

Model	Connection specifications for the refrigerant service valve	
	High pressure	Low pressure
PURY-EP250YJM	∅19.05 Brazed *1	∅22.2 Brazed *1
PURY-EP300YJM	∅19.05 Brazed *1	∅22.2 Brazed *1

\*1. Connect by using the connecting pipes (for bottom piping and front piping) that are supplied.

R2(HIGH COP)



PURY-EP250,300YJM-A(-BS)


Unit : mm

R2(HIGH COP)


1.Required space around the unit

In case of single installation

- ① Secure enough space around the unit as shown in the figure below.
  - With a space of at least 300mm to the wall on the back of the unit

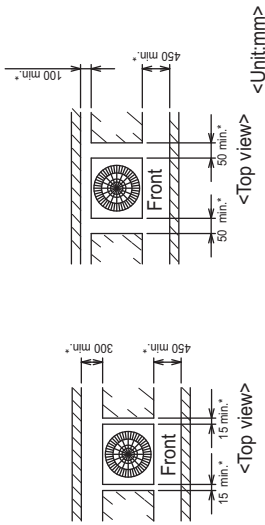

- ② When the height of the walls on the front, back or on the sides <H> exceeds the wall height limit as defined below add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.

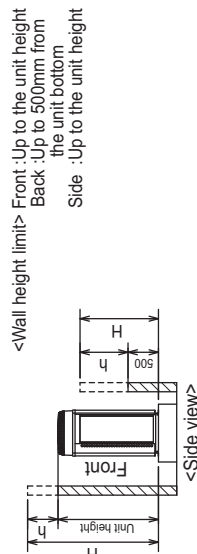

2.Foundation work

- ① Take into consideration the surface strength, water drainage route, piping route, and wiring route when preparing the installation site.
  - <Note that the drain water comes out of the unit during operation.>
- ② Build the foundation in such way that the corner of the installation leg is securely supported as shown in the right figure. (Fig.A,B)
  - When using a rubber isolating cushion, please ensure it is large enough to cover the entire width of each of the unit's legs.
- ③ The protrusion length of the anchor bolt must not exceed 30mm. (Fig.A,B)
  - Use four fixing plates as shown in the right figure <field supply required> when using post-installed anchor bolts. (Fig.C,D)
- ④ To prevent small animals and water and snow from entering the unit and damaging its parts, close the gap around the edges of through holes for pipes and wires with filler plates <field supply required>
- ⑤ When the pipes or cables are routed at the bottom of the unit, make sure that the through hole at the base of the unit does not get blocked with the installation base.
- ⑦ Refer to the Installation Manual when installing units on an installation base.

In case of collective installation

- ① When multiple units are installed adjacent to each other, secure enough space to allow for air circulation and walkway between groups of units as shown in the figures below.
- ② At least two sides must be left open.
- ③ As with the single installation, add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.
- ④ If there is a wall at both the front and the rear of the unit, install up to six units consecutively in the side direction and provide a space of 1000mm or more as inlet space/ passage space for each six units.

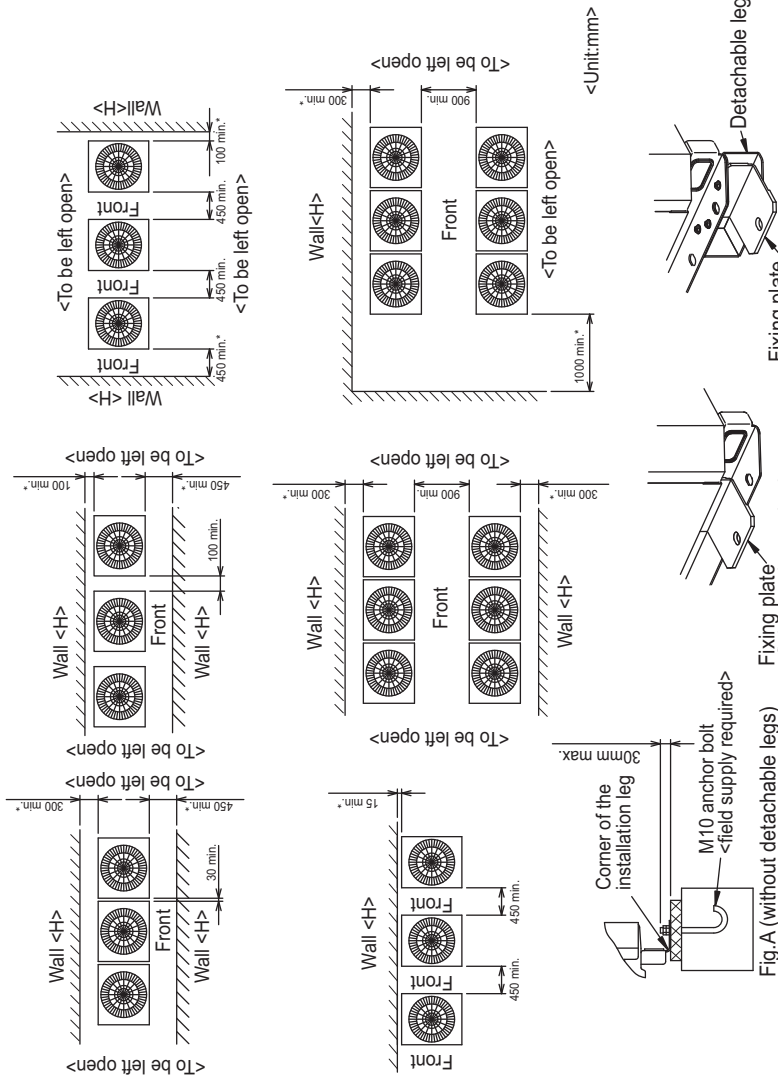


Fig.A (without detachable legs)

Fig.B (with detachable legs)

Fig.C (without detachable legs)


Fig.D (with detachable legs)

## PURY-EP350YJM-A(-BS)

Unit : mm

- <Accessories>  
 ● Connecting pipe 1 pc.  
 <Low pressure> · Pipe (Dø28.58XODø28.58) 1 pc.  
 <High pressure> · Pipe (Dø25.4XODø19.05) 1 pc.  
 · Elbow (Dø19.05XODø19.05) 1 pc.
- Note 1. Please refer to the next page for information regarding necessary spacing around the unit and foundation work.  
 2. The detachable leg can be removed at site.  
 3. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C.

NO.	Usage	Specifications
①	Front through hole	140 X 77 Knockout hole
②	Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole
③	Bottom through hole	150 X 94 Knockout hole
④	Front through hole	ø65 or ø40 Knockout hole
⑤	Front through hole	ø52 or ø27 Knockout hole
⑥	Bottom through hole	ø65 Knockout hole
⑦	For transmission cables	ø34 Knockout hole

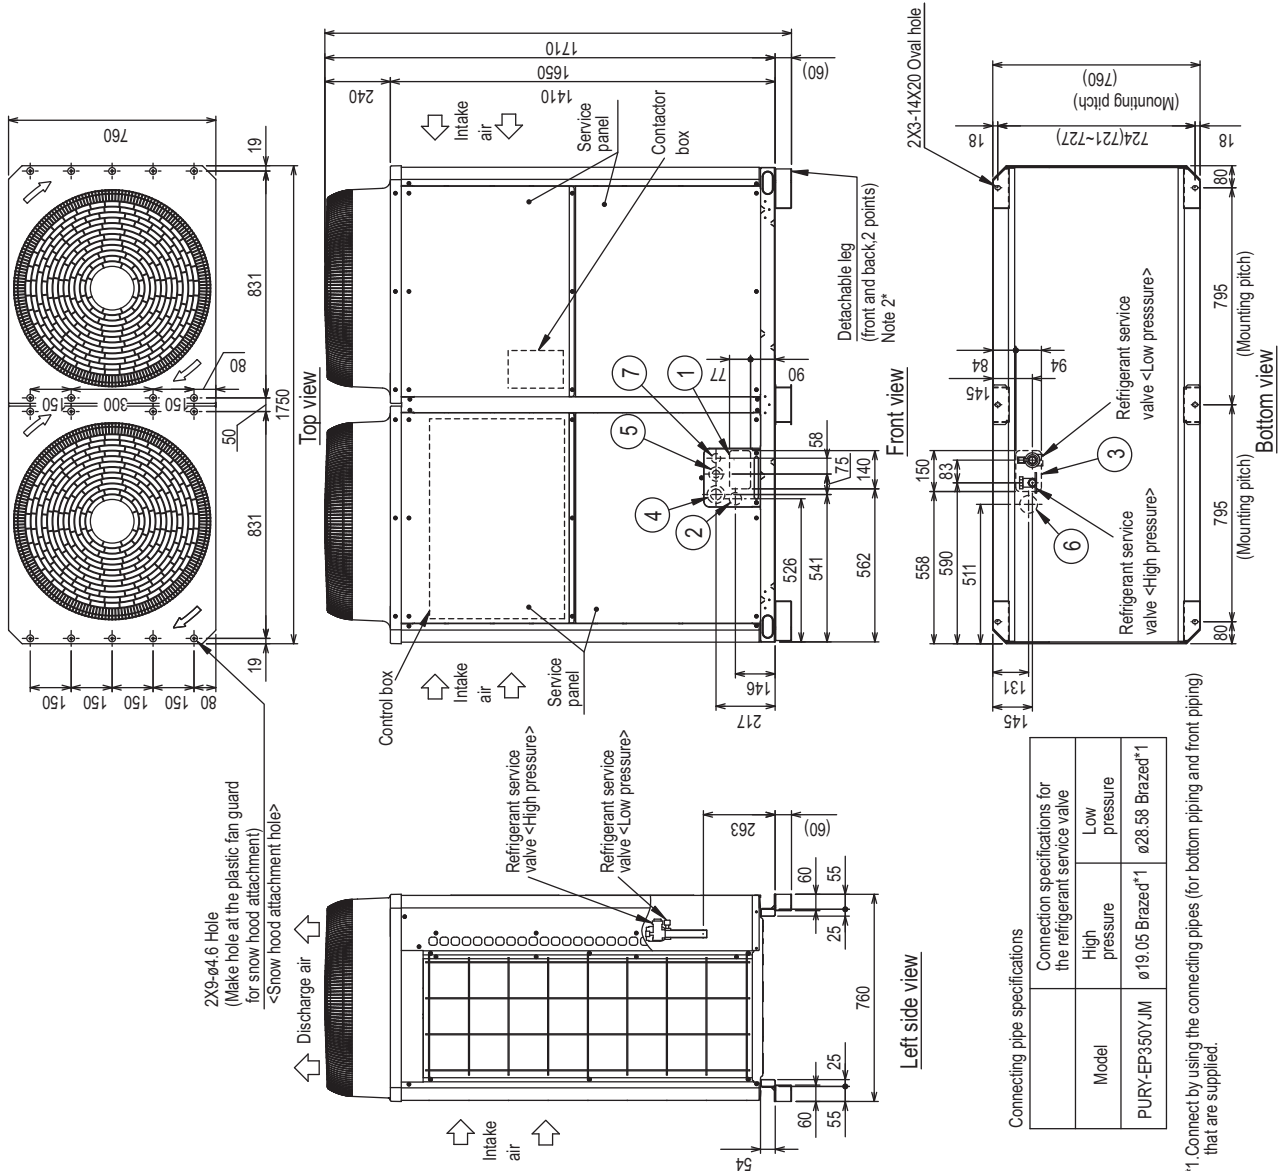

Connecting pipe specifications

Model	High pressure	Low pressure
PURY-EP350YJM	ø19.05 Brazed*1	ø28.58 Brazed*1

Connection specifications for the refrigerant service valve

High pressure	Low pressure
ø19.05 Brazed*1	ø28.58 Brazed*1

\*1 Connect by using the connecting pipes (for bottom piping and front piping) that are supplied.

R2(HIGH COP)

PURY-EP350YJM-A(-BS)


Unit : mm

R2(HIGH COP)


1.Required space around the unit

● In case of single installation

- ① Secure enough space around the unit as shown in the figure below.
- With a space of at least 300mm to the wall on the back of the unit

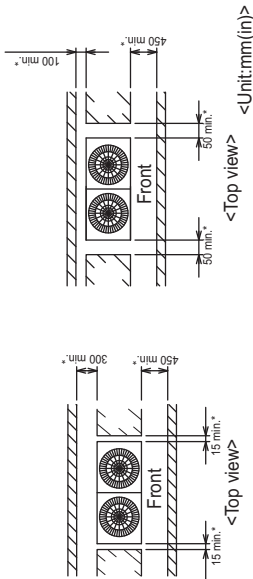

- ② When the height of the walls on the front, back or on the sides <H> exceeds the wall height limit as defined below add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.




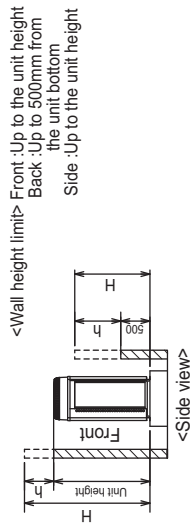



2.Foundation work

- ① Take into consideration the surface strength, water drainage route, piping route, and wiring route when preparing the installation site.
- ② Note that the drain water comes out of the unit during operation.
- ③ Build the foundation in such way that the corner of the installation leg is securely supported as shown in the right figure.(Fig.A,B)
- ④ When using a rubber isolating cushion, please ensure it is large enough to cover the entire width of each of the unit's legs.
- ⑤ The protrusion length of the anchor bolt must not exceed 30mm.(Fig.A,B)
- ⑥ Use four fixing plates as shown in the right figure <field supply required> when using post-installed anchor bolts.(Fig.C,D)
- ⑦ To prevent small animals and water and snow from entering the unit and damaging its parts, close the gap around the edges of through holes for pipes and wires with filler plates <field supply required>.
- ⑧ When the pipes or cables are routed at the bottom of the unit, make sure that the through hole at the base of the unit does not get blocked with the installation base.
- ⑨ Refer to the Installation Manual when installing units on an installation base.

● In case of collective installation

- ① When multiple units are installed adjacent to each other, secure enough space to allow for air circulation and walkway between groups of units as shown in the figures below.
- ② At least two sides must be left open.
- ③ As with the single installation, add the height that exceeds the height limit <h> to the figures that are marked with an asterisk.
- ④ If there is a wall at both the front and the rear of the unit, install up to three units consecutively in the side direction and provide a space of 1000mm or more as inlet space/ passage space for each three units.

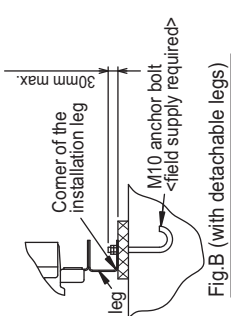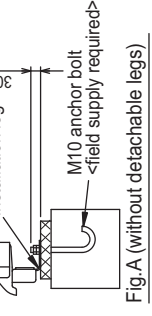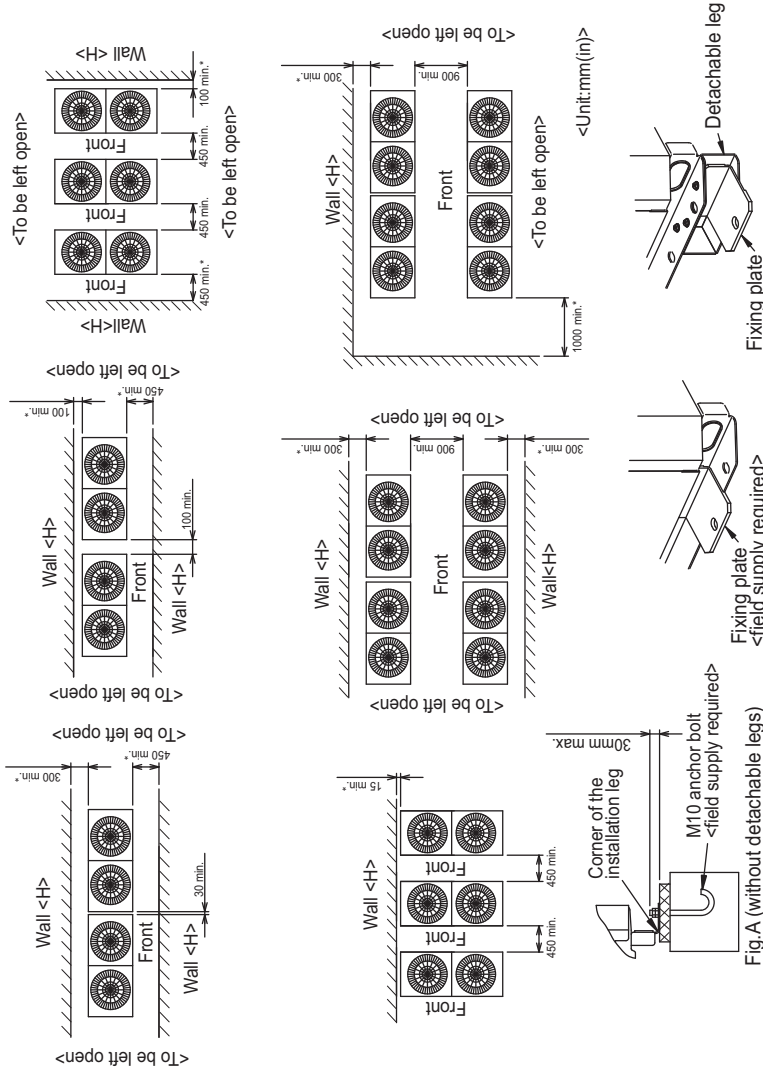


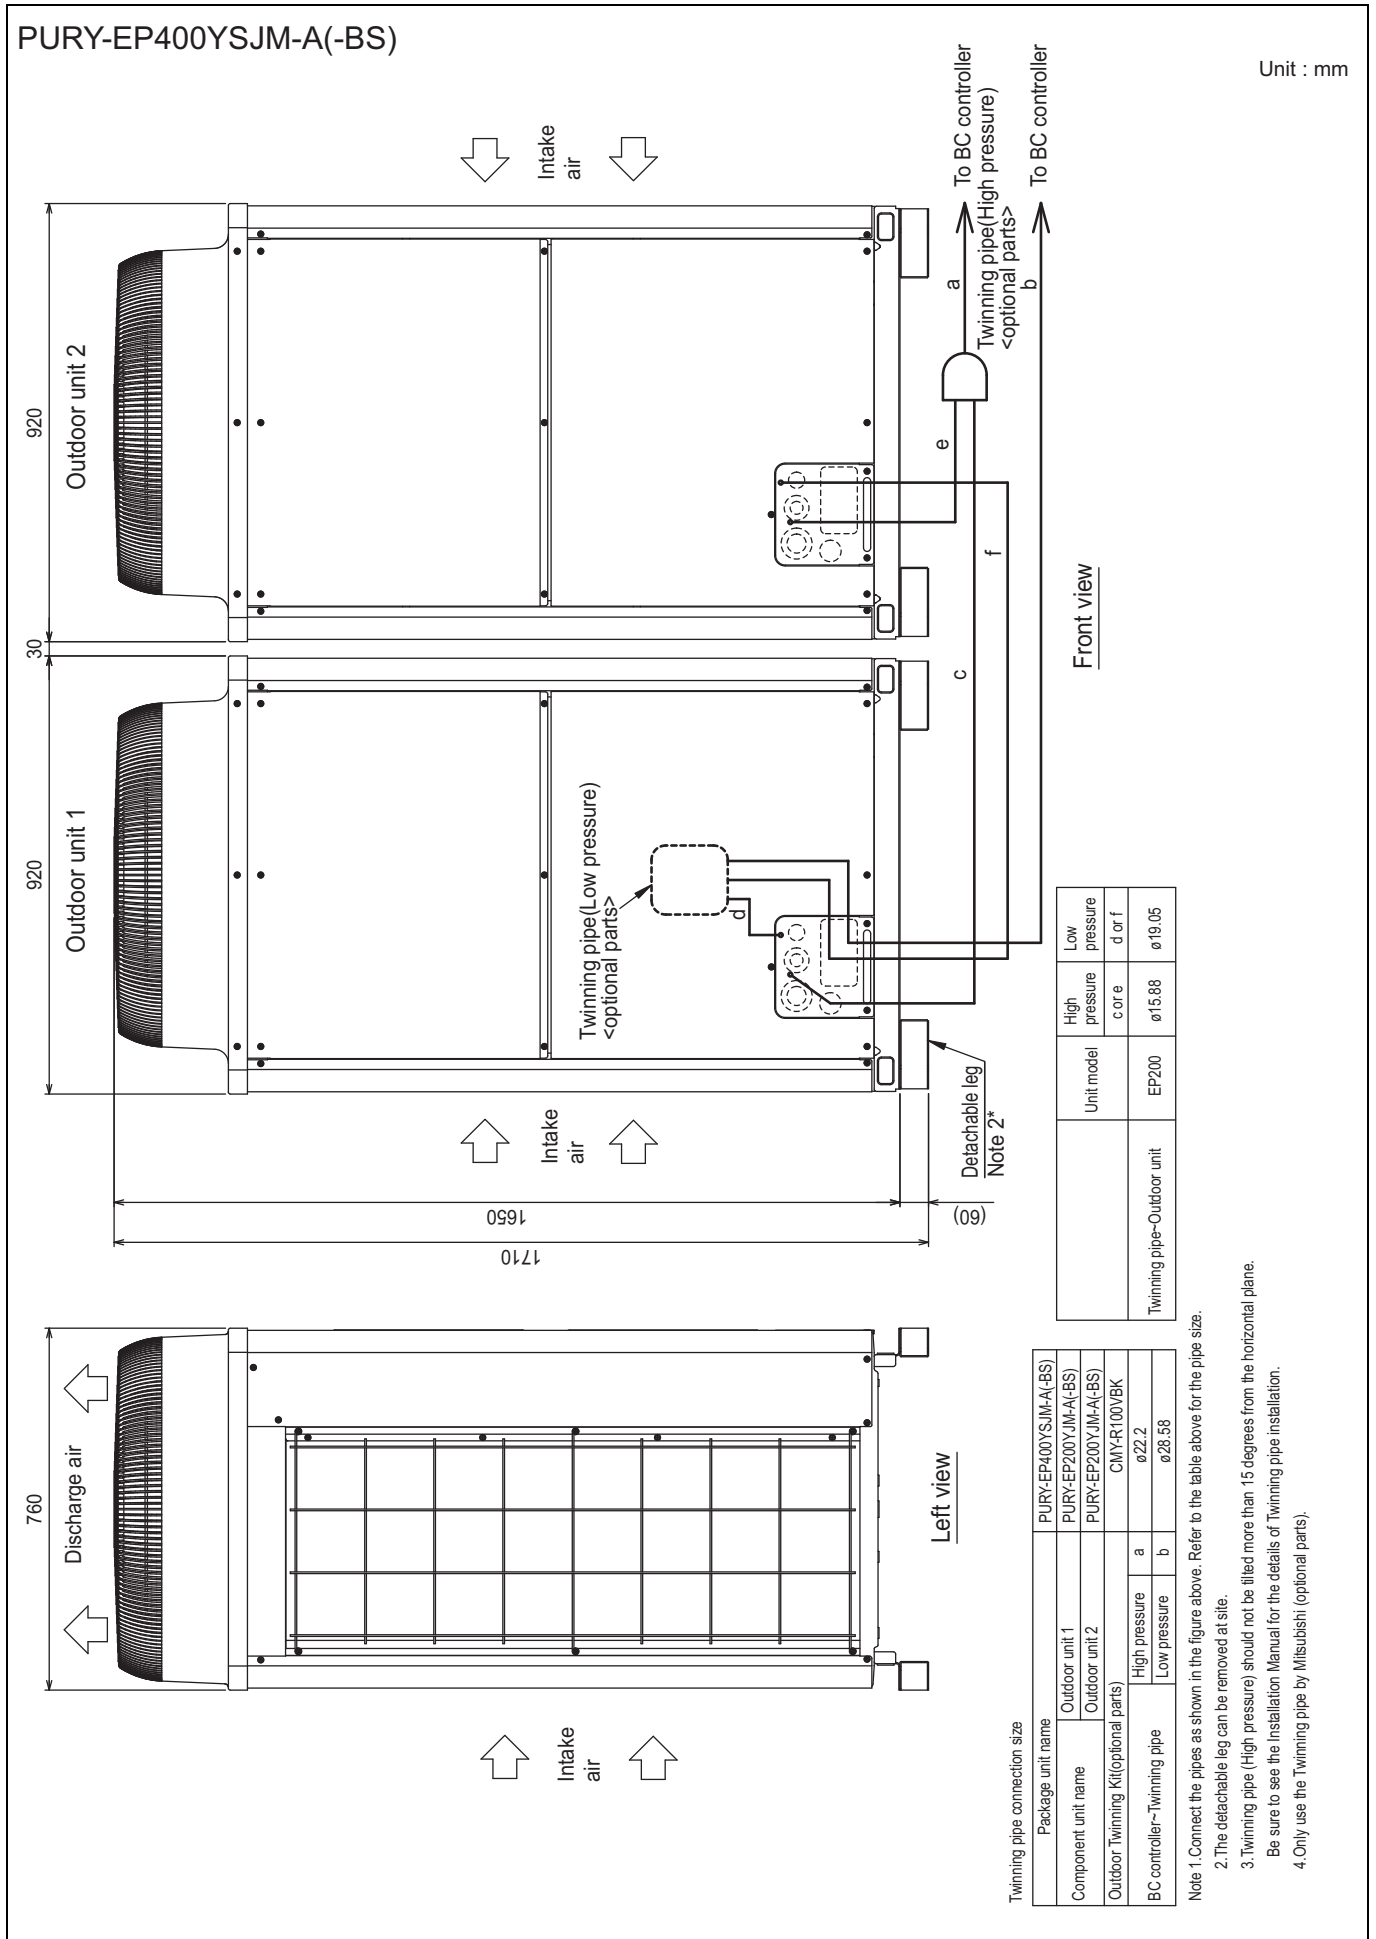

R2(HIGH COP)

PURY-EP450,500YSJM-A(-BS)

Unit : mm

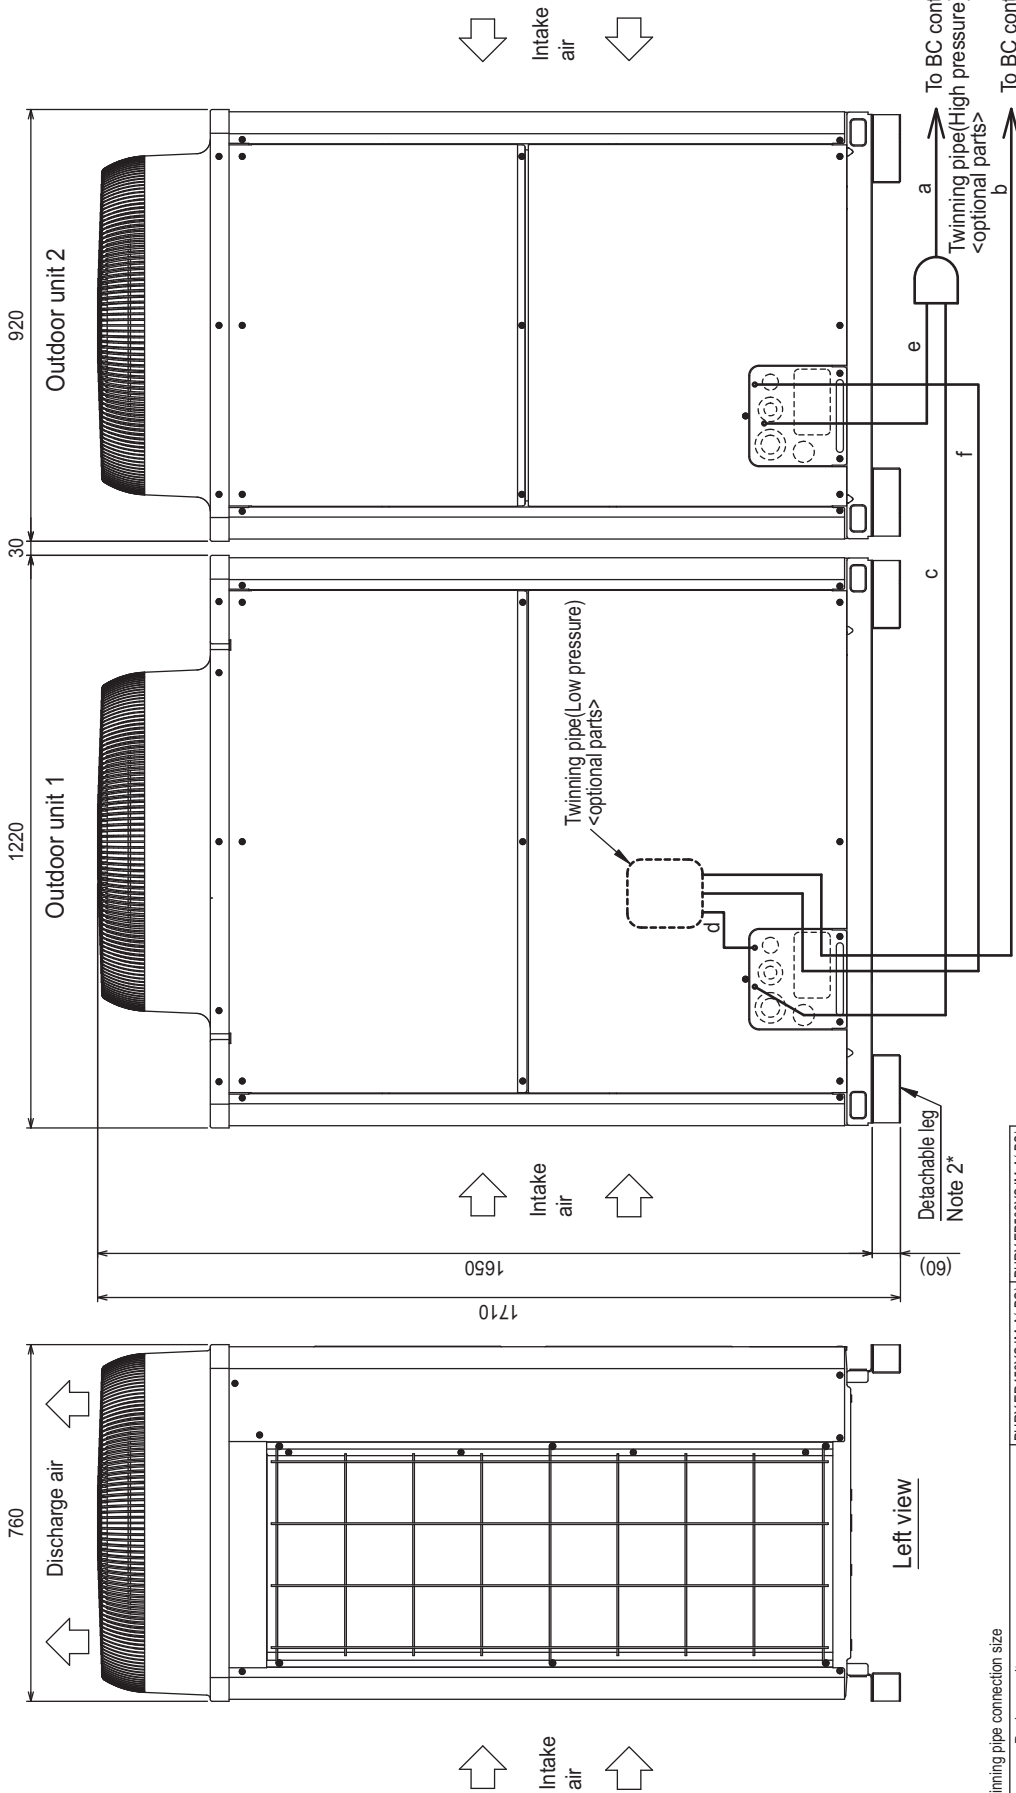

Front view

Unit model	High pressure core	Low pressure d or f
EP200	ø15.88	ø19.05
EP250	ø19.05	ø22.2
EP300	ø19.05	ø22.2


Twinning pipe~Outdoor unit

Twinning pipe connection size

Package unit name	PURY-EP450YSJM-A(-BS)	PURY-EP500YSJM-A(-BS)
Outdoor unit 1	PURY-EP250YSJM-A(-BS)	PURY-EP300YSJM-A(-BS)
Outdoor unit 2	PURY-EP200YSJM-A(-BS)	PURY-EP200YSJM-A(-BS)
Outdoor Twinning Kit (optional parts)	CMTY-R100VBK	
BC controller~Twinning pipe	High pressure	ø22.2
	Low pressure	ø28.58

- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.  
 2. The detachable leg can be removed at site.  
 3. Twinning pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane.  
 Be sure to see the Installation Manual for the details of Twinning pipe installation.  
 4. Only use the Twinning pipe by Mitsubishi (optional parts).


R2(HIGH COP)

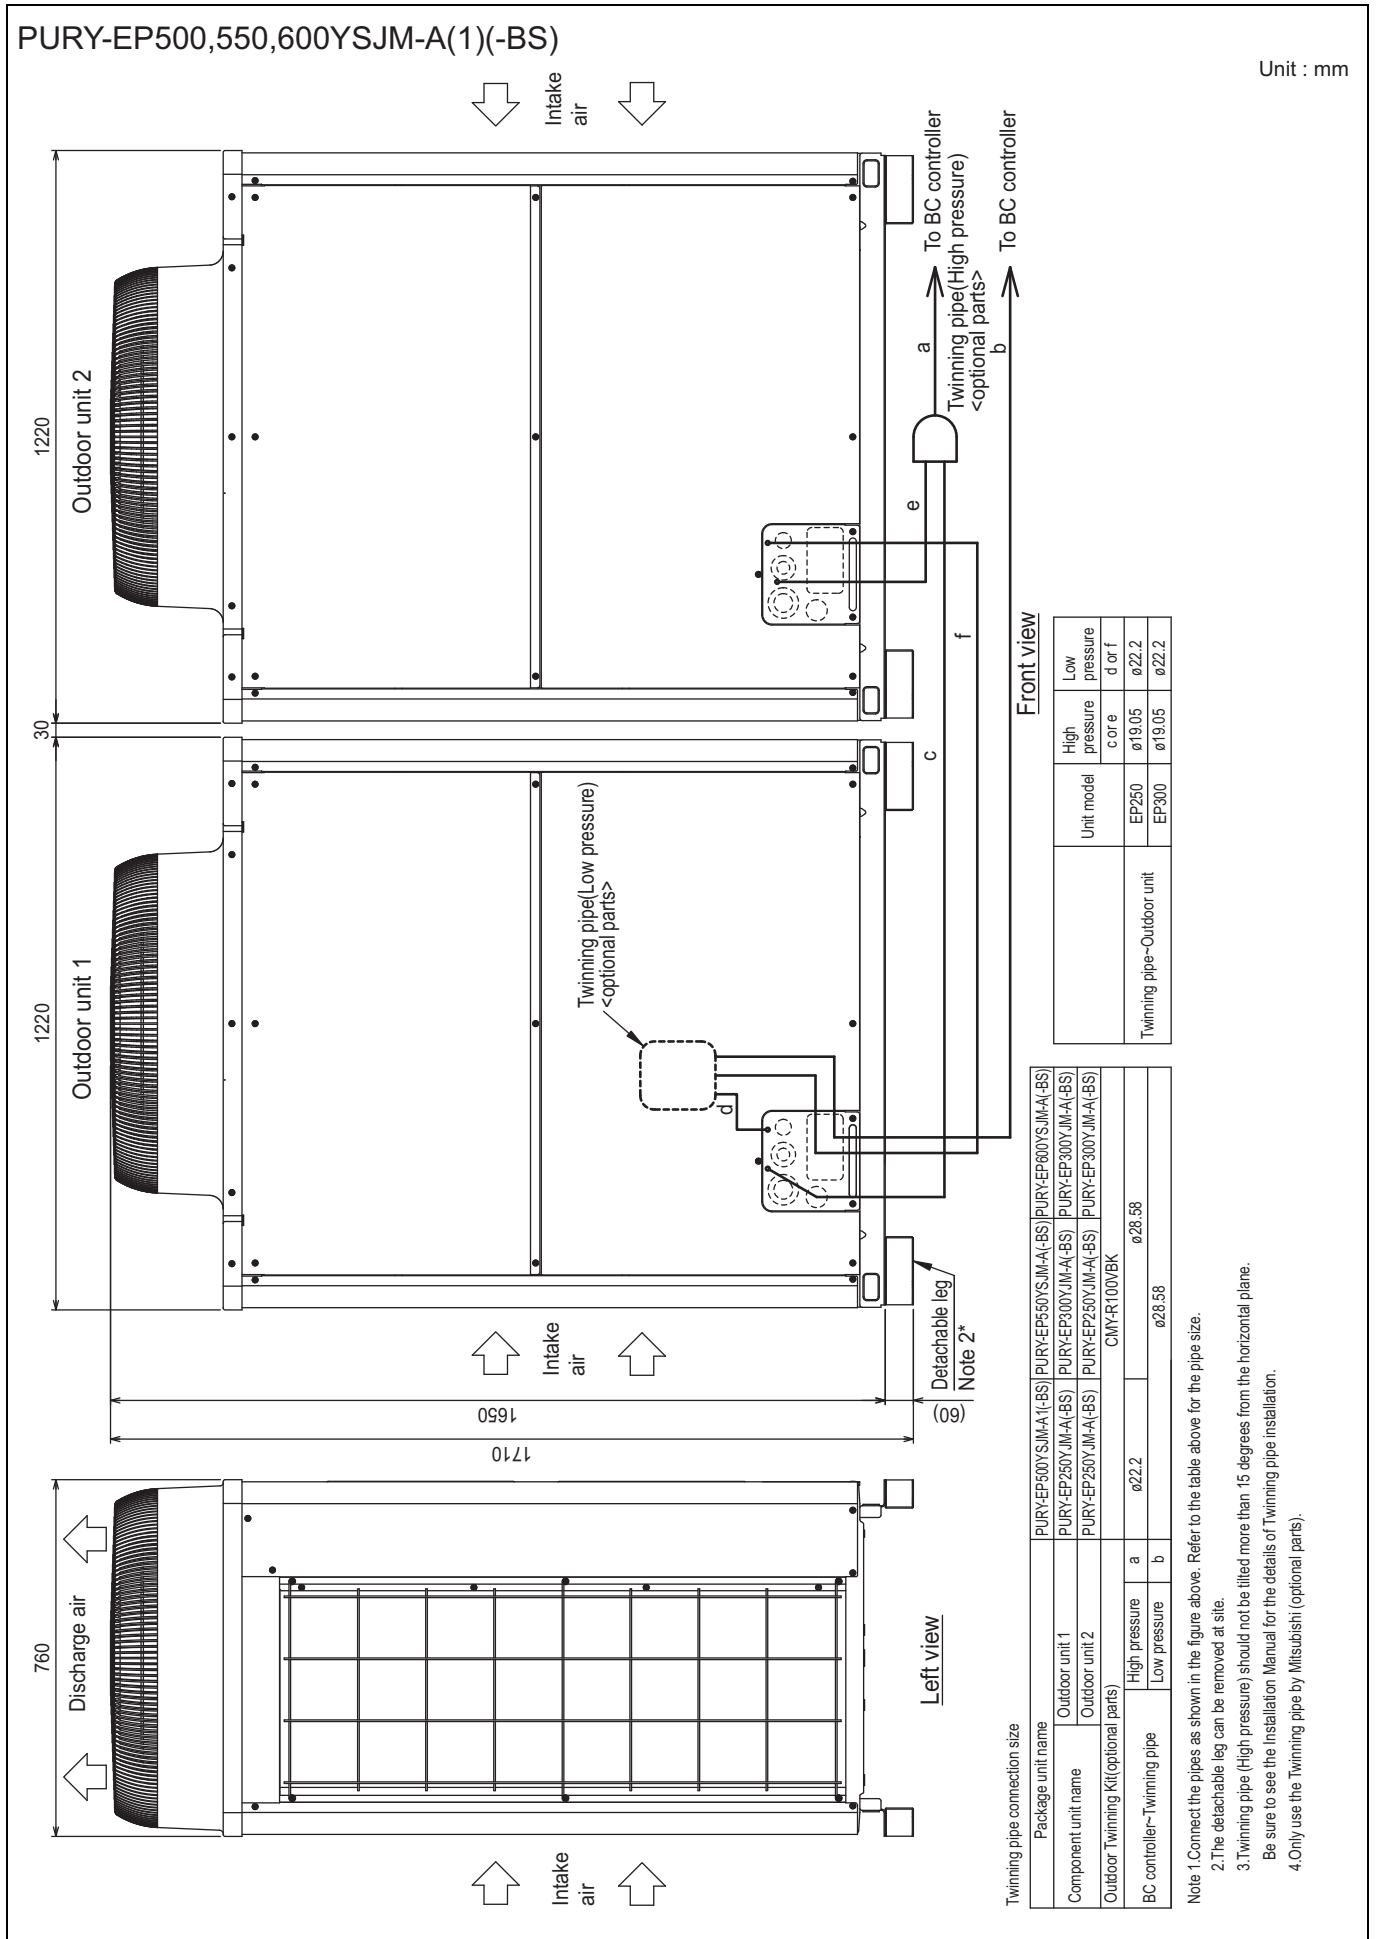

R2(HIGH COP)

PURY-EP600,650YSJM-A(1)-(BS)

Unit : mm

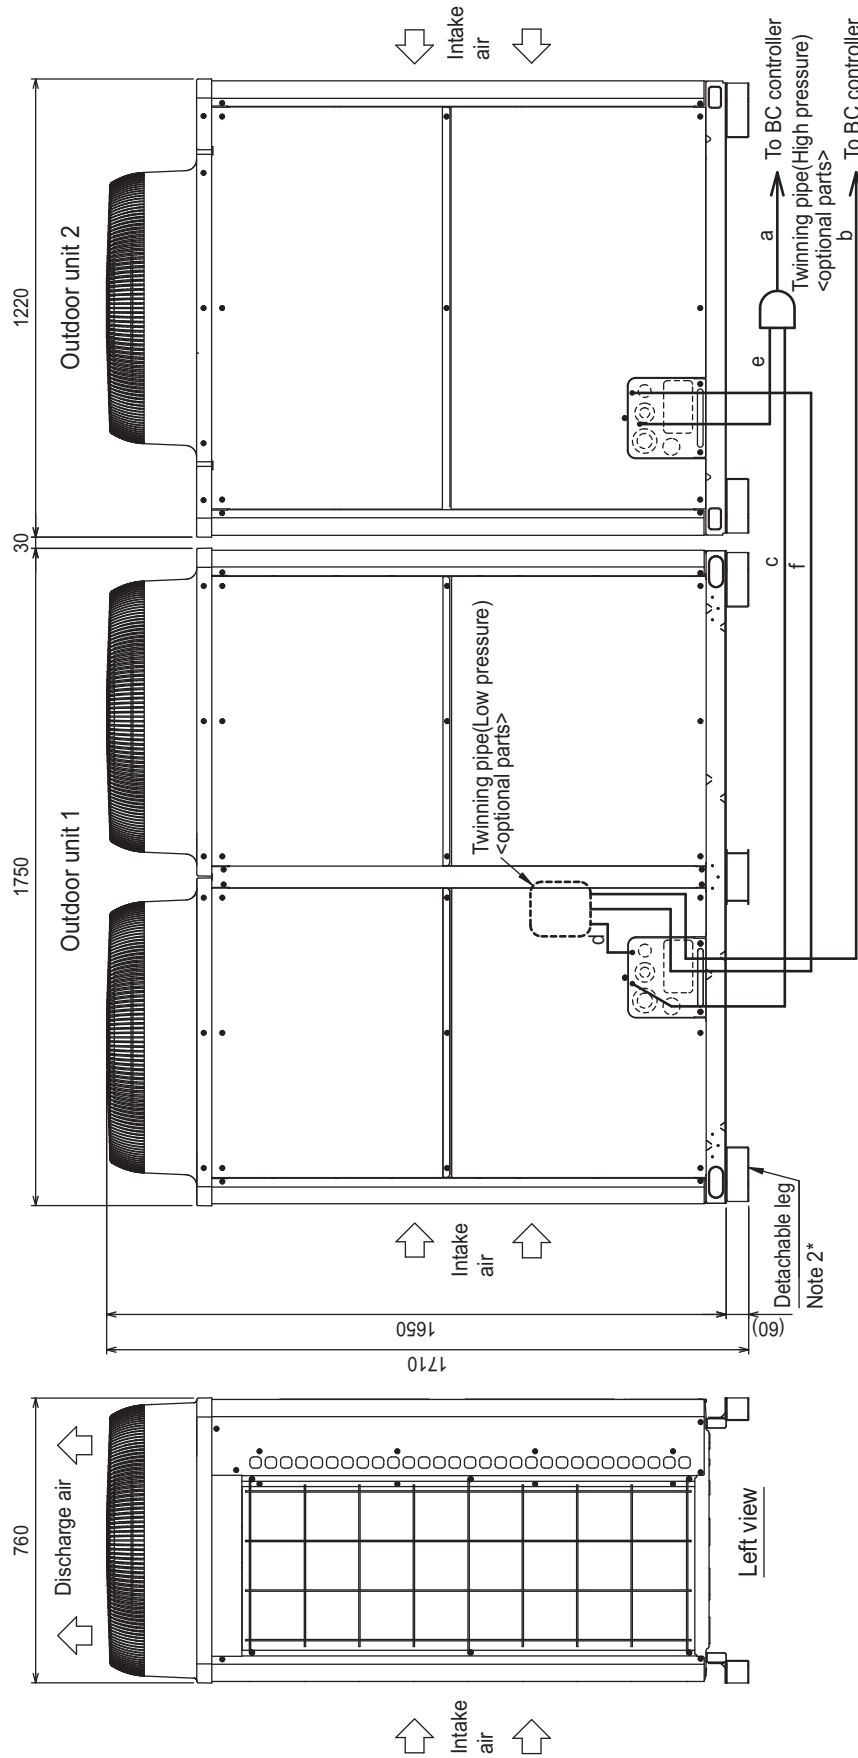

Front view

Detachable leg  
Note 2\*

Twinning pipe connection size


Package unit name	PURY-EP600YSJM-A(1)-(BS)	PURY-EP650YSJM-A(1)-(BS)
Outdoor unit 1	PURY-EP350YSJM-A(1)-(BS)	PURY-EP300YSJM-A(1)-(BS)
Outdoor unit 2	PURY-EP250YSJM-A(1)-(BS)	PURY-EP200YSJM-A(1)-(BS)
Outdoor Twinning Kit(optional parts)	CMY-R100XLVBK	
BC controller~Twinning pipe	High pressure	a
	Low pressure	b

Twinning pipe~Outdoor unit	Unit model		High pressure	Low pressure
	EP250	EP300	ø19.05	ø22.2
EP350	EP350	ø19.05	ø28.58	

- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
- 2. The detachable leg can be removed at site.
- 3. Twinning pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane. Be sure to see the Installation Manual for the details of Twinning pipe installation.
- 4. Only use the Twinning pipe by Mitsubishi (optional parts).


R2(HIGH COP)



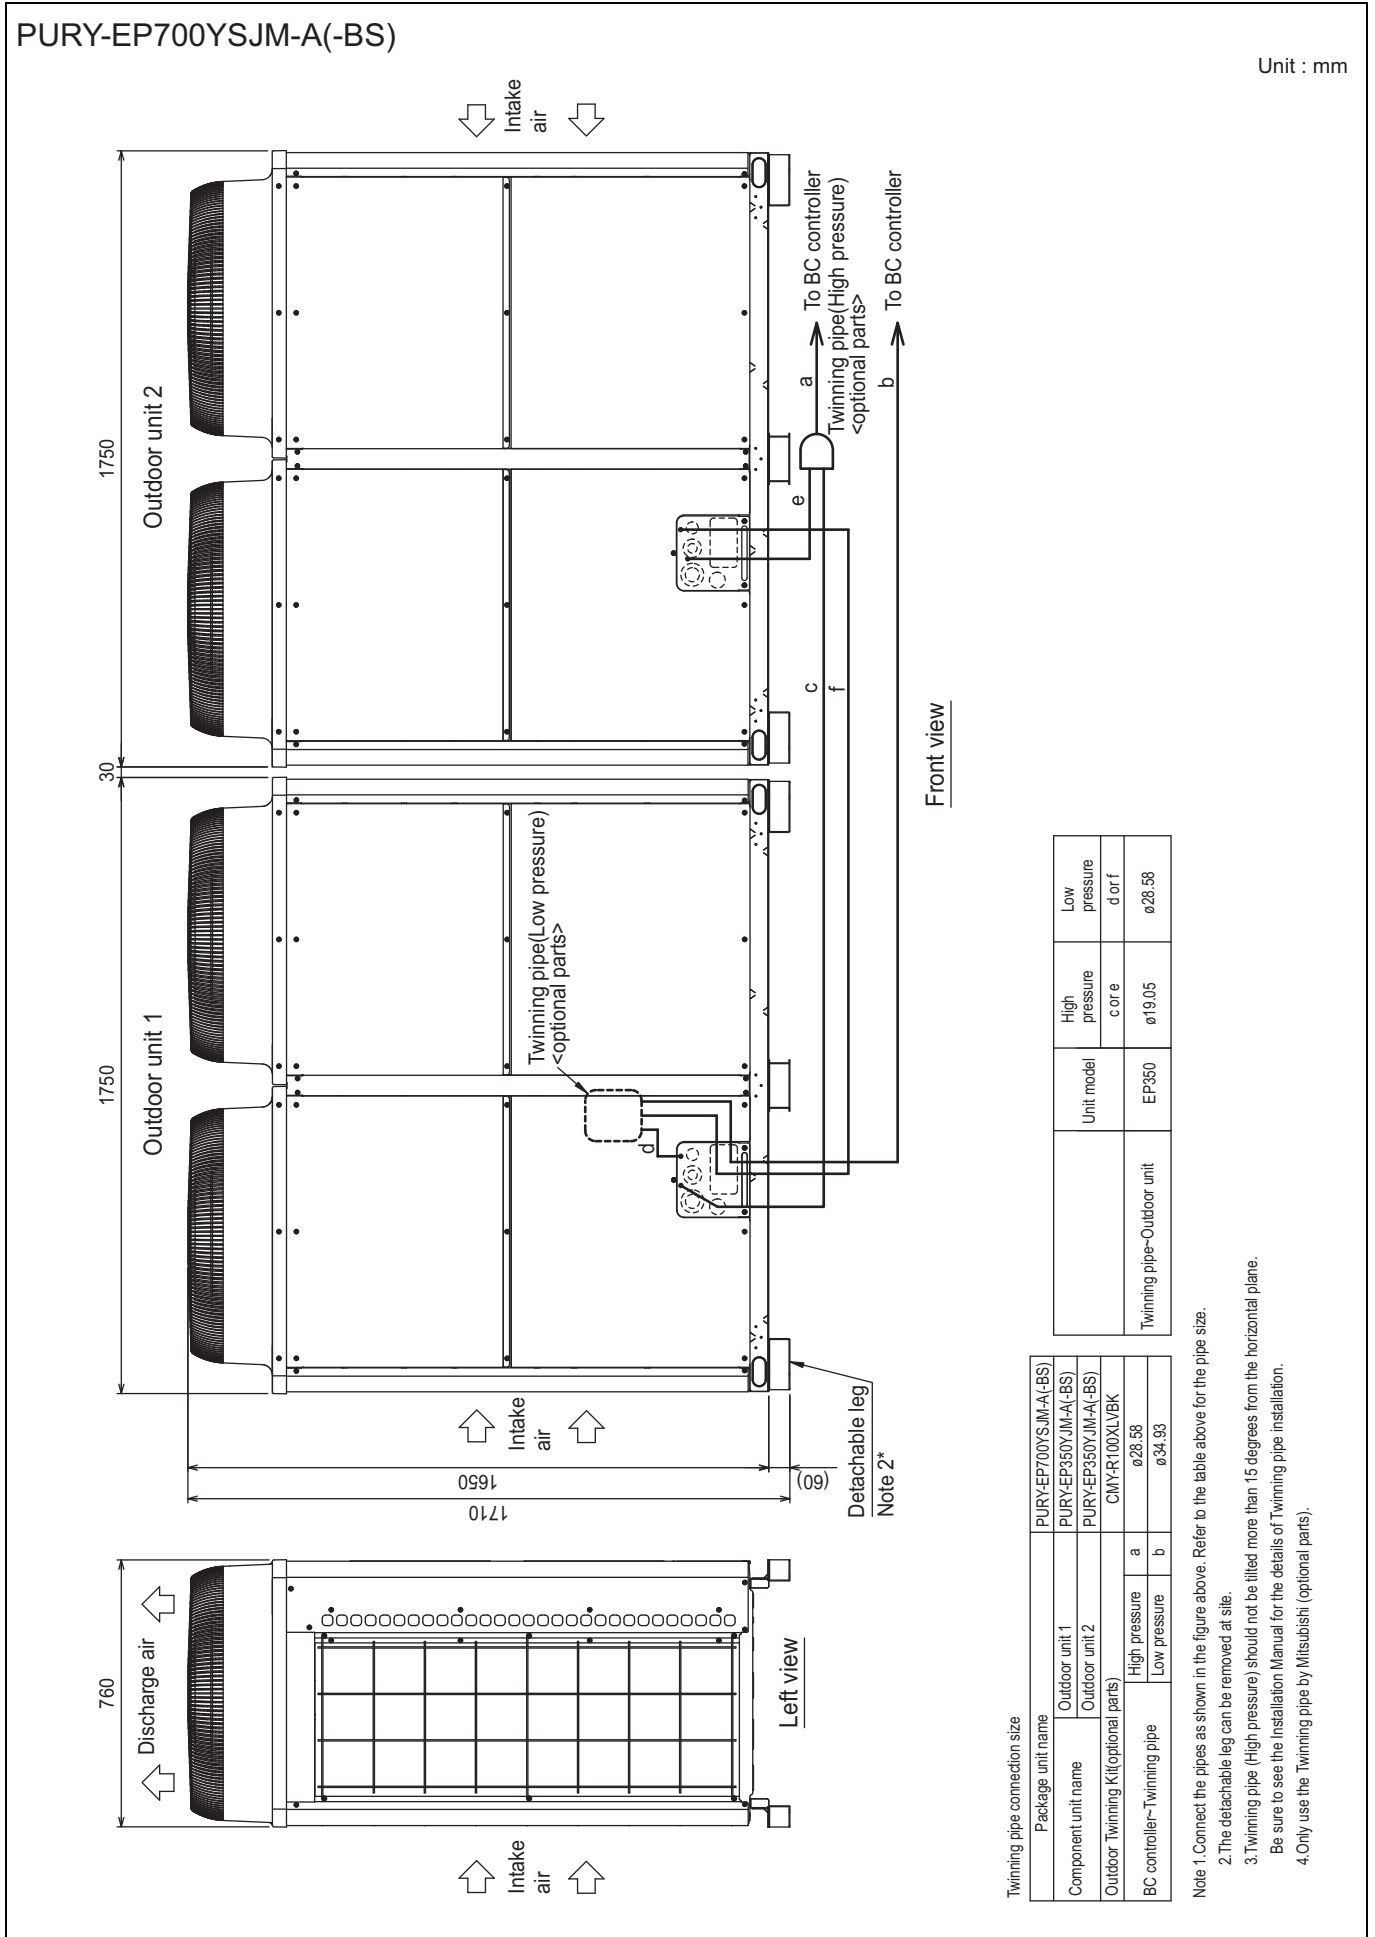

R2(HIGH COP)


#### PURY-P200, P250, P300, EP200YJM-A (-BS)

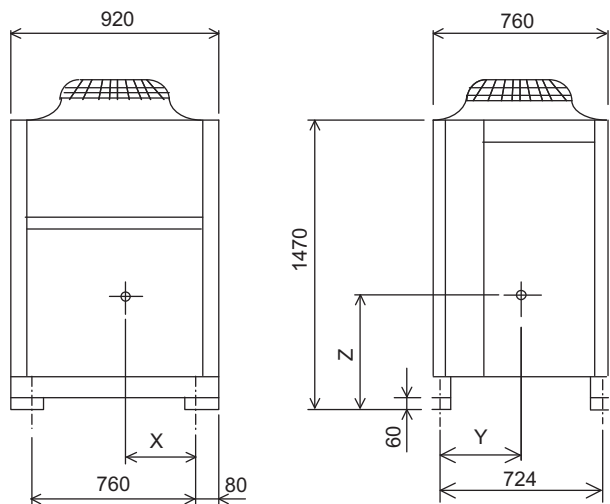

Unit:mm

Model	X	Y	Z
PURY-P200YJM-A (-BS)	345	317	655
PURY-P250YJM-A (-BS)	345	332	655
PURY-P300YJM-A (-BS)	335	327	645
PURY-EP200YJM-A (-BS)	345	332	655


#### PURY-P350, P400, EP250, EP300YJM-A (-BS)

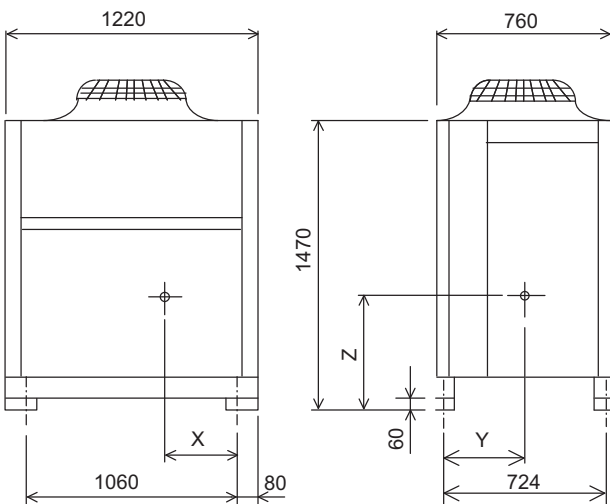

Unit:mm

Model	X	Y	Z
PURY-P350YJM-A (-BS)	450	322	630
PURY-P400YJM-A (-BS)	450	322	630
PURY-EP250YJM-A (-BS)	450	322	630
PURY-EP300YJM-A (-BS)	450	322	630

#### PURY-P450, EP350YJM-A (-BS)

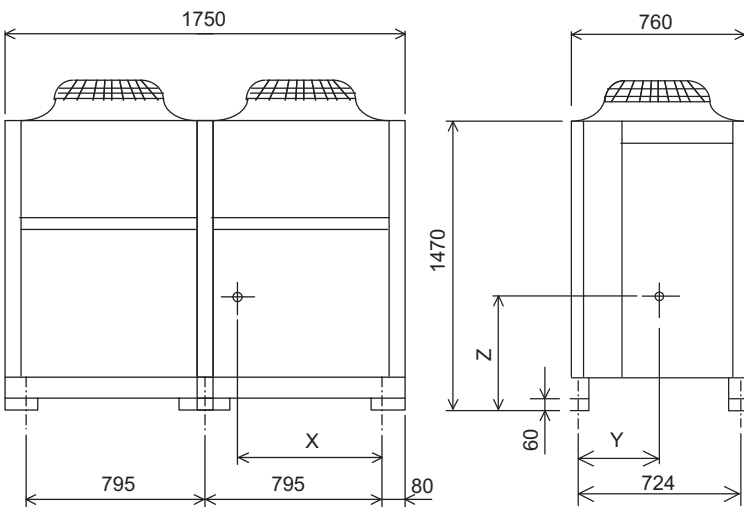


Unit:mm

Model	X	Y	Z
PURY-P450YJM-A (-BS)	726	318	728
PURY-EP350YJM-A (-BS)	726	318	728

R2(HIGH COP)

## PURY-P200, 250, 300, 350, 400YJM-A-(BS) PURY-EP200, 250, 300YJM-A-(BS)

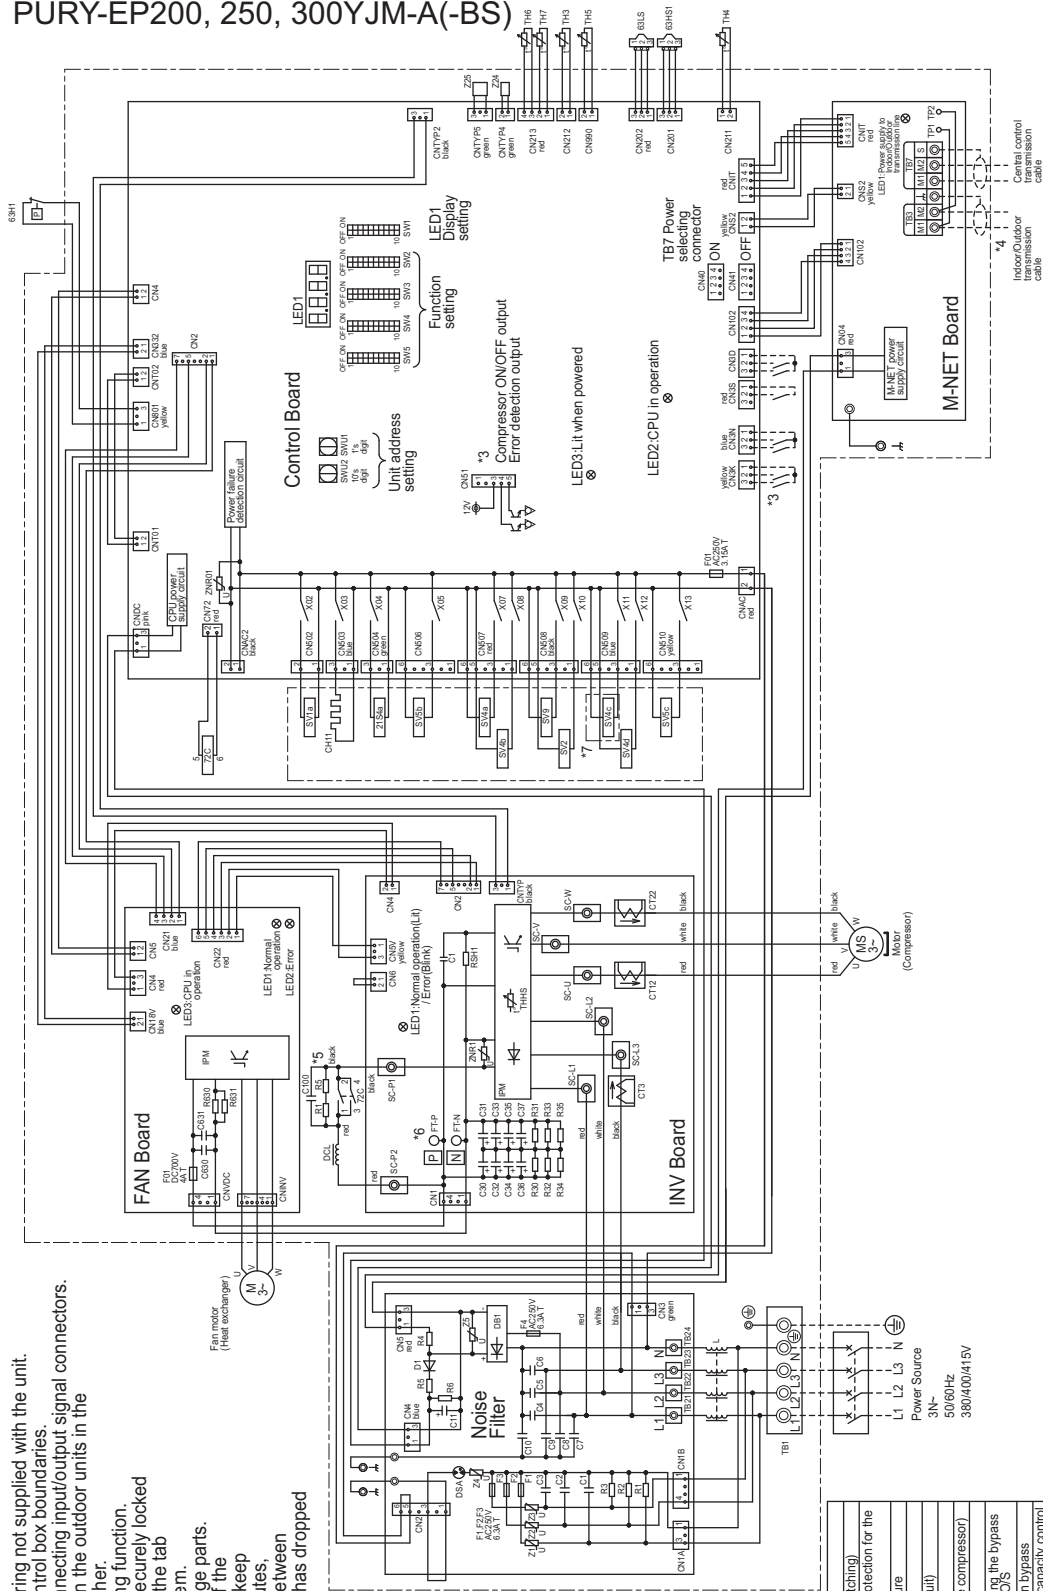

- \*1 Single-dotted lines indicate wiring not supplied with the unit.
- \*2 Dot-dash lines indicate the control box boundaries.
- \*3 Refer to the Data book for connecting input/output signal connectors.
- \*4 Daisy-chain terminals (TB3) on the outdoor units in the same refrigerant system together.
- \*5 Fan terminals have a locking function. Make sure the terminals are securely locked in place after insertion. Press the tab on the terminals to remove them.
- \*6 Control box houses high-voltage parts. Before inspecting the inside of the control box, turn off the power, keep the unit off for at least 10 minutes, and confirm that the voltage between FT-P and FT-N on INV Board has dropped to DC20V or less.
- \*7 Difference of appliance


Model name	Appliance
P200/P250/P300	*7 do not exist
P350/P400	*7 exist
EP250/EP300	*7 exist

<Symbol explanation>

Symbol	Explanation
21Sha	4-way valve(Cooling/Heating switching)
63H1	High pressure protection for the outdoor unit
63FS1	Pressure switch
63LS	Pressure sensor
ZC	Low pressure
CH12.22.3	Magnetic relay/inverter main circuit
CH11	Current sensor(AC)
DCL	Crankcase heater(for heating the compressor)
SV1a	DC reactor
SV2	Solenoid valve
SV4a,b,c,d	For opening/closing the bypass circuit under the OS
SV5b	Discharge suction bypass
SV5c	Heat exchanger capacity control circuit
SV6c	For opening/closing the bypass circuit
SV9	Heat exchanger low pressure bypass
TB1	For opening/closing the bypass circuit
TB3	Power supply terminal block
TB7	For Indoor/Outdoor transmission cable
TH3	Central control transmission cable
TH4	Thermistor
TH5	Liquid pipe temperature
TH6	Discharge pipe temperature
TH7	ACC inlet pipe temperature
TH8	Heat exchanger inlet pipe temperature
TH9	OA temperature
TH10	IPM temperature
Z24,25	Function setting connector



R2(HIGH COP)

## PURY-P450YJM-A(-BS) PURY-EP350YJM-A(-BS)

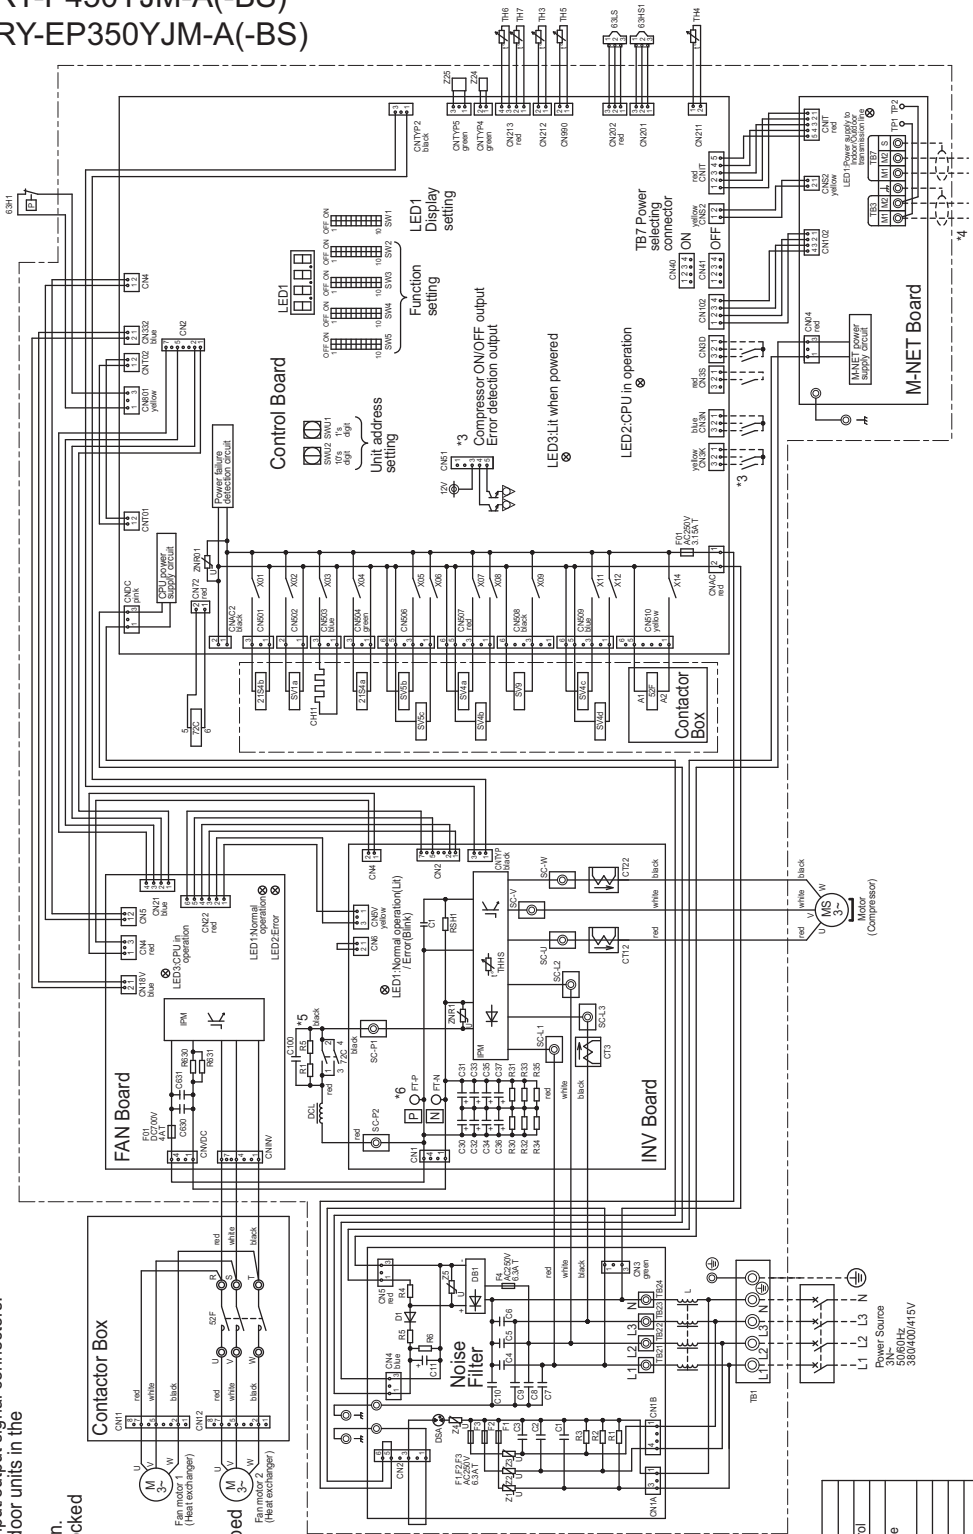

R2(HIGH COP)


- \*1. Single-dotted lines indicate wiring not supplied with the unit.
- \*2. Dot-dash lines indicate the control box boundaries.
- \*3. Refer to the Data Book for connecting input/output signal connectors.
- \*4. Daisy-chain terminals (TB3) on the outdoor units in the same refrigerant system together.
- \*5. Faston terminals have a locking function. Make sure the terminals are securely locked in place after insertion. Press the tab on the terminals to remove them.
- \*6. Control box houses high-voltage parts. Before inspecting the inside of the control box turn off the power, keep the unit off for at least 10 minutes, and confirm that the voltage between FT-P and FT-N on INV Board has dropped to DC20V or less.

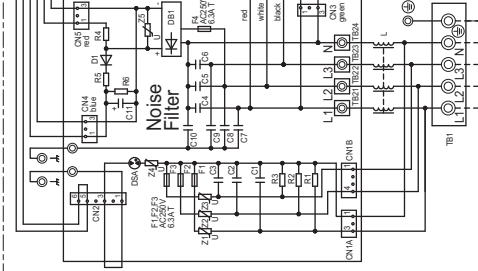


<Symbol explanation>

Symbol	Explanation
2/18/18	4-way valve
2/18/18	Case of heating switching circuit under the O.S.
5P/2	Heat exchanger capacity control
63H1	Magnetic contactor(FAN)
63H1	Pressure
63H1	High pressure protection for the pressure switch
63H1	Pressure sensor
79C	Discharge pressure
C112,22,3	Low pressure
C112,22,3	Magnetic relay(inverter main circuit)
C112,22,3	Current sensor(AC)
C112,22,3	Craticase heater(for heating the compressor)
DCI	DC reactor
SV1a	Soft start valve
SV4a,b,c,d	For opening/closing the bypass circuit under the O.S.
SV5b	Heat exchanger capacity control
SV5c	For opening/closing the bypass circuit
SV6	Heat exchanger low pressure bypass
SV6	For opening/closing the bypass circuit
TB1	Power supply
TB3	Indoor/Outdoor transmission cable
TB7	Central control transmission cable
TH3	Liquid pipe temperature
TH4	Discharge pipe temperature
TH5	ACC inlet pipe temperature
TH6	Heat exchanger inlet pipe temperature
TH7	O.A temperature
TH8	P.M temperature
Z24,25	Function setting connector


Measurement condition  
PURY-EP200YJM-A(-BS)

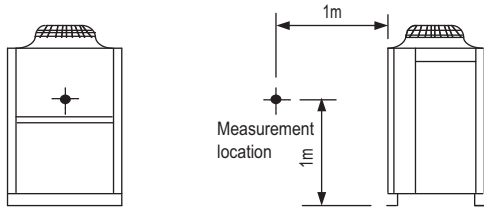

Measurement condition  
PURY-EP250,300YJM-A(-BS)

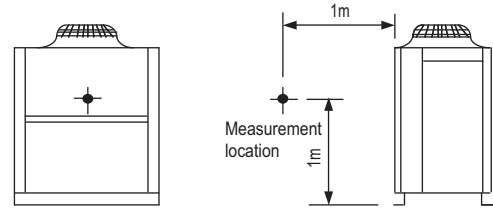


Sound level of PURY-EP200YJM-A(-BS)

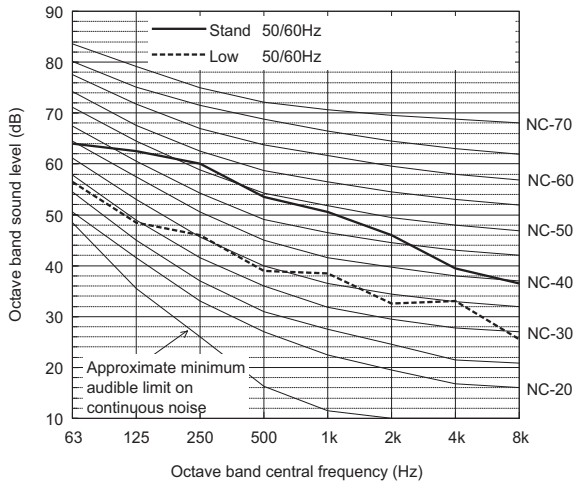

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	64.0	62.5	60.0	53.5	50.5	46.0	39.5	36.5	57.0
Low noise mode	50/60Hz	56.5	48.5	46.0	39.0	38.5	32.5	33.0	25.5	44.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


Sound level of PURY-EP250YJM-A(-BS)

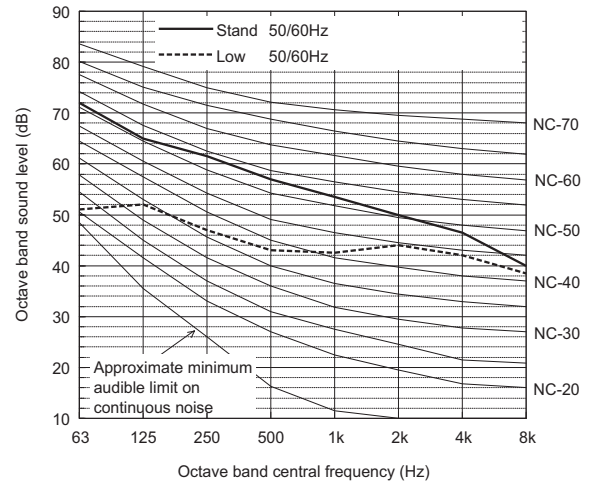

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	72.0	65.0	61.5	57.0	53.5	50.0	46.5	40.0	60.0
Low noise mode	50/60Hz	51.0	52.0	47.0	43.0	42.5	44.0	42.0	38.5	50.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PURY-EP300YJM-A(-BS)

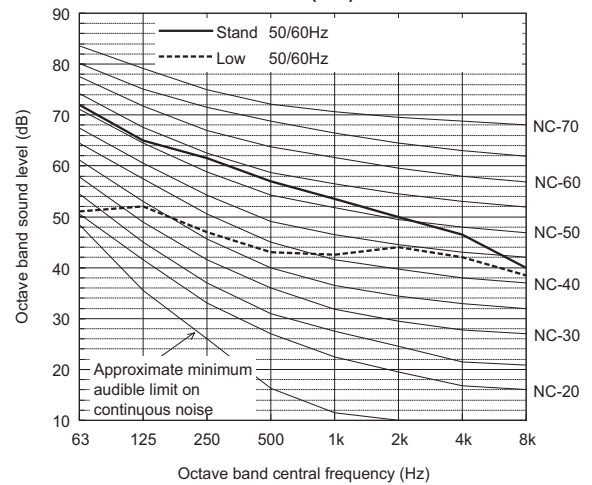


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	72.0	65.0	61.5	57.0	53.5	50.0	46.5	40.0	60.0
Low noise mode	50/60Hz	51.0	52.0	47.0	43.0	42.5	44.0	42.0	38.5	50.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

R2(HIGH COP)


Measurement condition  
PURY-EP350YJM-A(-BS)

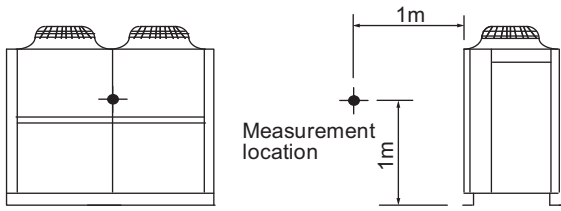

Measurement condition  
PURY-EP400YSJM-A(-BS)

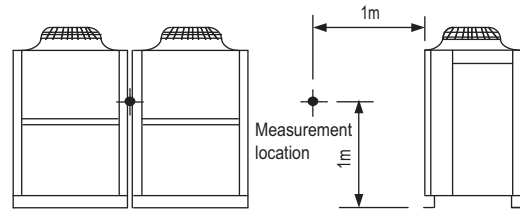


Sound level of PURY-EP350YJM-A(-BS)

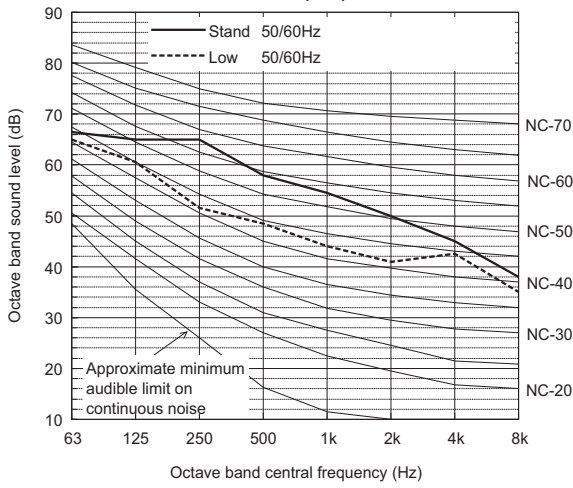

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	66.5	65.0	65.0	58.0	54.5	50.0	45.0	38.0	61.0
Low noise mode	50/60Hz	65.0	60.5	51.5	48.5	44.0	41.0	42.5	35.0	52.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

Sound level of PURY-EP400YSJM-A(-BS)

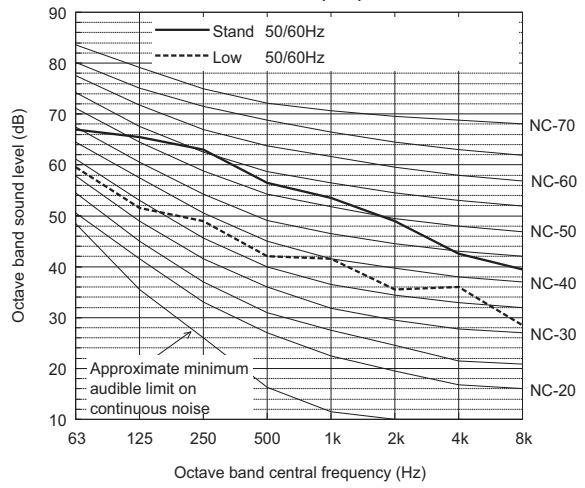


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	67.0	65.5	63.0	56.5	53.5	49.0	42.5	39.5	60.0
Low noise mode	50/60Hz	59.5	51.5	49.0	42.0	41.5	35.5	36.0	28.5	47.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

R2(HIGH COP)


**Measurement condition  
PURY-EP450,500YSJM-A(-BS)**

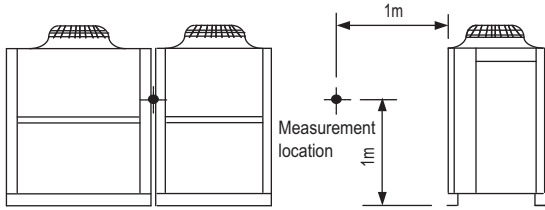

**Measurement condition  
PURY-EP500,550,600YSJM-A(1)(-BS)**

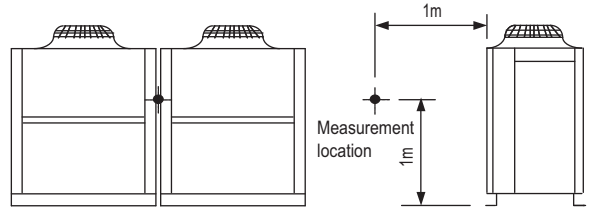


**Sound level of PURY-EP450YSJM-A(-BS)**

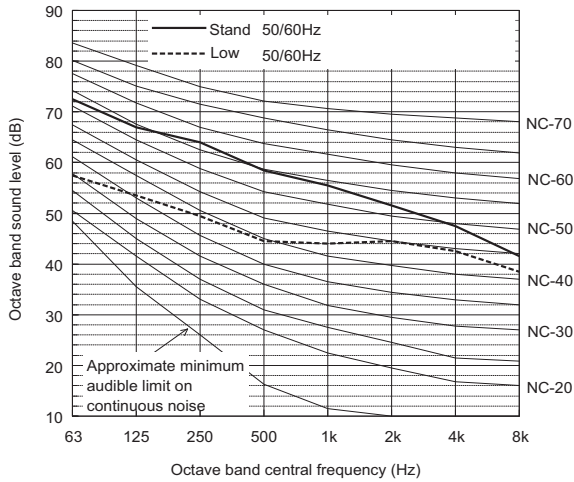

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	72.5	67.0	64.0	58.5	55.5	51.5	47.5	41.5	62.0
Low noise mode	50/60Hz	57.5	53.5	49.5	44.5	44.0	44.5	42.5	38.5	51.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


**Sound level of PURY-EP500YSJM-A(1)(-BS)**

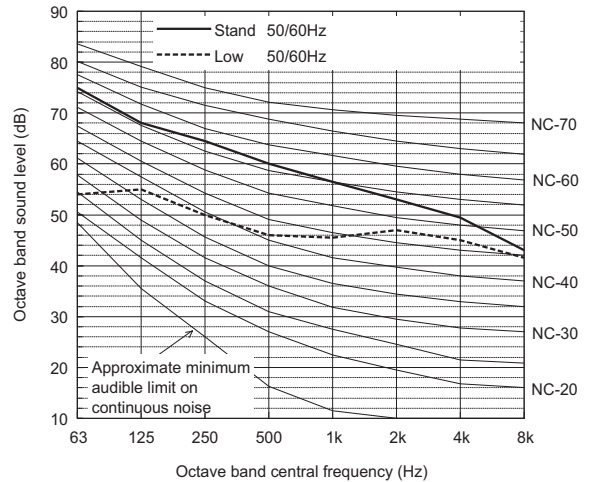

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	75.0	68.0	64.5	60.0	56.5	53.0	49.5	43.0	63.0
Low noise mode	50/60Hz	54.0	55.0	50.0	46.0	45.5	47.0	45.0	41.5	53.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


**Sound level of PURY-EP500YSJM-A(-BS)**

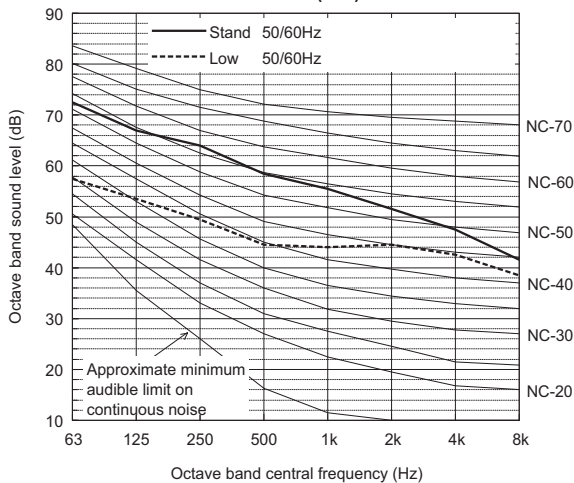

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	72.5	67.0	64.0	58.5	55.5	51.5	47.5	41.5	62.0
Low noise mode	50/60Hz	57.5	53.5	49.5	44.5	44.0	44.5	42.5	38.5	51.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

**Sound level of PURY-EP550YSJM-A(-BS)**



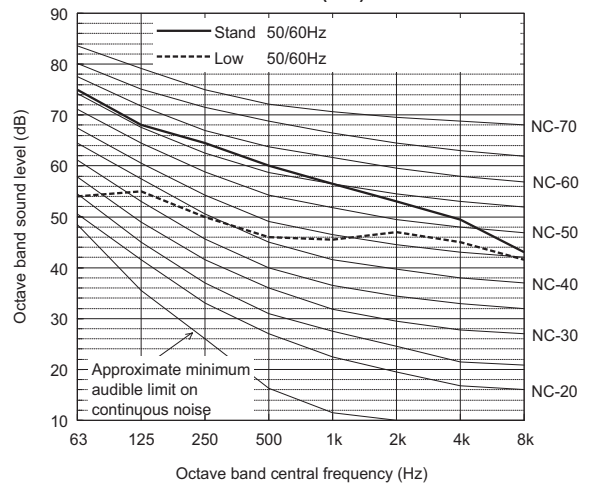


		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	75.0	68.0	64.5	60.0	56.5	53.0	49.5	43.0	63.0
Low noise mode	50/60Hz	54.0	55.0	50.0	46.0	45.5	47.0	45.0	41.5	53.0

When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.


R2(HIGH COP)



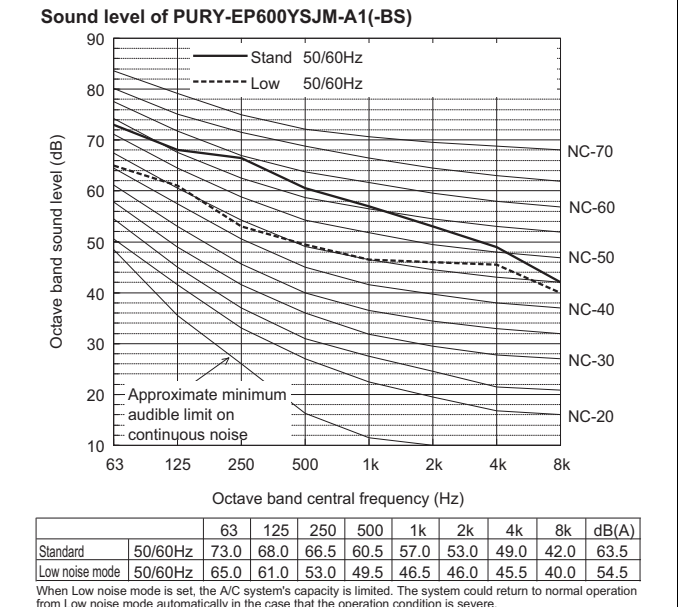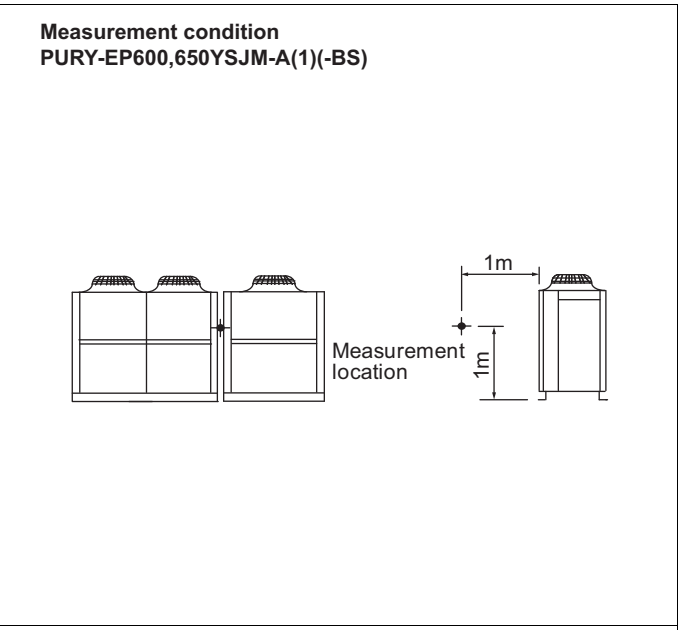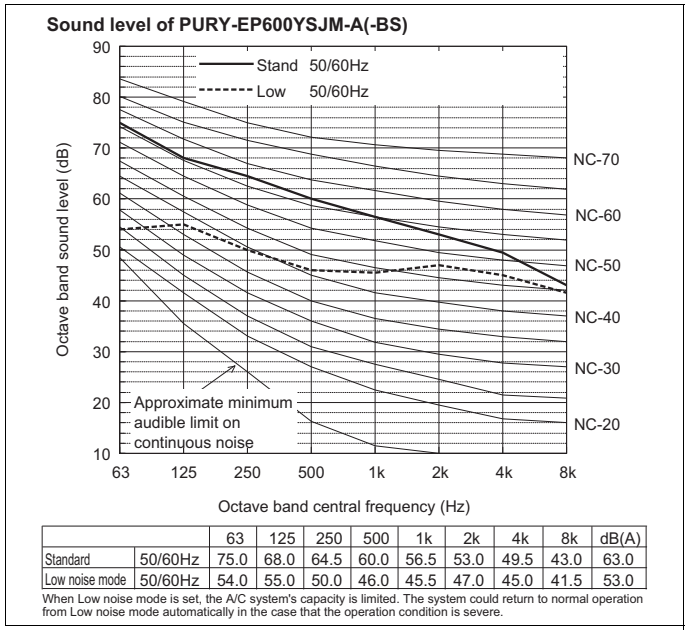


R2(HIGH COP)

**Measurement condition**  
**PURY-EP700YSJM-A(-BS)**

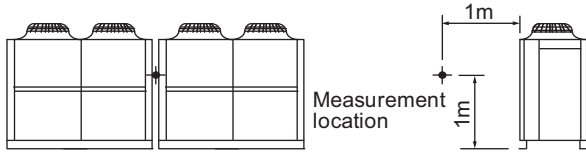

**Sound level of PURY-EP700YSJM-A(-BS)**

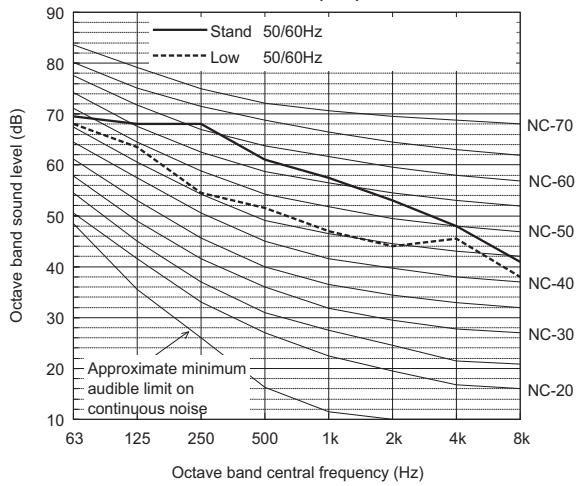

		63	125	250	500	1k	2k	4k	8k	dB(A)
Standard	50/60Hz	69.5	68.0	68.0	61.0	57.5	53.0	48.0	41.0	64.0
Low noise mode	50/60Hz	68.0	63.5	54.5	51.5	47.0	44.0	45.5	38.0	55.0


When Low noise mode is set, the A/C system's capacity is limited. The system could return to normal operation from Low noise mode automatically in the case that the operation condition is severe.

R2(HIGH COP)


6-1. Correction by temperature

CITY MULTI could have various capacities at different designing temperatures. Using the nominal cooling/heating capacity values and the ratios below, the capacity can be found for various temperatures.

PURY-		EP200YJM-A	EP250YJM-A
Nominal Cooling Capacity	kW	22.4	28.0
	BTU/h	76,400	95,500
Input	kW	5.07	6.76

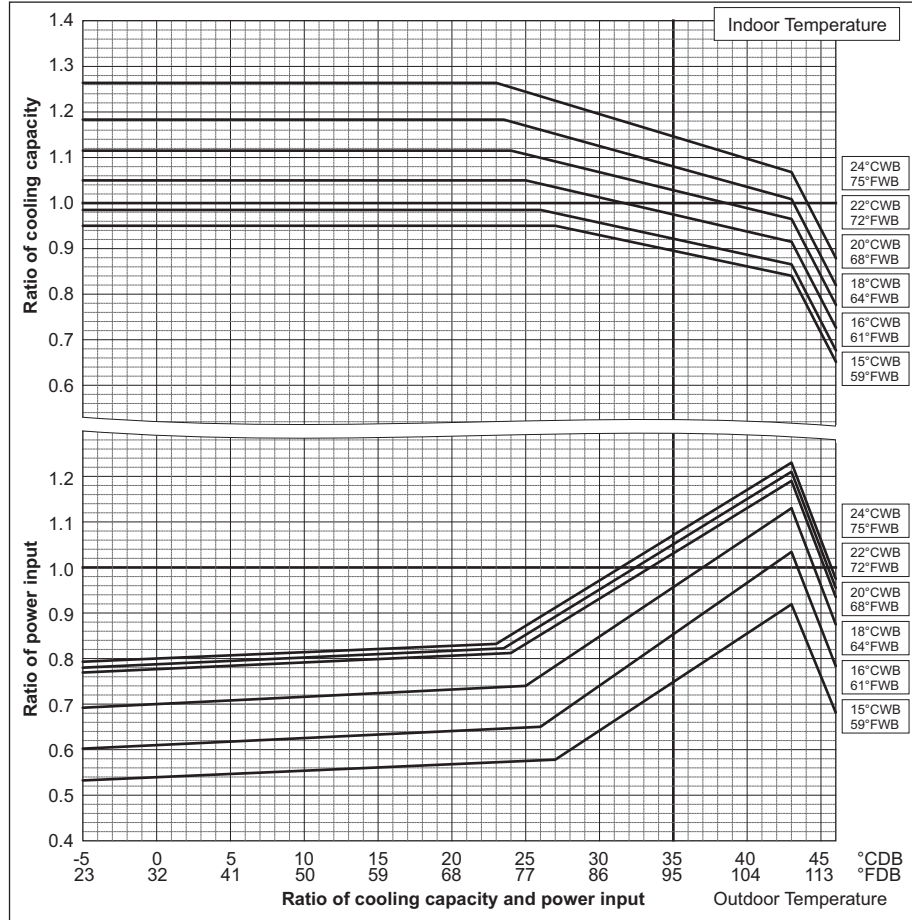

PURY-		EP200YJM-A	EP250YJM-A
Nominal Heating Capacity	kW	25.0	31.5
	BTU/h	85,300	107,500
Input	kW	5.56	7.15

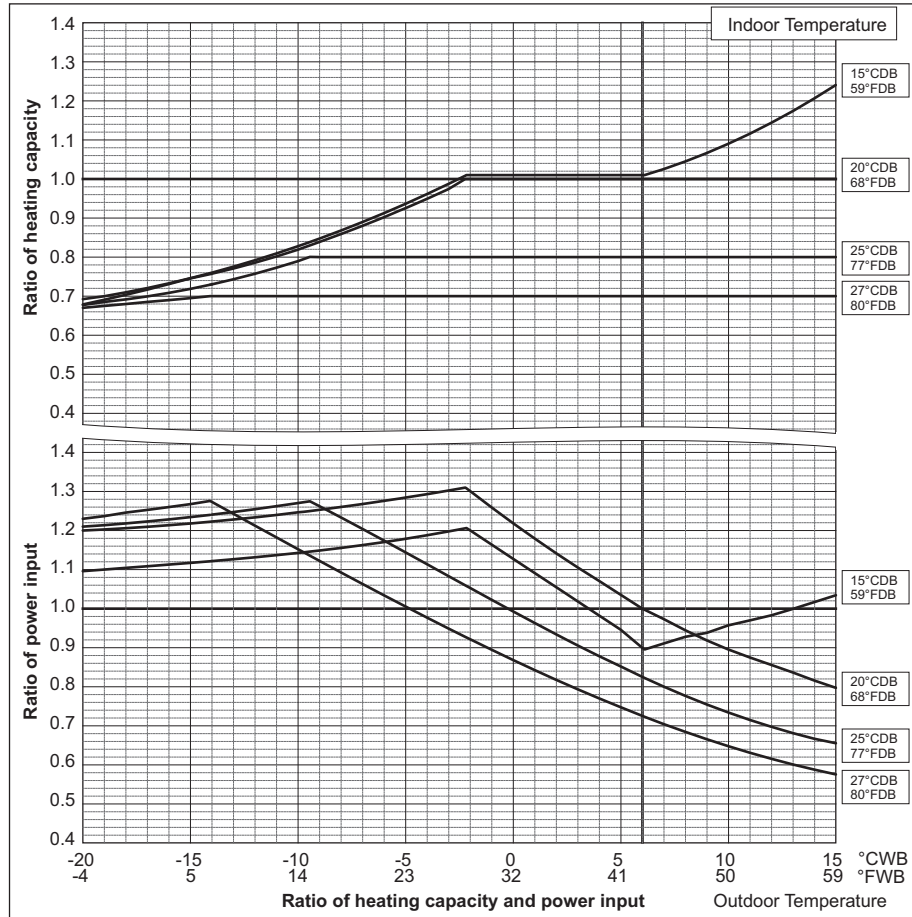


R2(HIGH COP)

# 6. CAPACITY TABLES


PURY-		EP300YJM-A	EP350YJM-A
Nominal Cooling Capacity	kW	33.5	40.0
	BTU/h	114,300	136,500
Input	kW	8.25	10.28

PURY-		EP400YSJM-A
Nominal Cooling Capacity	kW	45.0
	BTU/h	153,500
Input	kW	10.41

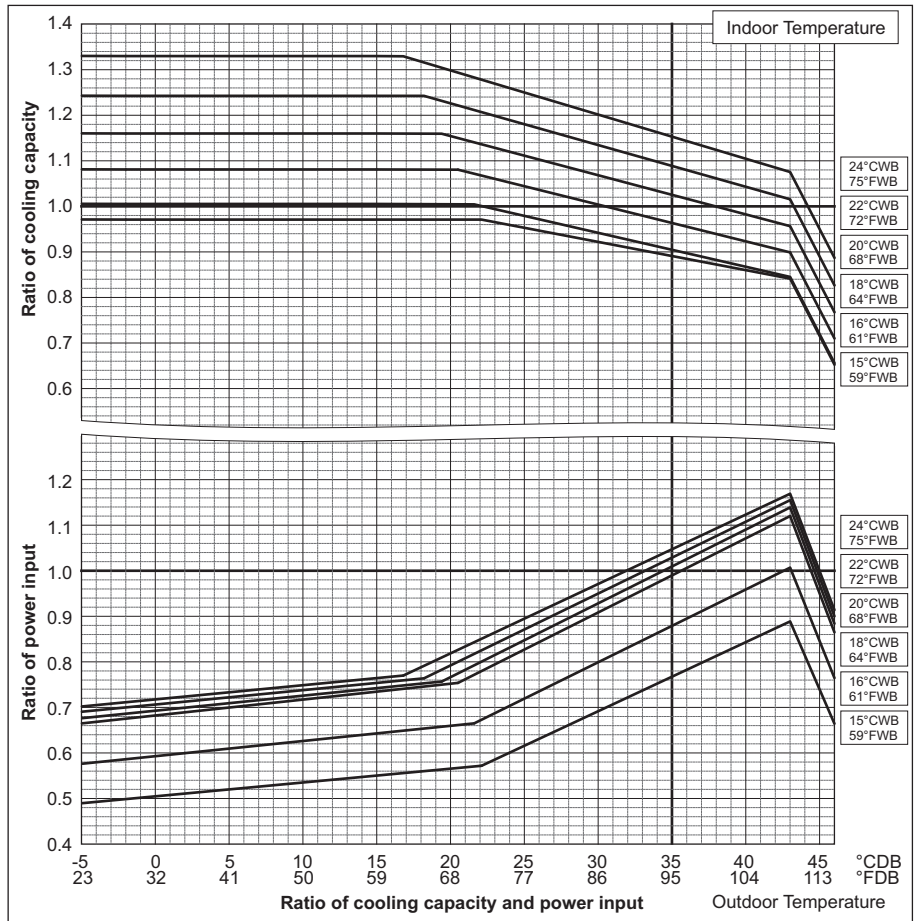

PURY-		EP300YJM-A	EP350YJM-A
Nominal Heating Capacity	kW	37.5	45.0
	BTU/h	128,000	153,500
Input	kW	8.60	10.58

PURY-		EP400YSJM-A
Nominal Heating Capacity	kW	50.0
	BTU/h	170,600
Input	kW	11.36

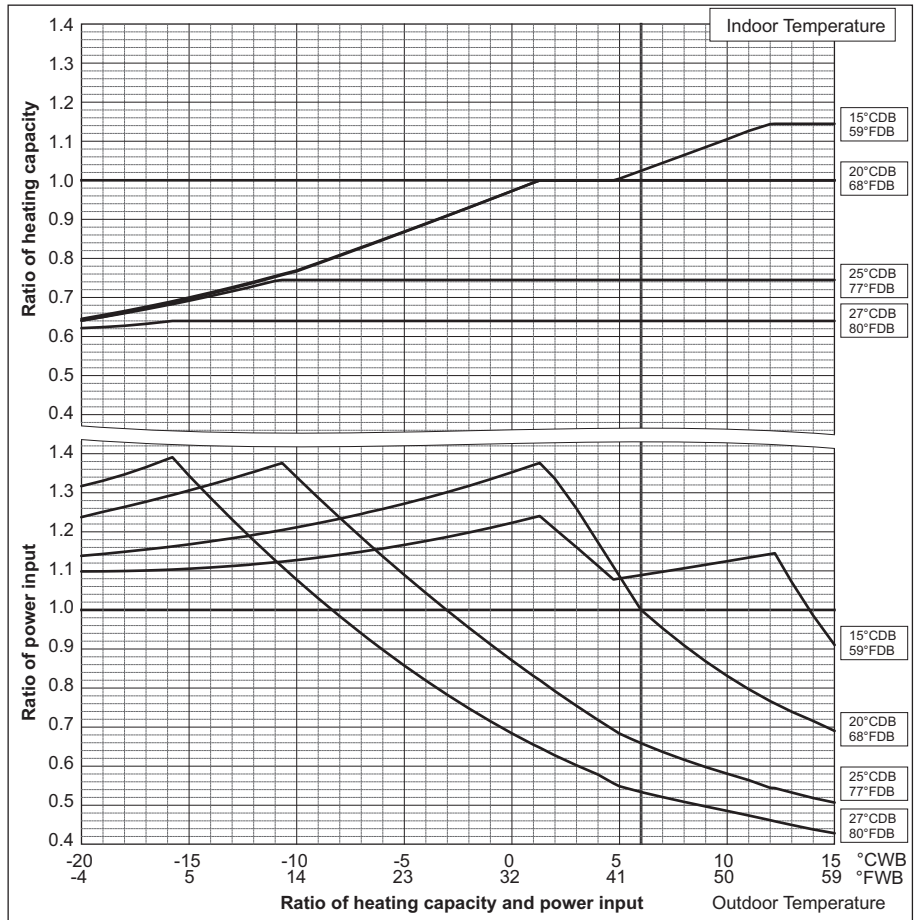

R2(HIGH COP)


# 6. CAPACITY TABLES

PURY-		EP450YSJM-A	EP500YSJM-A
Nominal Cooling Capacity	kW	50.0	56.0
	BTU/h	170,600	191,100
Input	kW	11.99	13.62

PURY-		EP500YSJM-A1	EP550YSJM-A
Nominal Cooling Capacity	kW	56.0	63.0
	BTU/h	191,100	215,000
Input	kW	13.96	15.40

PURY-		EP600YSJM-A	EP600YSJM-A1
Nominal Cooling Capacity	kW	69.0	69.0
	BTU/h	235,400	235,400
Input	kW	16.87	17.82

PURY-		EP650YSJM-A
Nominal Cooling Capacity	kW	73.0
	BTU/h	249,100
Input	kW	19.01

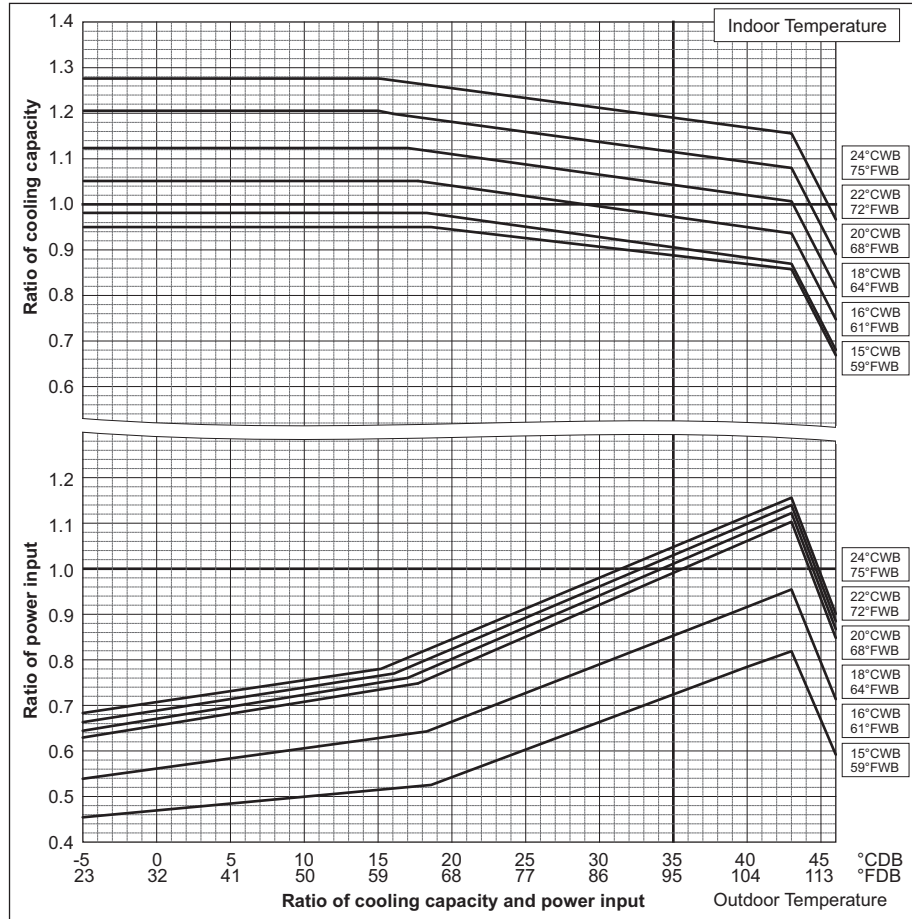


PURY-		EP450YSJM-A	EP500YSJM-A
Nominal Heating Capacity	kW	56.0	63.0
	BTU/h	191,100	215,000
Input	kW	12.87	14.38

PURY-		EP500YSJM-A1	EP550YSJM-A
Nominal Heating Capacity	kW	63.0	69.0
	BTU/h	215,000	235,400
Input	kW	14.78	15.93

PURY-		EP600YSJM-A	EP600YSJM-A1
Nominal Heating Capacity	kW	76.5	76.5
	BTU/h	261,000	261,000
Input	kW	17.38	18.30

PURY-		EP650YSJM-A
Nominal Heating Capacity	kW	81.5
	BTU/h	278,100
Input	kW	19.73

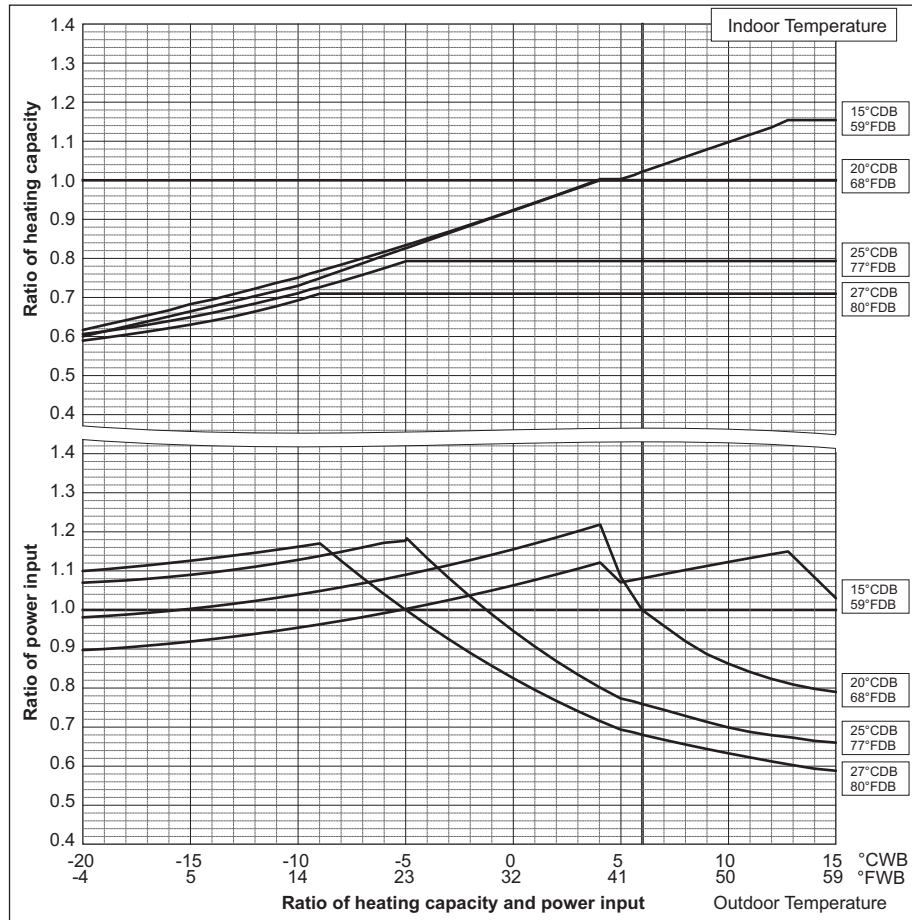


R2(HIGH COP)




# 6. CAPACITY TABLES

PURY-		EP700YSJM-A
Nominal Cooling Capacity	kW	80.0
	BTU/h	273,000
Input	kW	21.22

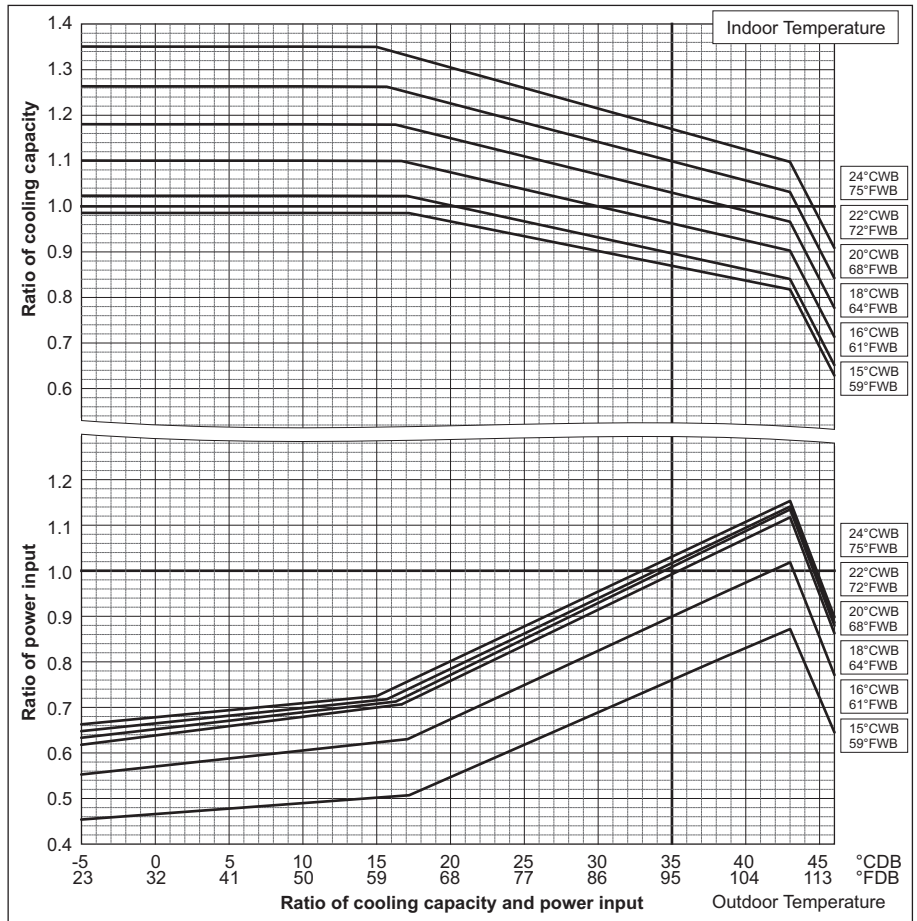

PURY-		EP700YSJM-A
Nominal Heating Capacity	kW	88.0
	BTU/h	300,300
Input	kW	22.05

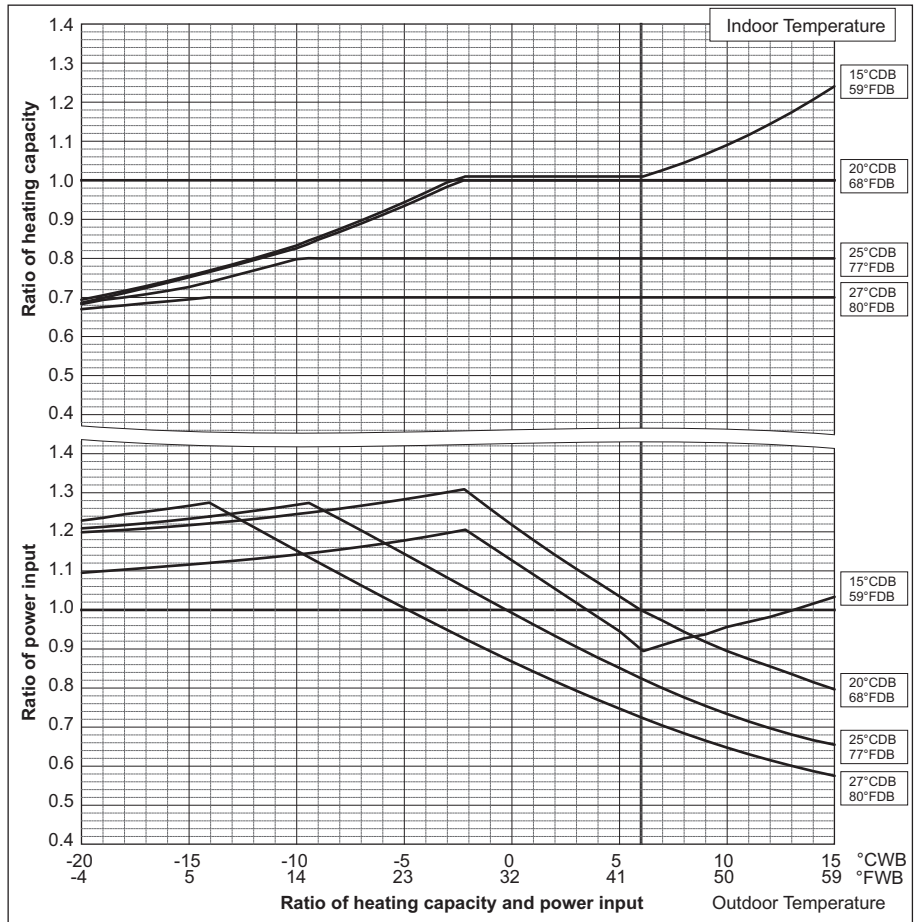

R2(HIGH COP)

**Correction by temperature (COP Priority Mode)**


CITY MULTI could have various capacities at different designing temperatures. Using the nominal cooling/heating capacity values and the ratios below, the capacity can be found for various temperatures.

To select COP priority mode, DipSW 3-7 must be set to ON.


PURY-	EP200YJM-A	EP250YJM-A
Nominal Cooling Capacity	kW 22.4	28.0
	BTU/h 76,400	95,500
Input	kW 5.07	6.76

(There is no difference in cooling performance between Standard Mode and COP Priority Mode.)

R2(HIGH COP)

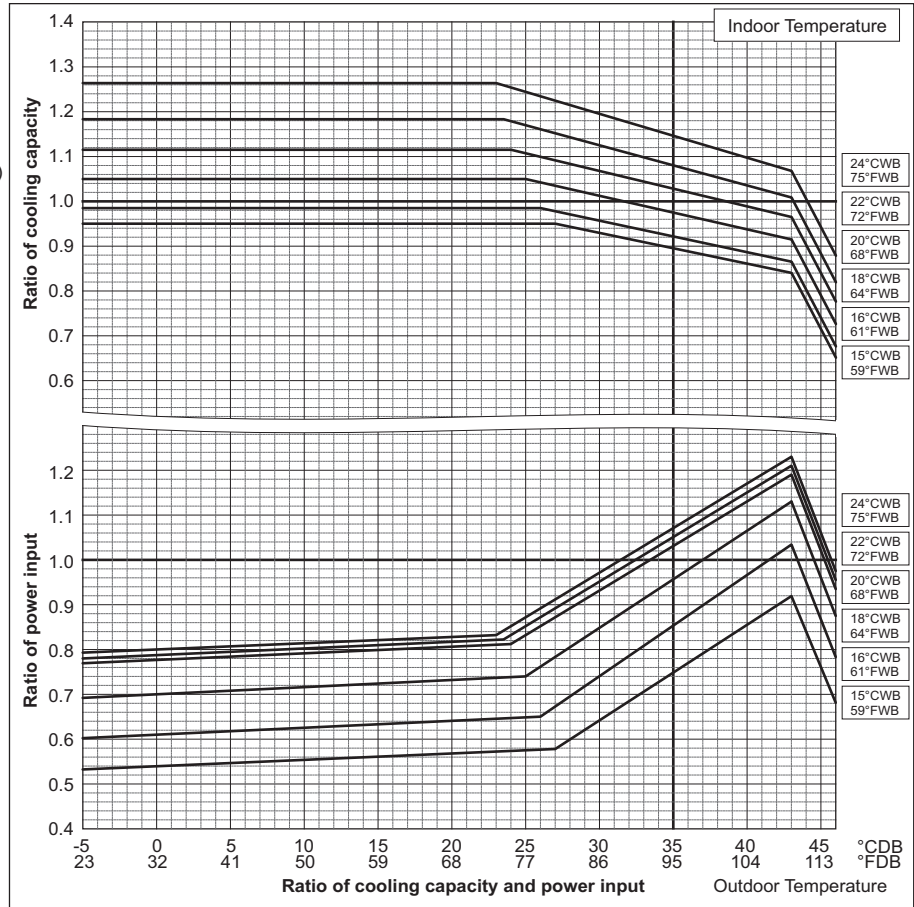

PURY-	EP200YJM-A	EP250YJM-A
Nominal Heating Capacity	kW 25.0	31.5
	BTU/h 85,300	107,500
Input	kW 5.56	7.15

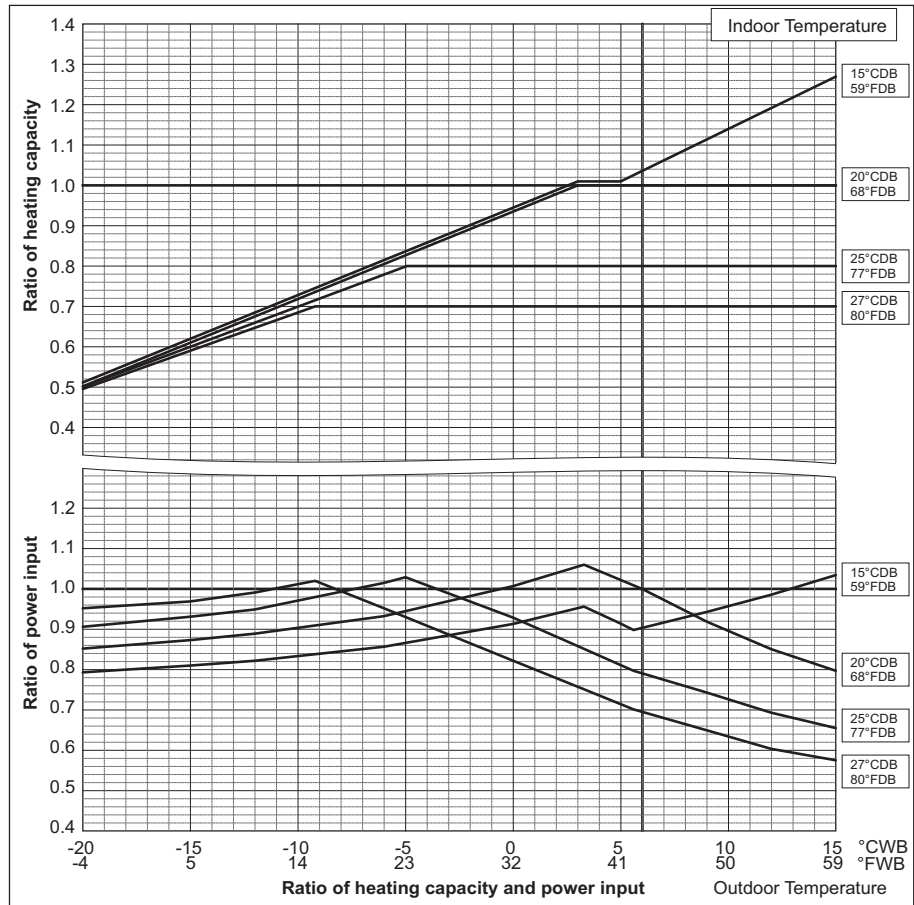




# 6. CAPACITY TABLES

PURY-		EP300YJM-A	EP350YJM-A
Nominal Cooling Capacity	kW	33.5	40.0
	BTU/h	114,300	136,500
Input	kW	8.25	10.28


PURY-		EP400YSJM-A
Nominal Cooling Capacity	kW	45.0
	BTU/h	153,500
Input	kW	10.41

(There is no difference in cooling performance between Standard Mode and COP Priority Mode.)

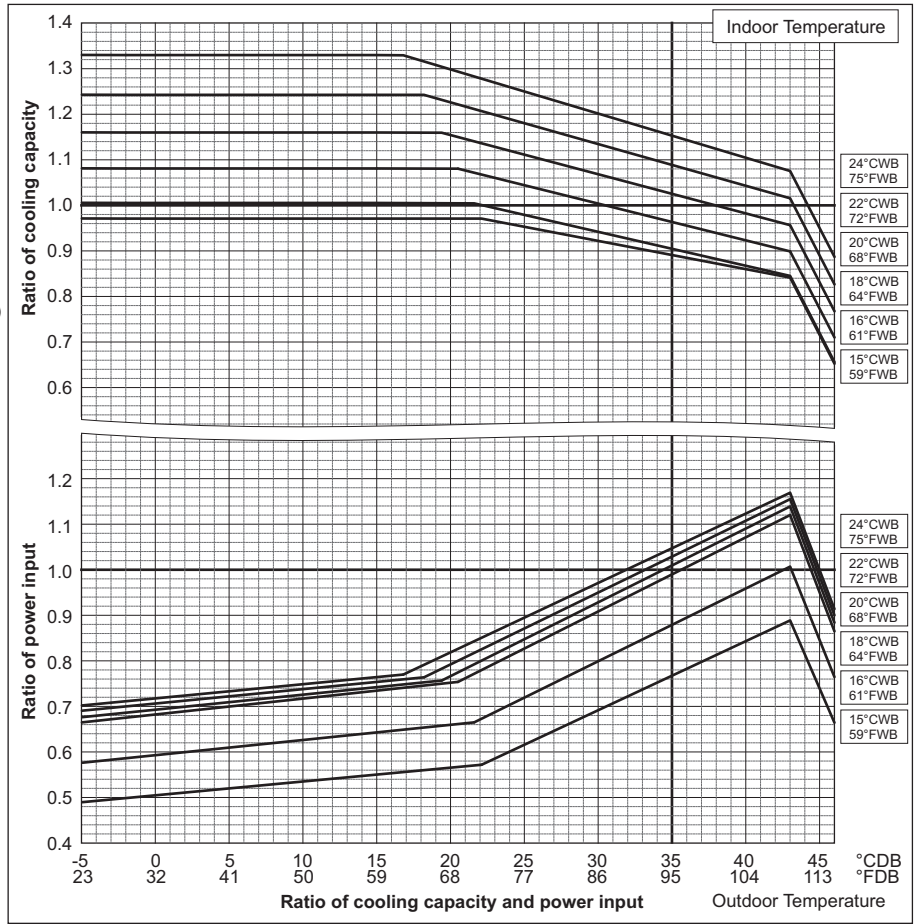

PURY-		EP300YJM-A	EP350YJM-A
Nominal Heating Capacity	kW	37.5	45.0
	BTU/h	128,000	153,500
Input	kW	8.60	10.58

PURY-		EP400YSJM-A
Nominal Heating Capacity	kW	50.0
	BTU/h	170,600
Input	kW	11.36

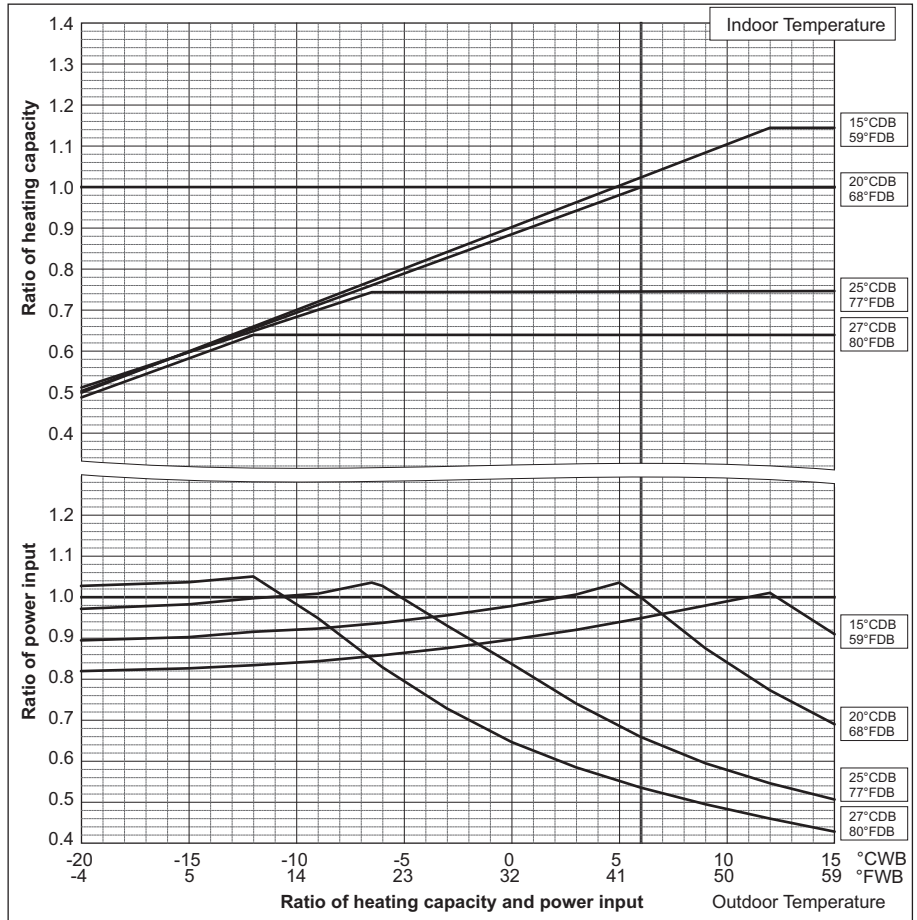

R2(HIGH COP)

# 6. CAPACITY TABLES


PURY-		EP450YSJM-A	EP500YSJM-A
Nominal Cooling Capacity	kW	50.0	56.0
	BTU/h	170,600	191,100
Input	kW	11.99	13.62

PURY-		EP500YSJM-A1	EP550YSJM-A
Nominal Cooling Capacity	kW	56.0	63.0
	BTU/h	191,100	215,000
Input	kW	13.96	15.40

PURY-		EP600YSJM-A	EP600YSJM-A1
Nominal Cooling Capacity	kW	69.0	69.0
	BTU/h	235,400	235,400
Input	kW	16.87	17.82

PURY-		EP650YSJM-A
Nominal Cooling Capacity	kW	73.0
	BTU/h	249,100
Input	kW	19.01

(There is no difference in cooling performance between Standard Mode and COP Priority Mode.)

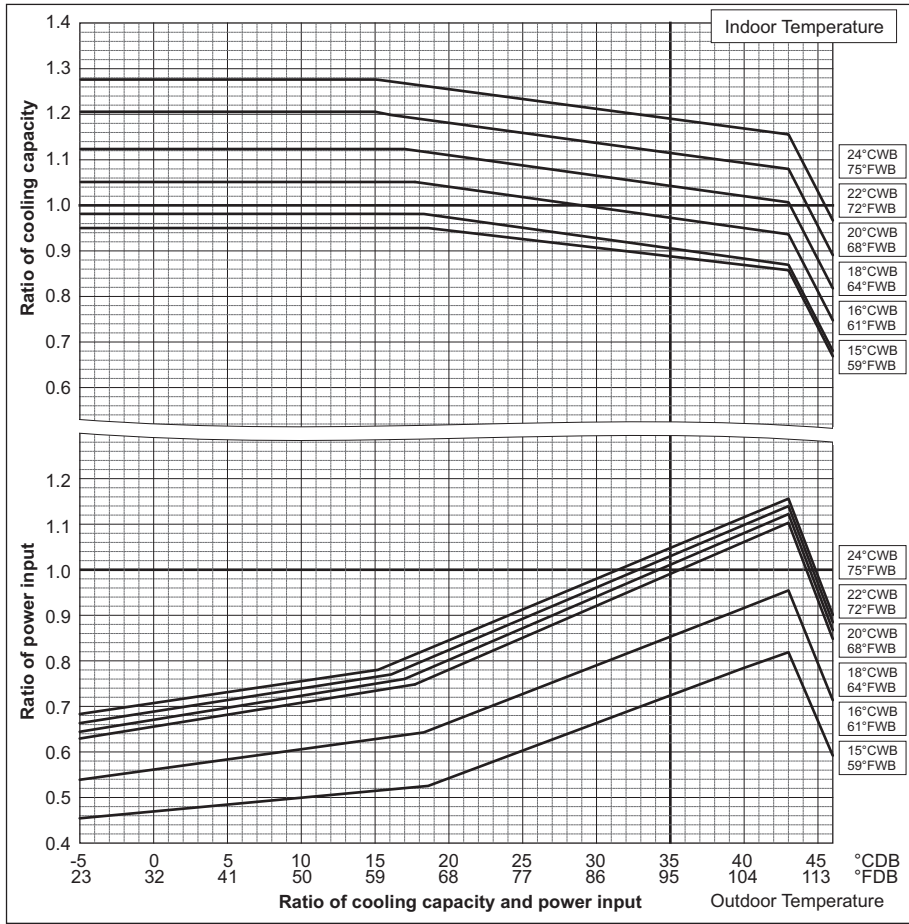


R2(HIGH COP)

PURY-		EP450YSJM-A	EP500YSJM-A
Nominal Heating Capacity	kW	56.0	63.0
	BTU/h	191,100	215,000
Input	kW	12.87	14.38

PURY-		EP500YSJM-A1	EP550YSJM-A
Nominal Heating Capacity	kW	63.0	69.0
	BTU/h	215,000	235,400
Input	kW	14.78	15.93

PURY-		EP600YSJM-A	EP600YSJM-A1
Nominal Heating Capacity	kW	76.5	76.5
	BTU/h	261,000	261,000
Input	kW	17.38	18.30


PURY-		EP650YSJM-A
Nominal Heating Capacity	kW	81.5
	BTU/h	278,100
Input	kW	19.73

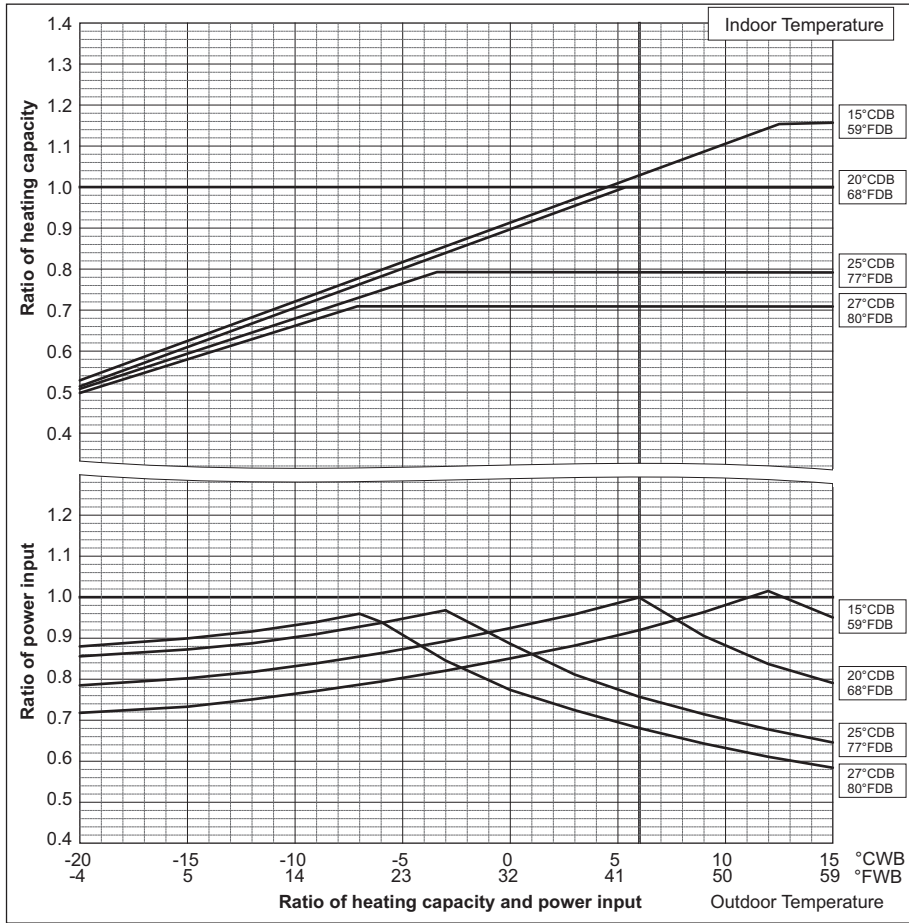


# 6. CAPACITY TABLES

<b>PURY-</b>		<b>EP700YSJM-A</b>
Nominal Cooling Capacity	kW	80.0
	BTU/h	273,000
Input	kW	21.22

(There is no difference in cooling performance between Standard Mode and COP Priority Mode.)

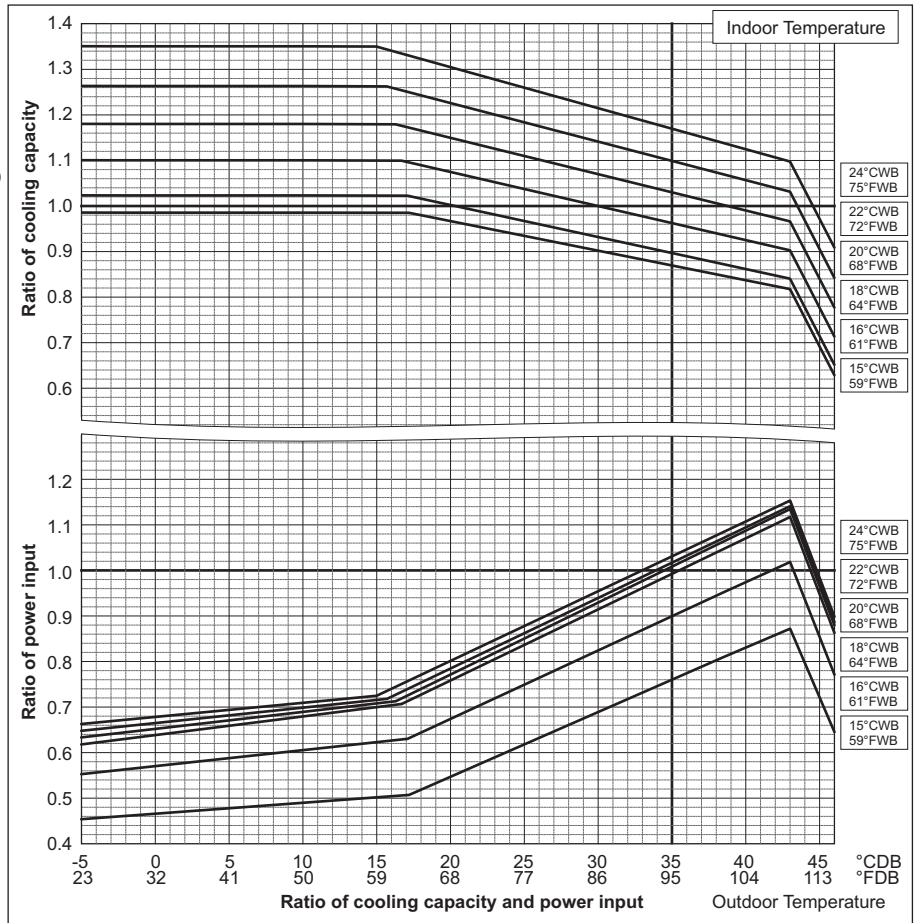

<b>PURY-</b>		<b>EP700YSJM-A</b>
Nominal Heating Capacity	kW	88.0
	BTU/h	300,300
Input	kW	22.05

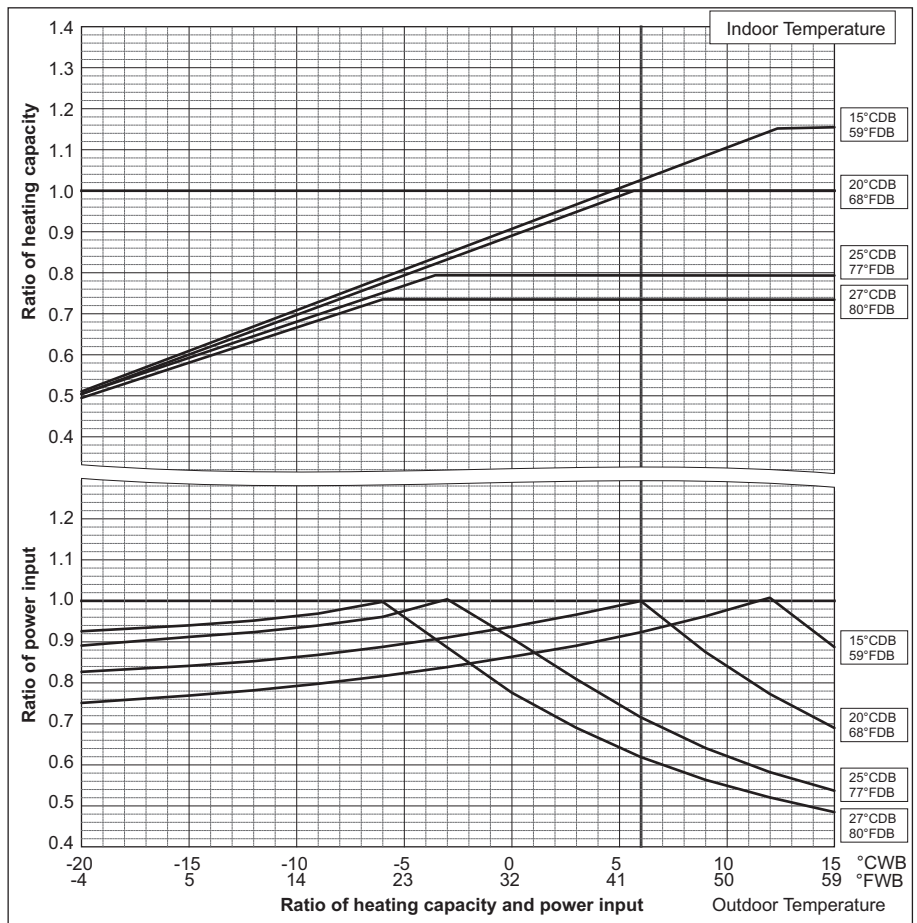


R2(HIGH COP)

6-2. Correction by total indoor

CITY MULTI system have different capacities and inputs when many combinations of indoor units with different total capacities are connected. Using following tables, the maximum capacity can be found to ensure the system is installed with enough capacity for a particular application.


PURY-EP200YJM-A		
Nominal Cooling Capacity	kW	22.4
	BTU/h	76,400
Input	kW	5.07

PURY-EP200YJM-A		
Nominal Heating Capacity	kW	25.0
	BTU/h	85,300
Input	kW	5.56

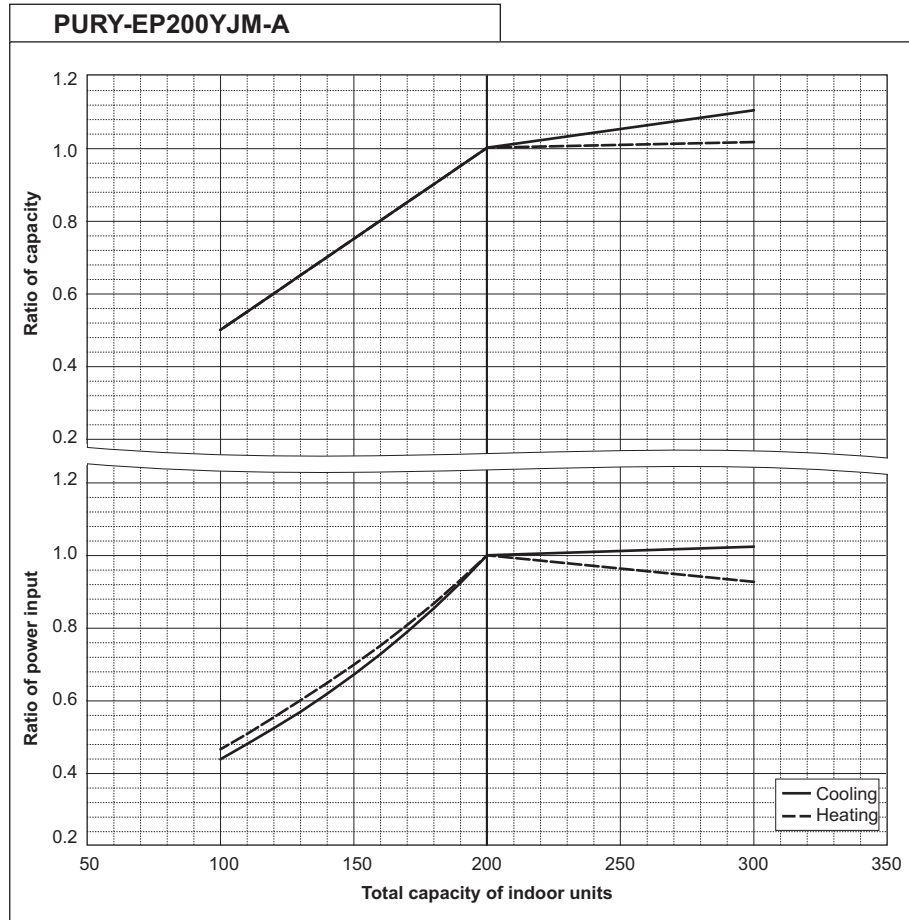

PURY-EP250YJM-A		
Nominal Cooling Capacity	kW	28.0
	BTU/h	95,500
Input	kW	6.76

PURY-EP250YJM-A		
Nominal Heating Capacity	kW	31.5
	BTU/h	107,500
Input	kW	7.15

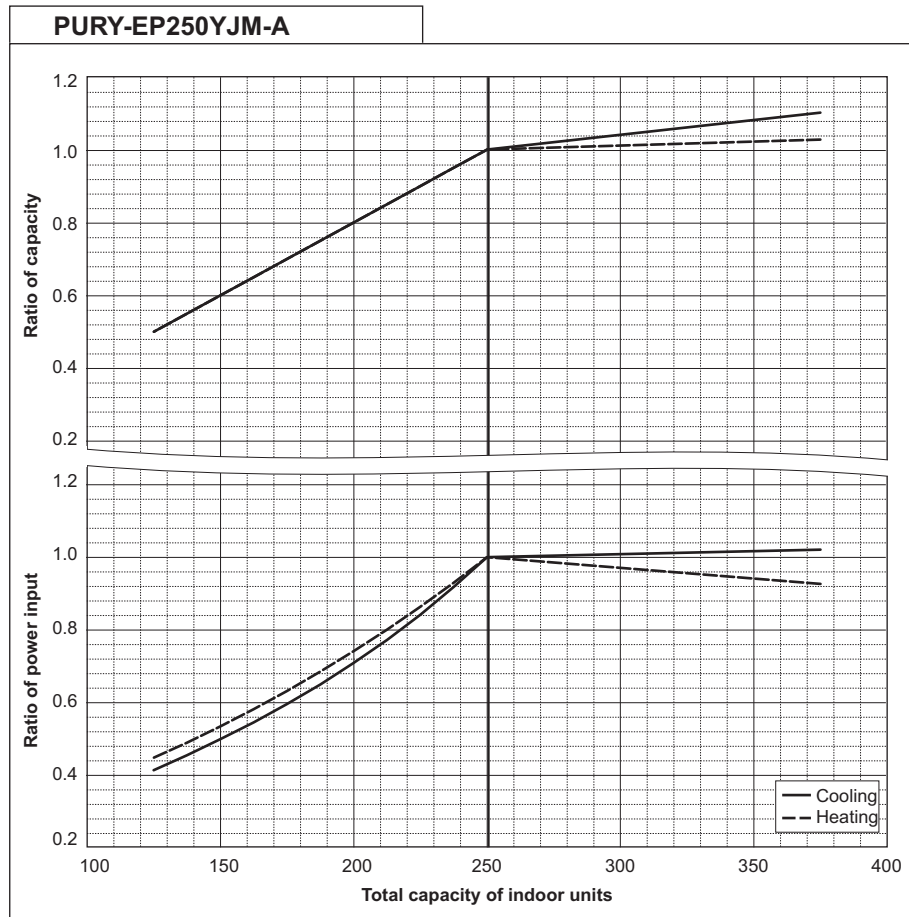


R2(HIGH COP)




PURY-EP300YJM-A		
Nominal Cooling Capacity	kW	33.5
	BTU/h	114,300
Input	kW	8.25

PURY-EP300YJM-A		
Nominal Heating Capacity	kW	37.5
	BTU/h	128,000
Input	kW	8.60

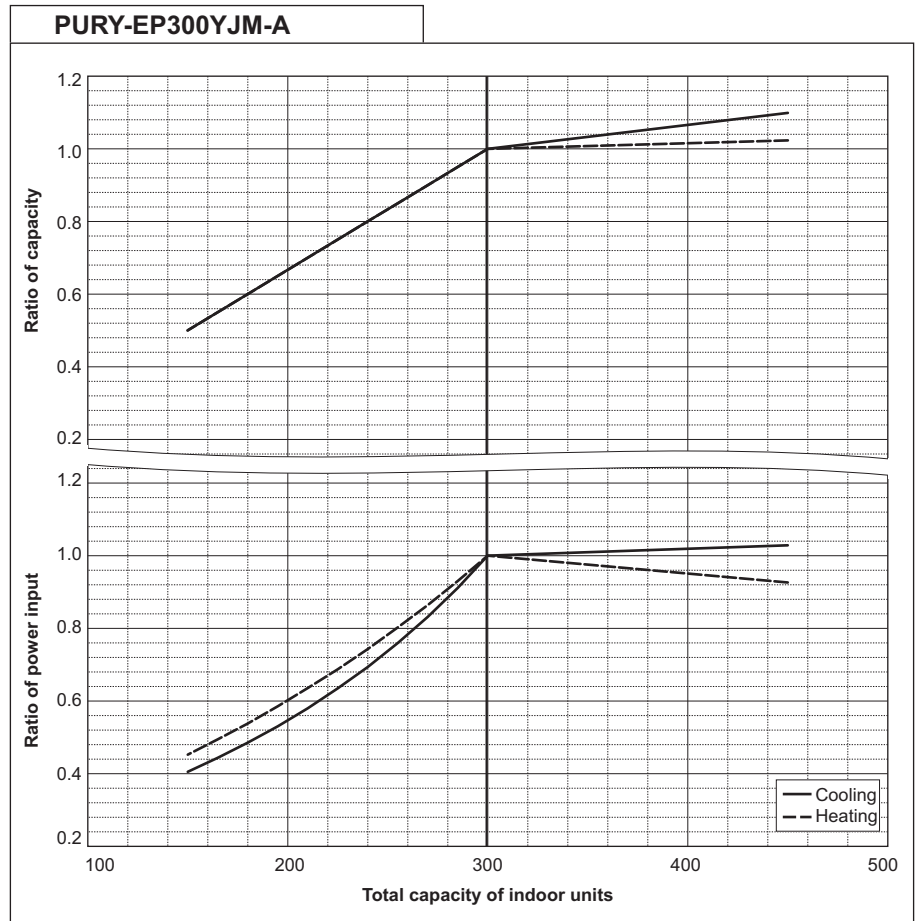

PURY-EP350YJM-A		
Nominal Cooling Capacity	kW	40.0
	BTU/h	136,500
Input	kW	10.28


PURY-EP350YJM-A		
Nominal Heating Capacity	kW	45.0
	BTU/h	153,500
Input	kW	10.58

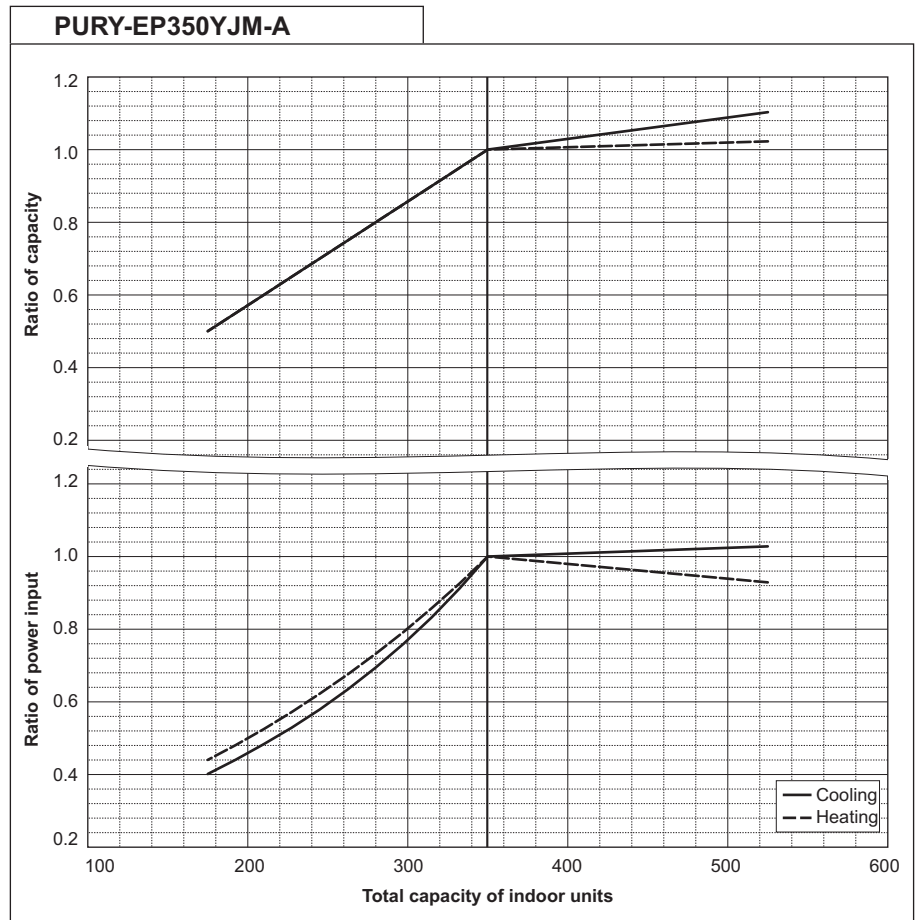

R2(HIGH COP)


PURY-EP400YSJM-A		
Nominal Cooling Capacity	kW	45.0
	BTU/h	153,500
Input	kW	10.41

PURY-EP400YSJM-A		
Nominal Heating Capacity	kW	50.0
	BTU/h	170,600
Input	kW	11.36

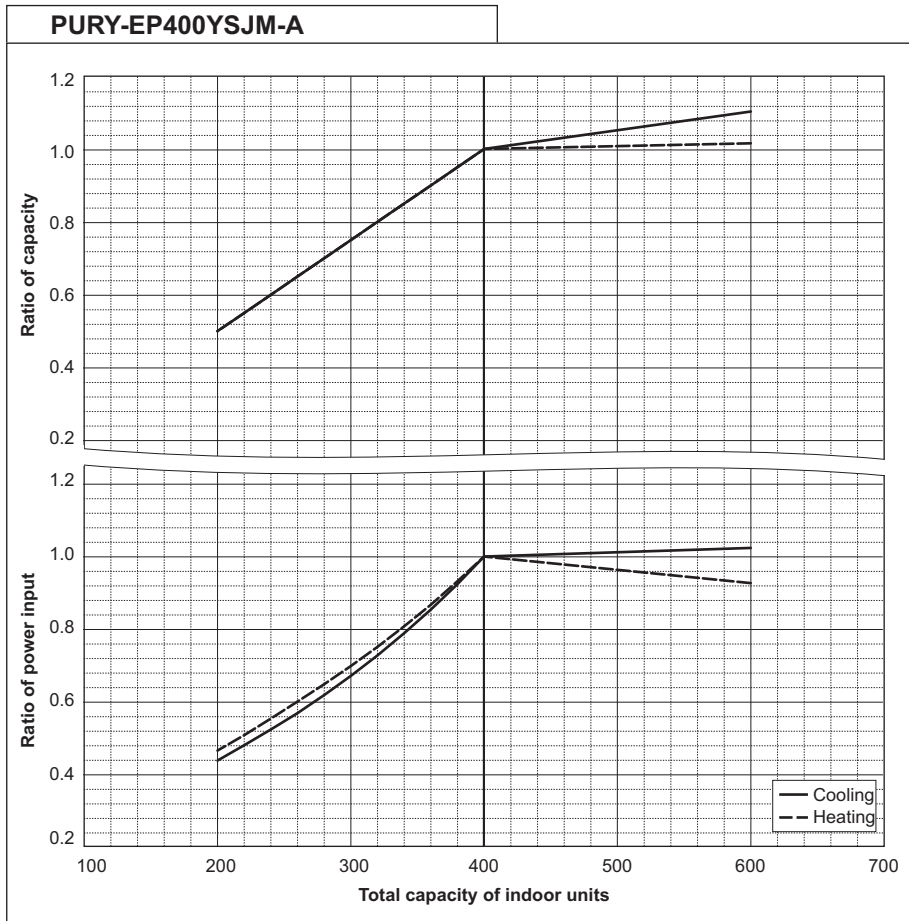

PURY-EP450YSJM-A		
Nominal Cooling Capacity	kW	50.0
	BTU/h	170,600
Input	kW	11.99


PURY-EP450YSJM-A		
Nominal Heating Capacity	kW	56.0
	BTU/h	191,100
Input	kW	12.87

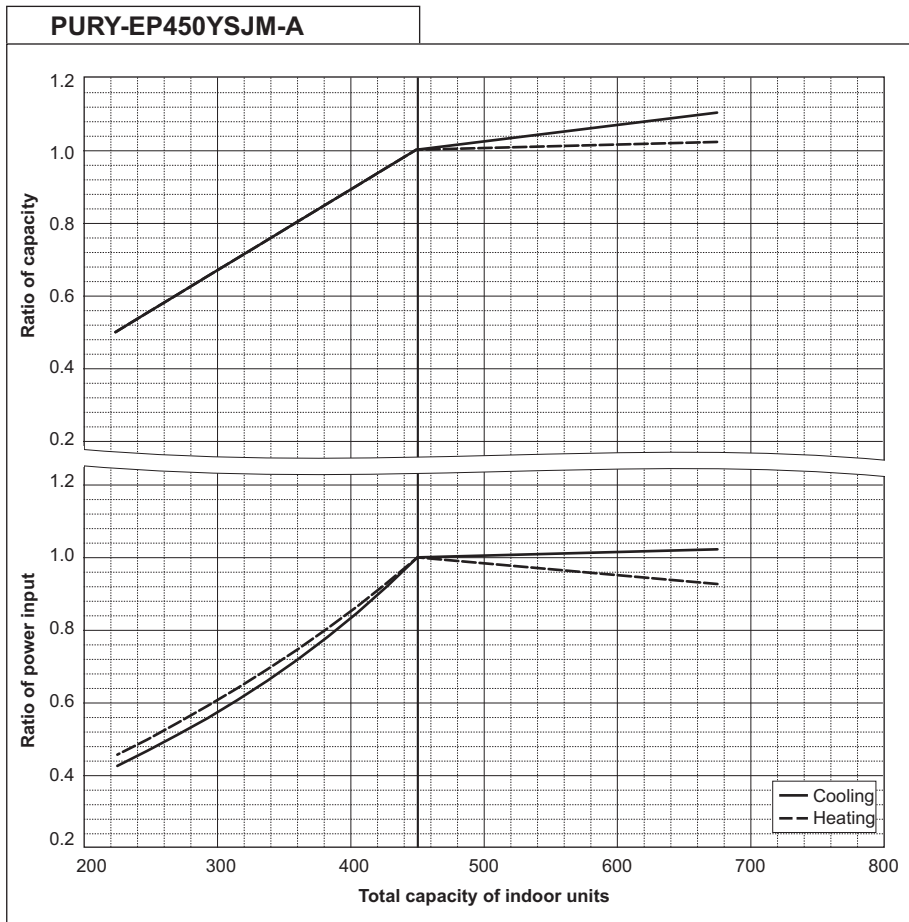

R2(HIGH COP)


PURY-EP500YSJM-A		
Nominal Cooling Capacity	kW	56.0
	BTU/h	191,100
Input	kW	13.62

PURY-EP500YSJM-A		
Nominal Heating Capacity	kW	63.0
	BTU/h	215,000
Input	kW	14.38

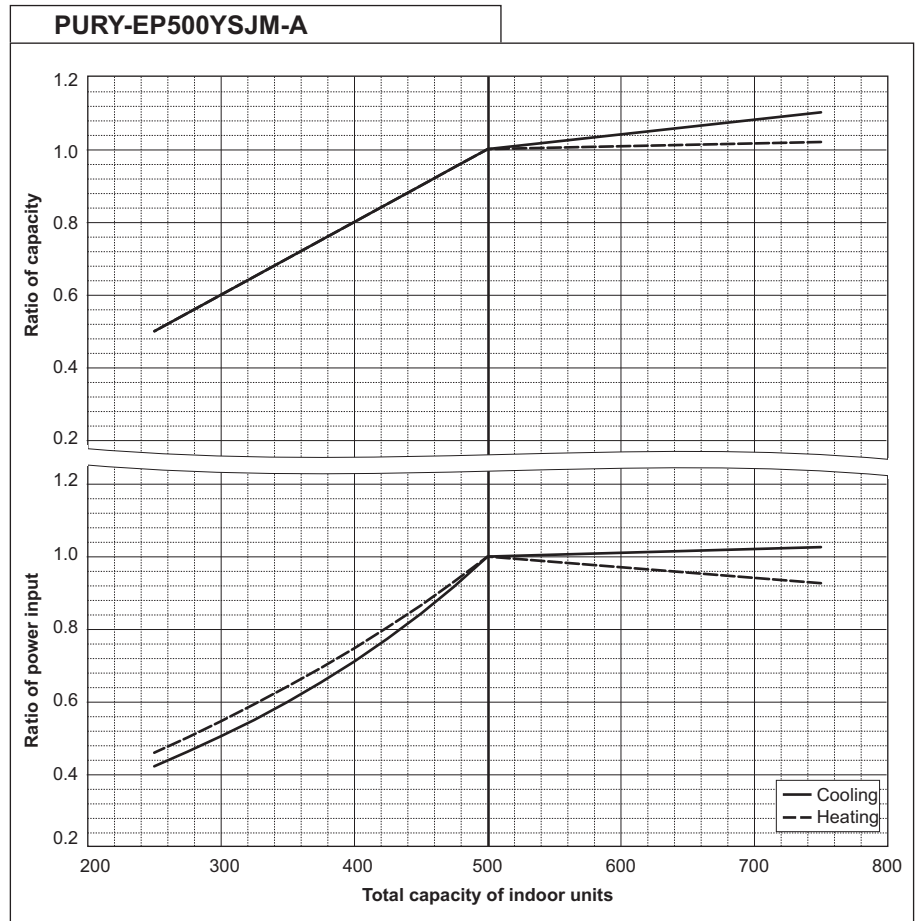

PURY-EP500YSJM-A1		
Nominal Cooling Capacity	kW	56.0
	BTU/h	191,100
Input	kW	13.96

PURY-EP500YSJM-A1		
Nominal Heating Capacity	kW	63.0
	BTU/h	215,000
Input	kW	14.78

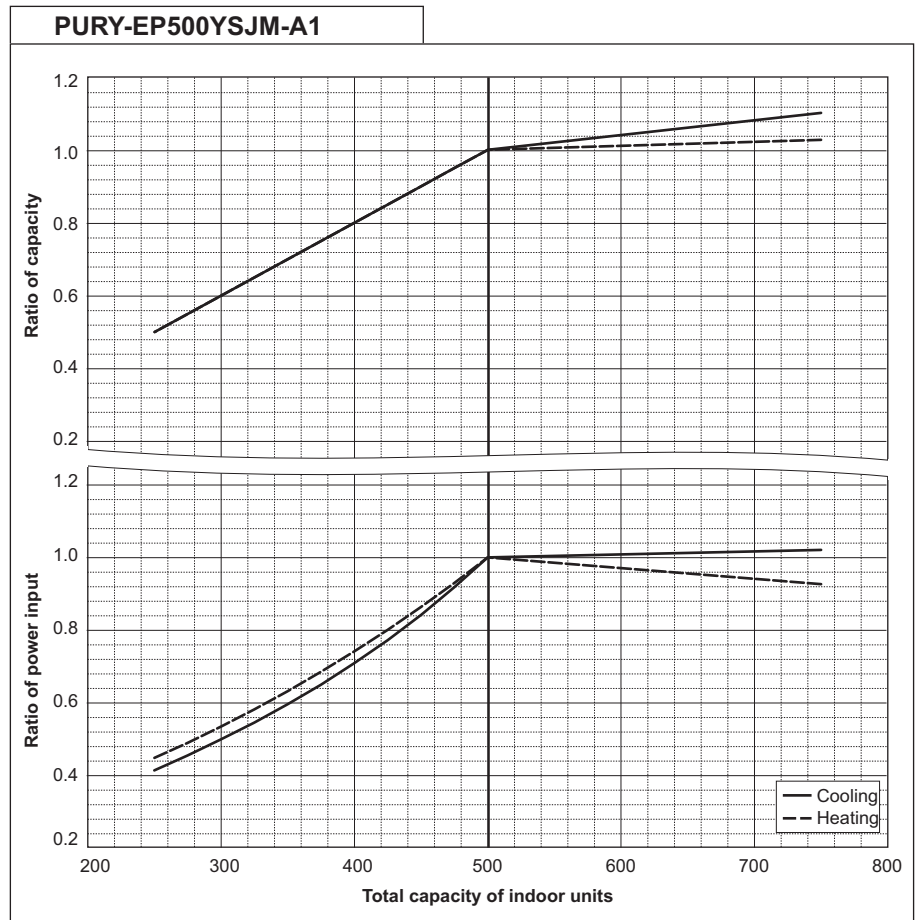


R2(HIGH COP)




PURY-EP550YSJM-A		
Nominal Cooling Capacity	kW	63.0
	BTU/h	215,000
Input	kW	15.40

PURY-EP550YSJM-A		
Nominal Heating Capacity	kW	69.0
	BTU/h	235,400
Input	kW	15.93

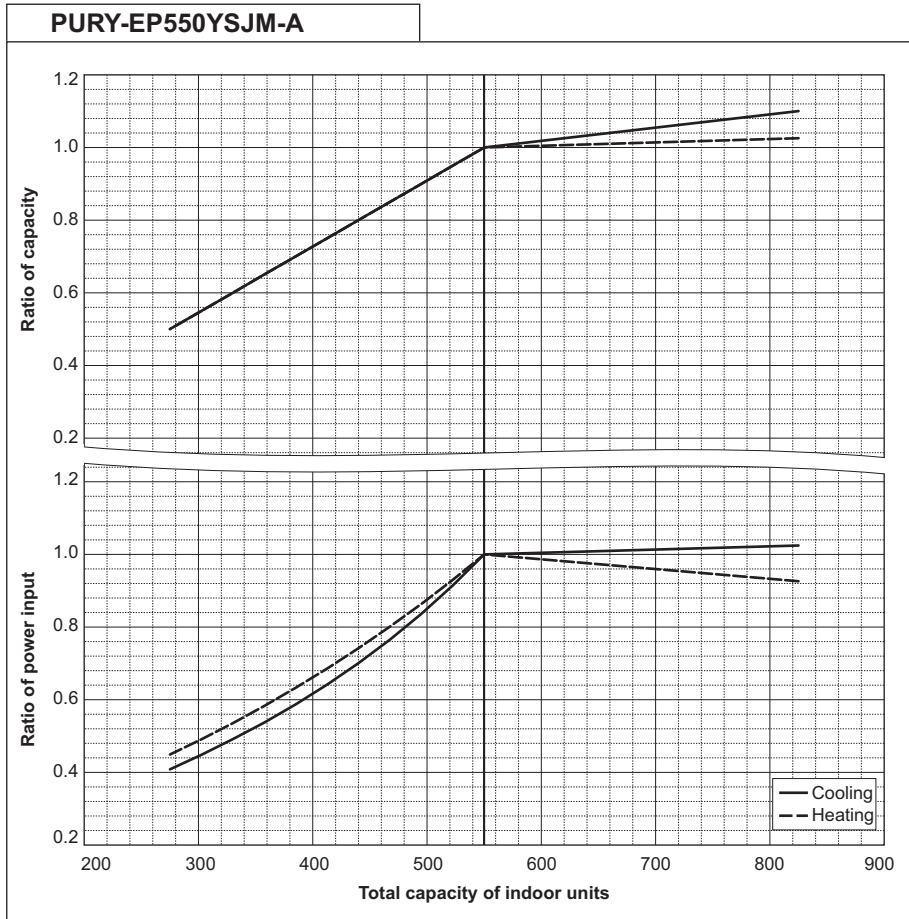

PURY-EP600YSJM-A		
Nominal Cooling Capacity	kW	69.0
	BTU/h	235,400
Input	kW	16.87


PURY-EP600YSJM-A		
Nominal Heating Capacity	kW	76.5
	BTU/h	261,000
Input	kW	17.38

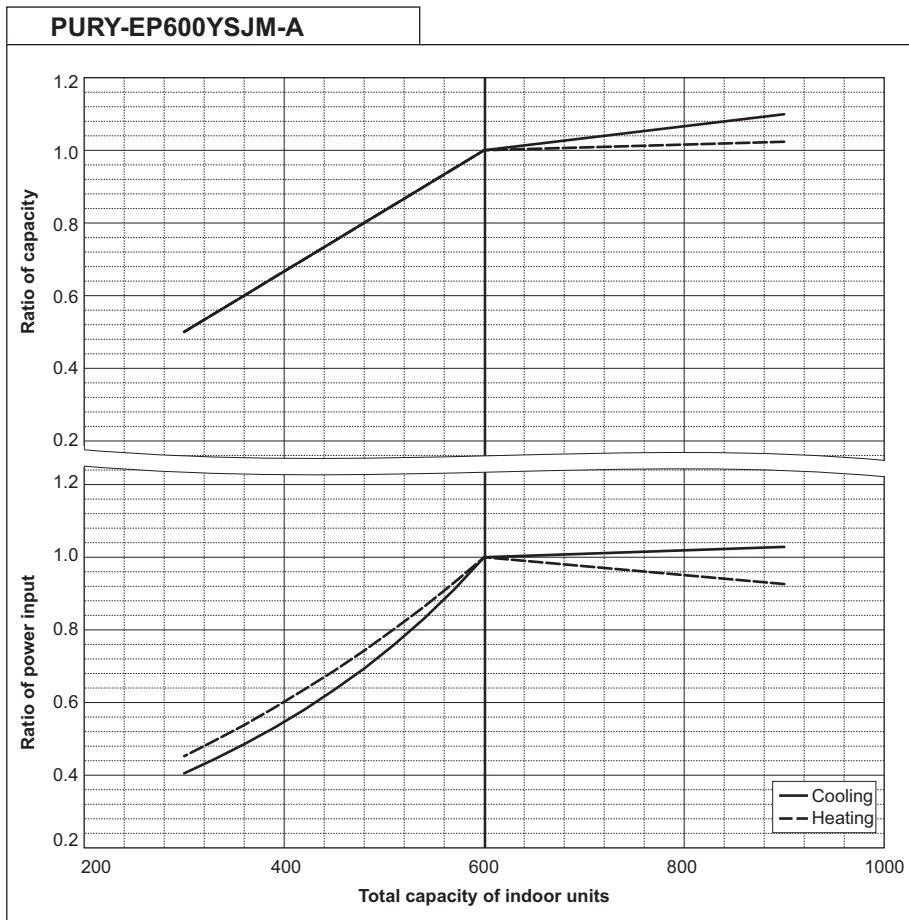

R2(HIGH COP)


PURY-EP600YSJM-A1		
Nominal Cooling Capacity	kW	69.0
	BTU/h	235,400
Input	kW	17.82

PURY-EP600YSJM-A1		
Nominal Heating Capacity	kW	76.5
	BTU/h	261,000
Input	kW	18.30

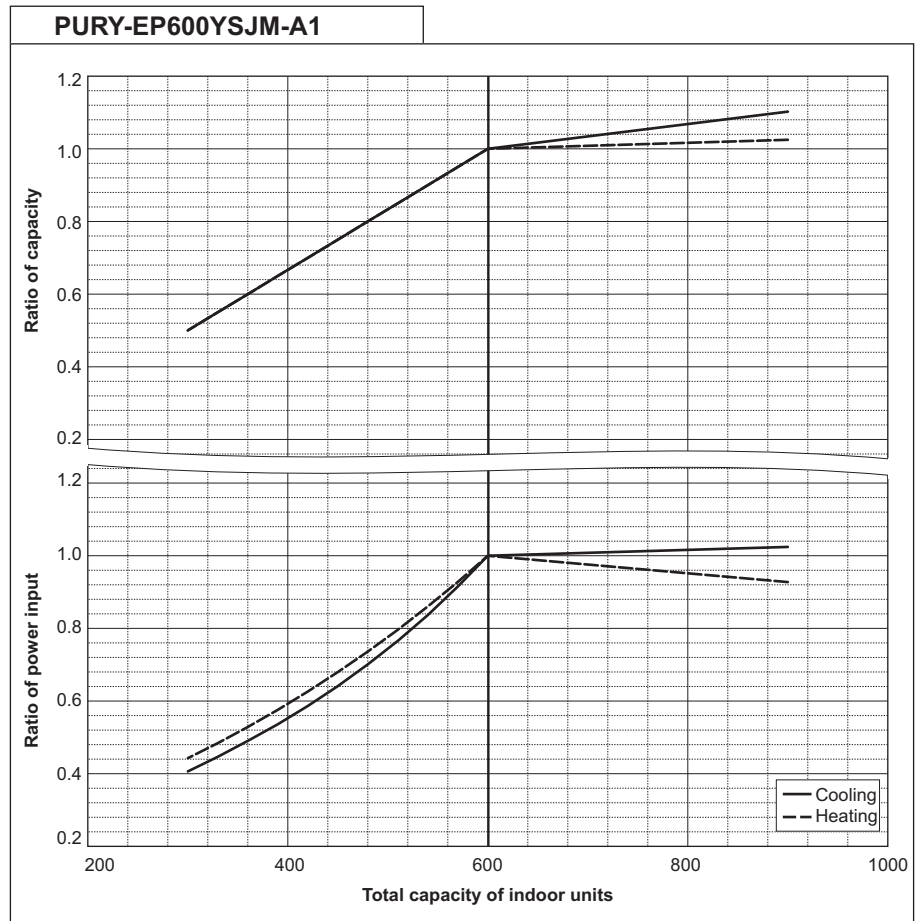

PURY-EP650YSJM-A		
Nominal Cooling Capacity	kW	73.0
	BTU/h	249,100
Input	kW	19.01


PURY-EP650YSJM-A		
Nominal Heating Capacity	kW	81.5
	BTU/h	278,100
Input	kW	19.73

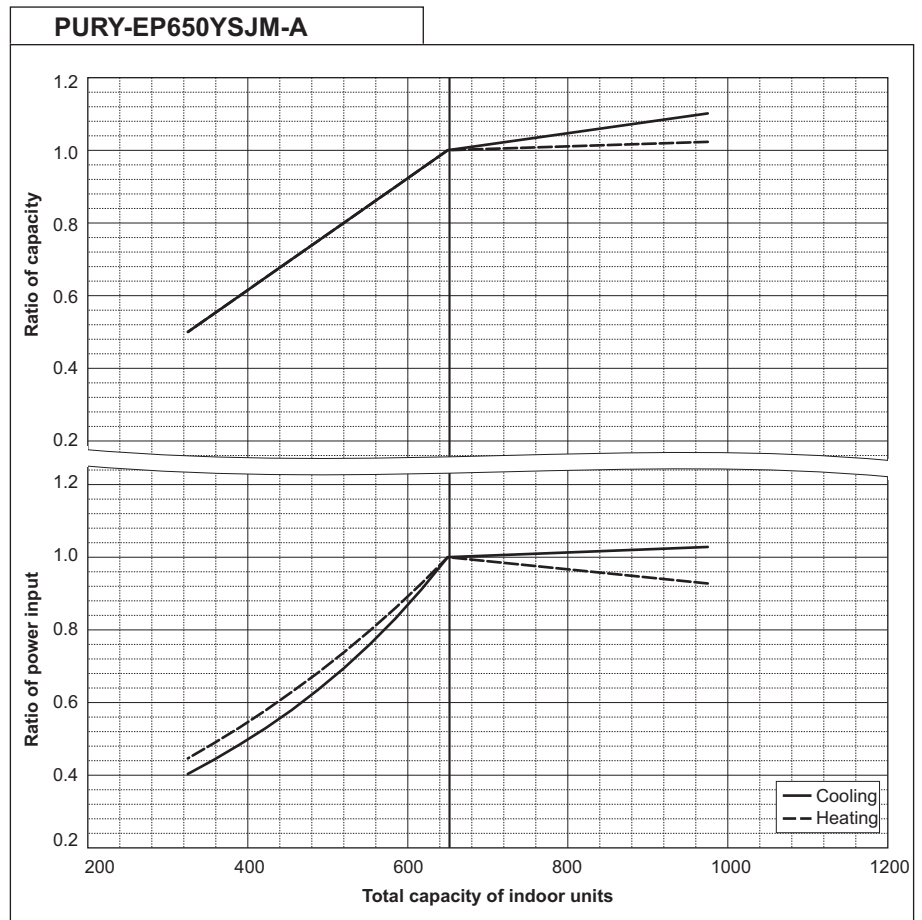

R2(HIGH COP)

PURY-EP700YSJM-A		
Nominal Cooling Capacity	kW	80.0
	BTU/h	273,000
Input	kW	21.22

PURY-EP700YSJM-A		
Nominal Heating Capacity	kW	88.0
	BTU/h	300,300
Input	kW	22.05

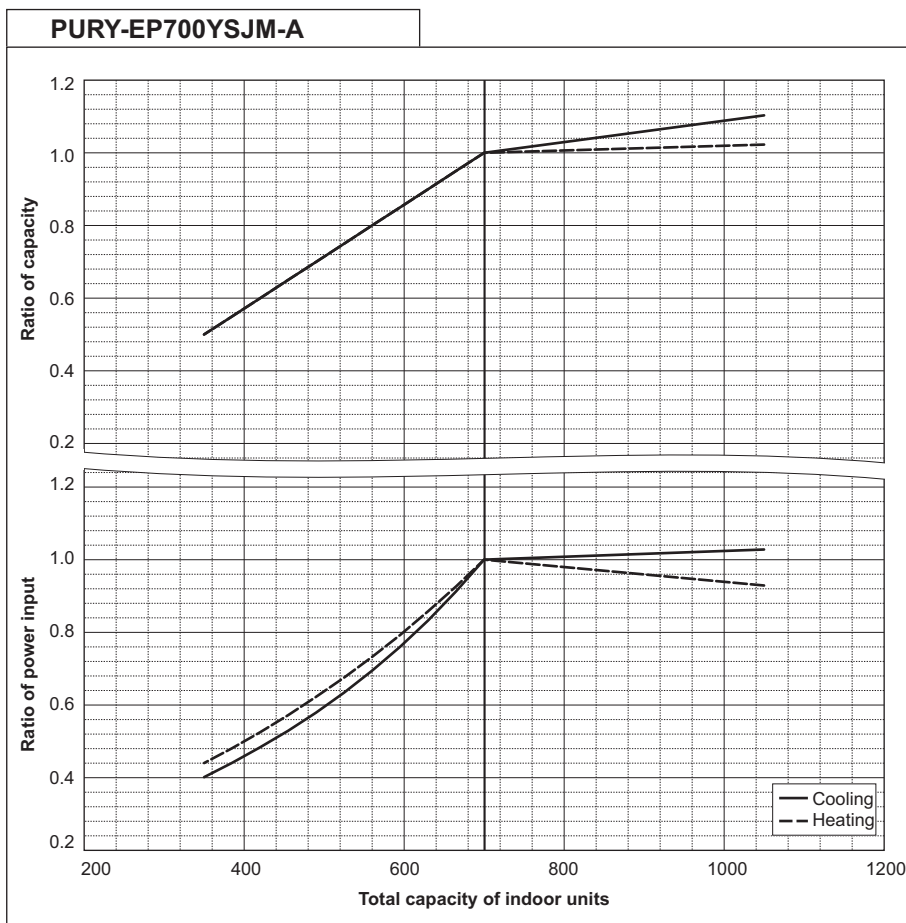


R2(HIGH COP)

6-3. Correction by refrigerant piping length








CITY MULTI system can extend the piping flexibly within its limitation for the actual situation. Yet, a decrease of cooling/heating capacity could happen correspondently. Using following correction factor according to the equivalent length of the piping shown at 6-3-1 and 6-3-2, the capacity can be observed. 6-3-3 shows how to obtain the equivalent length of piping.

6-3-1. Cooling capacity correction

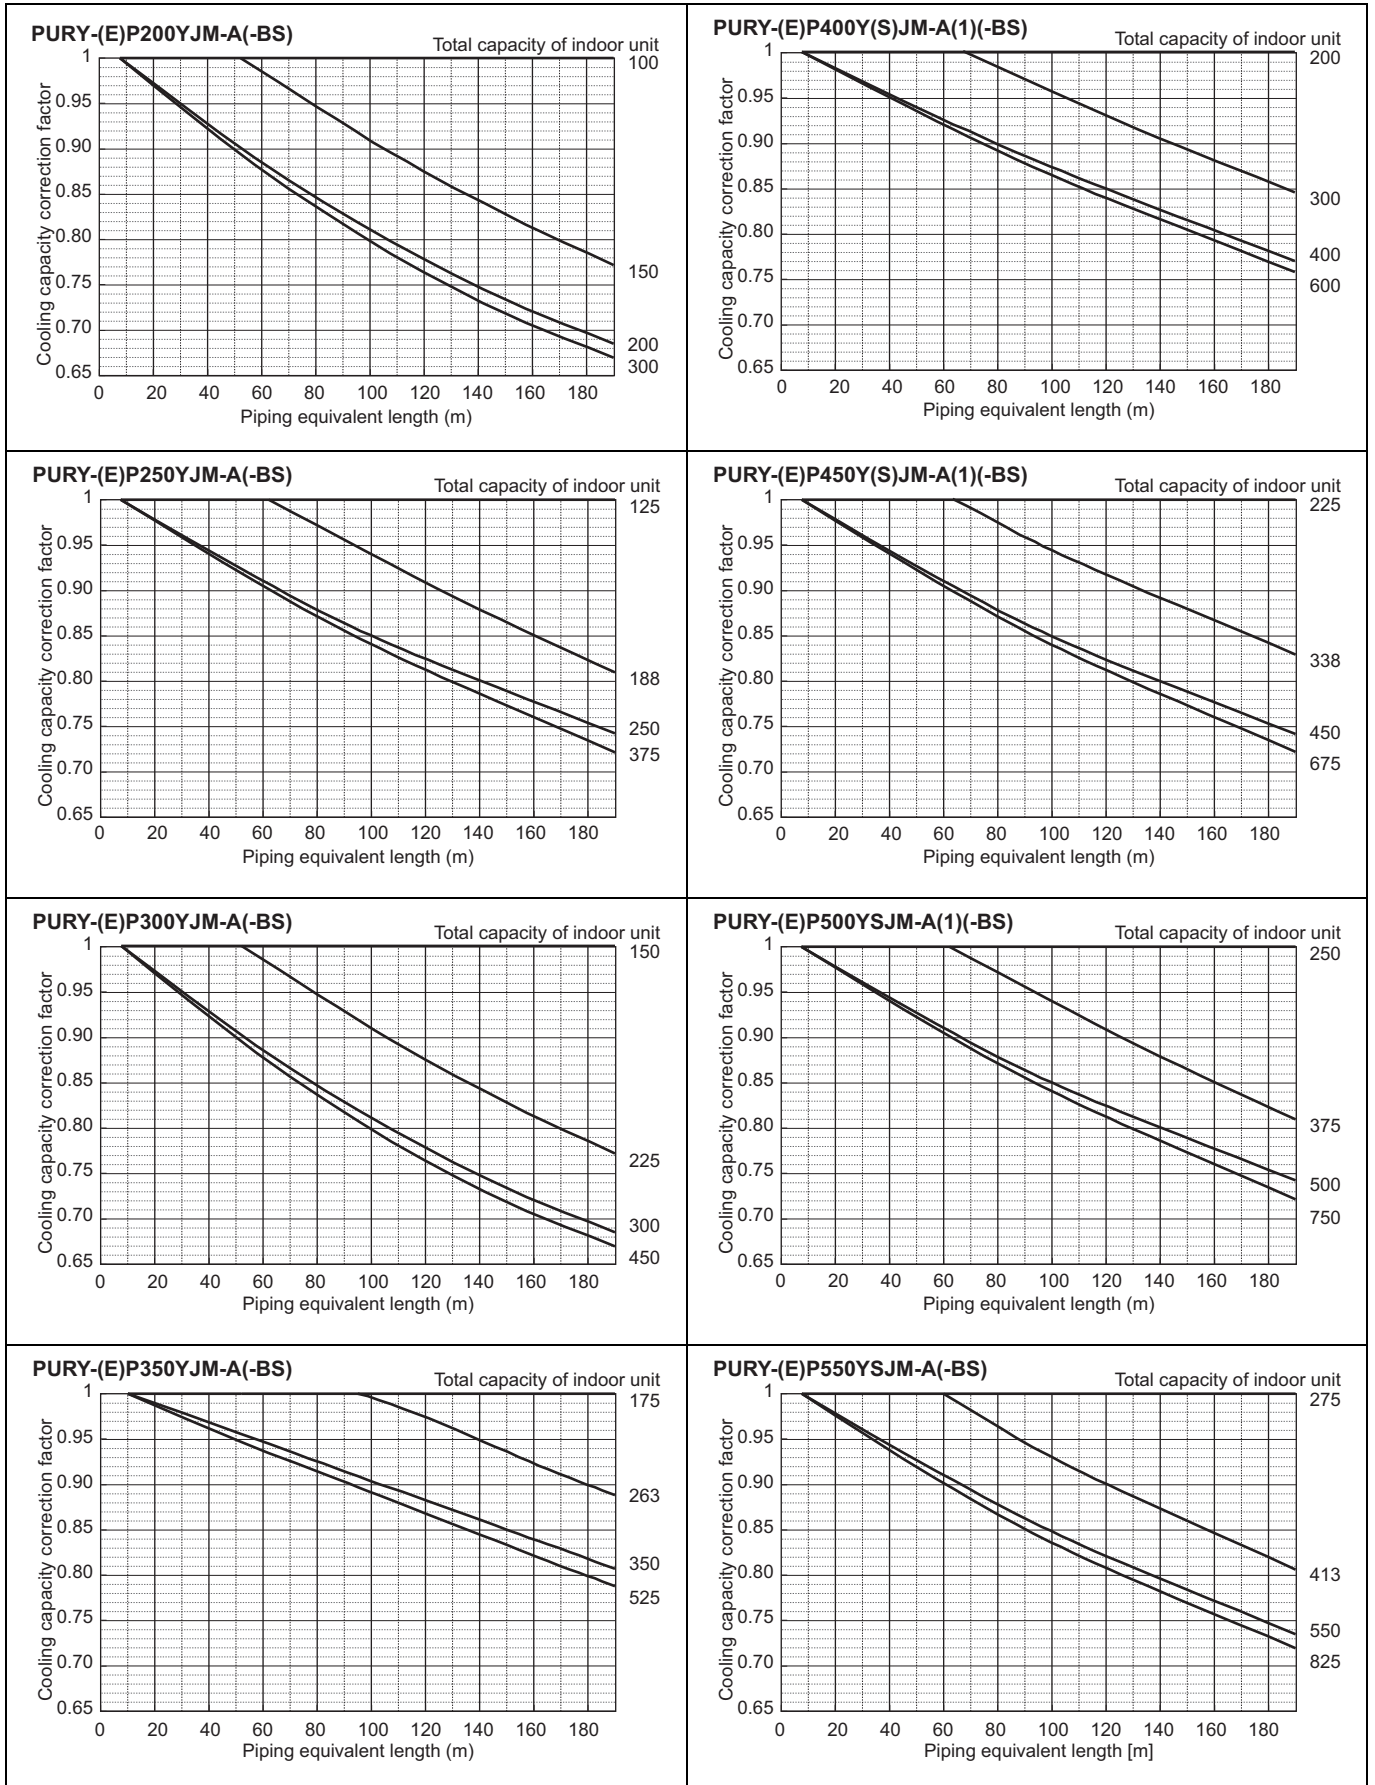


# 6. CAPACITY TABLES

R2(HIGH COP)

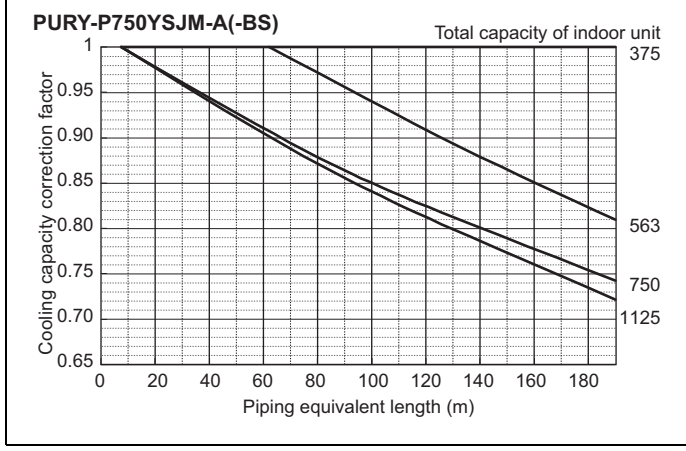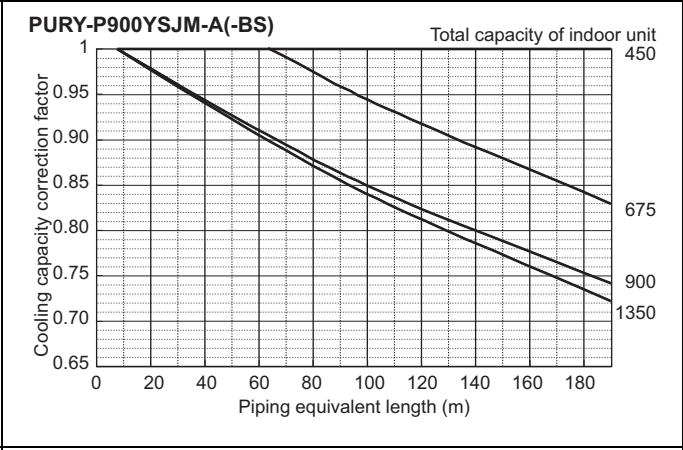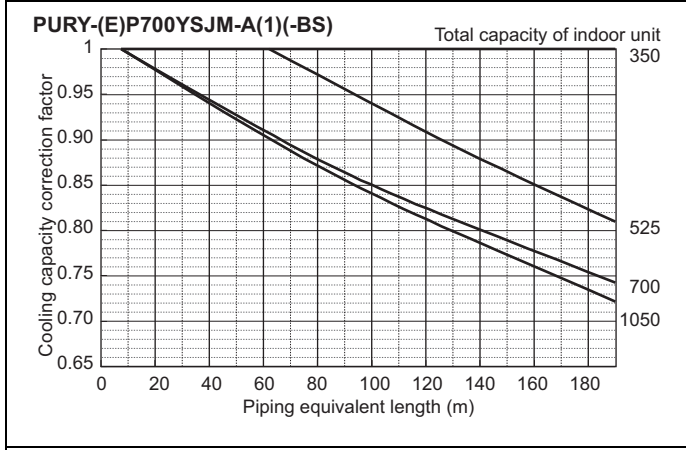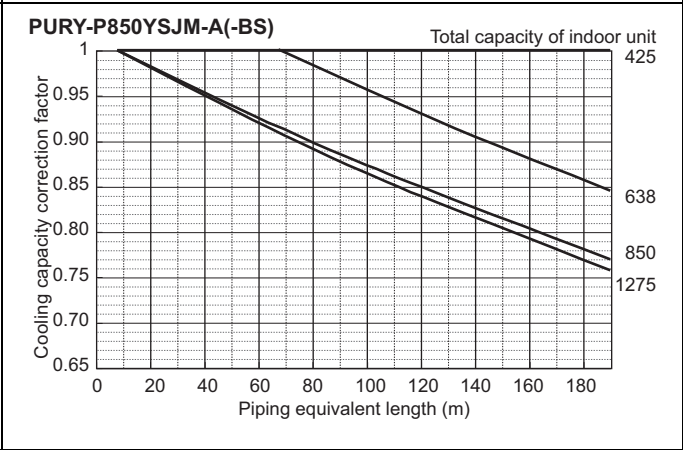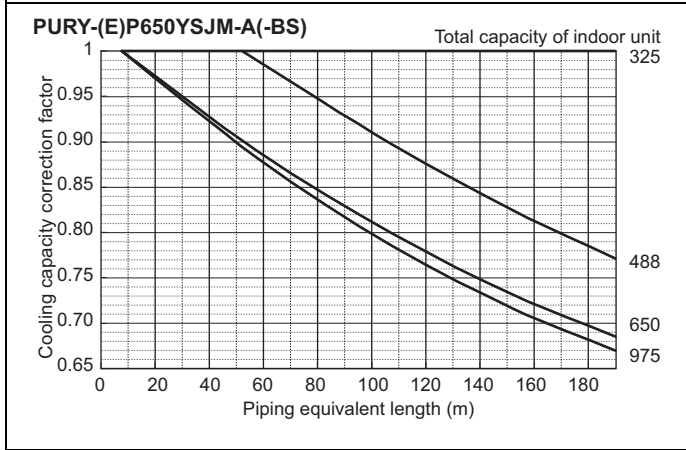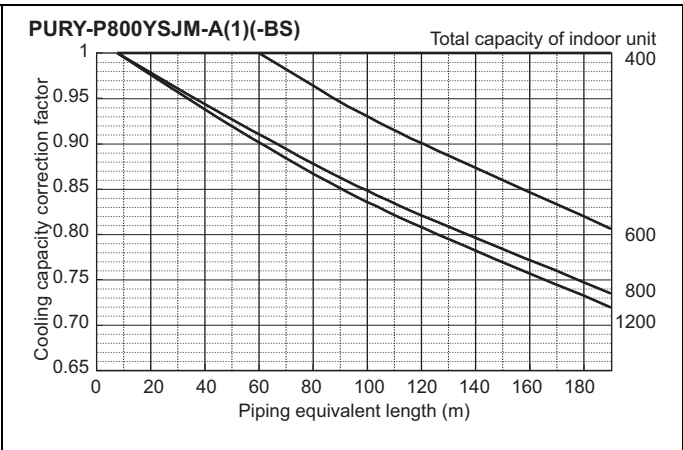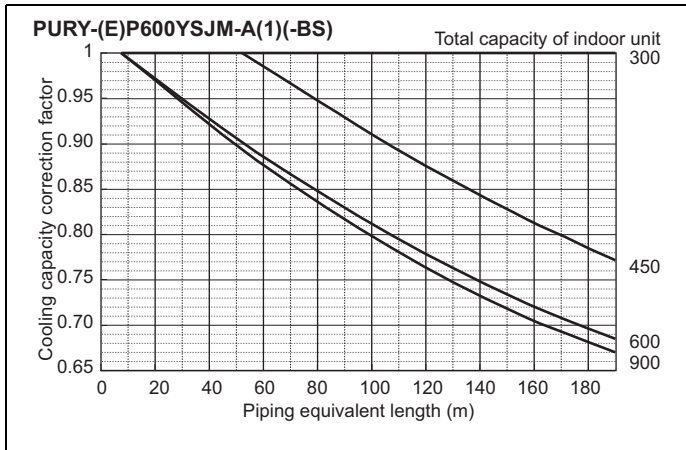

6-3-2. Heating capacity correction

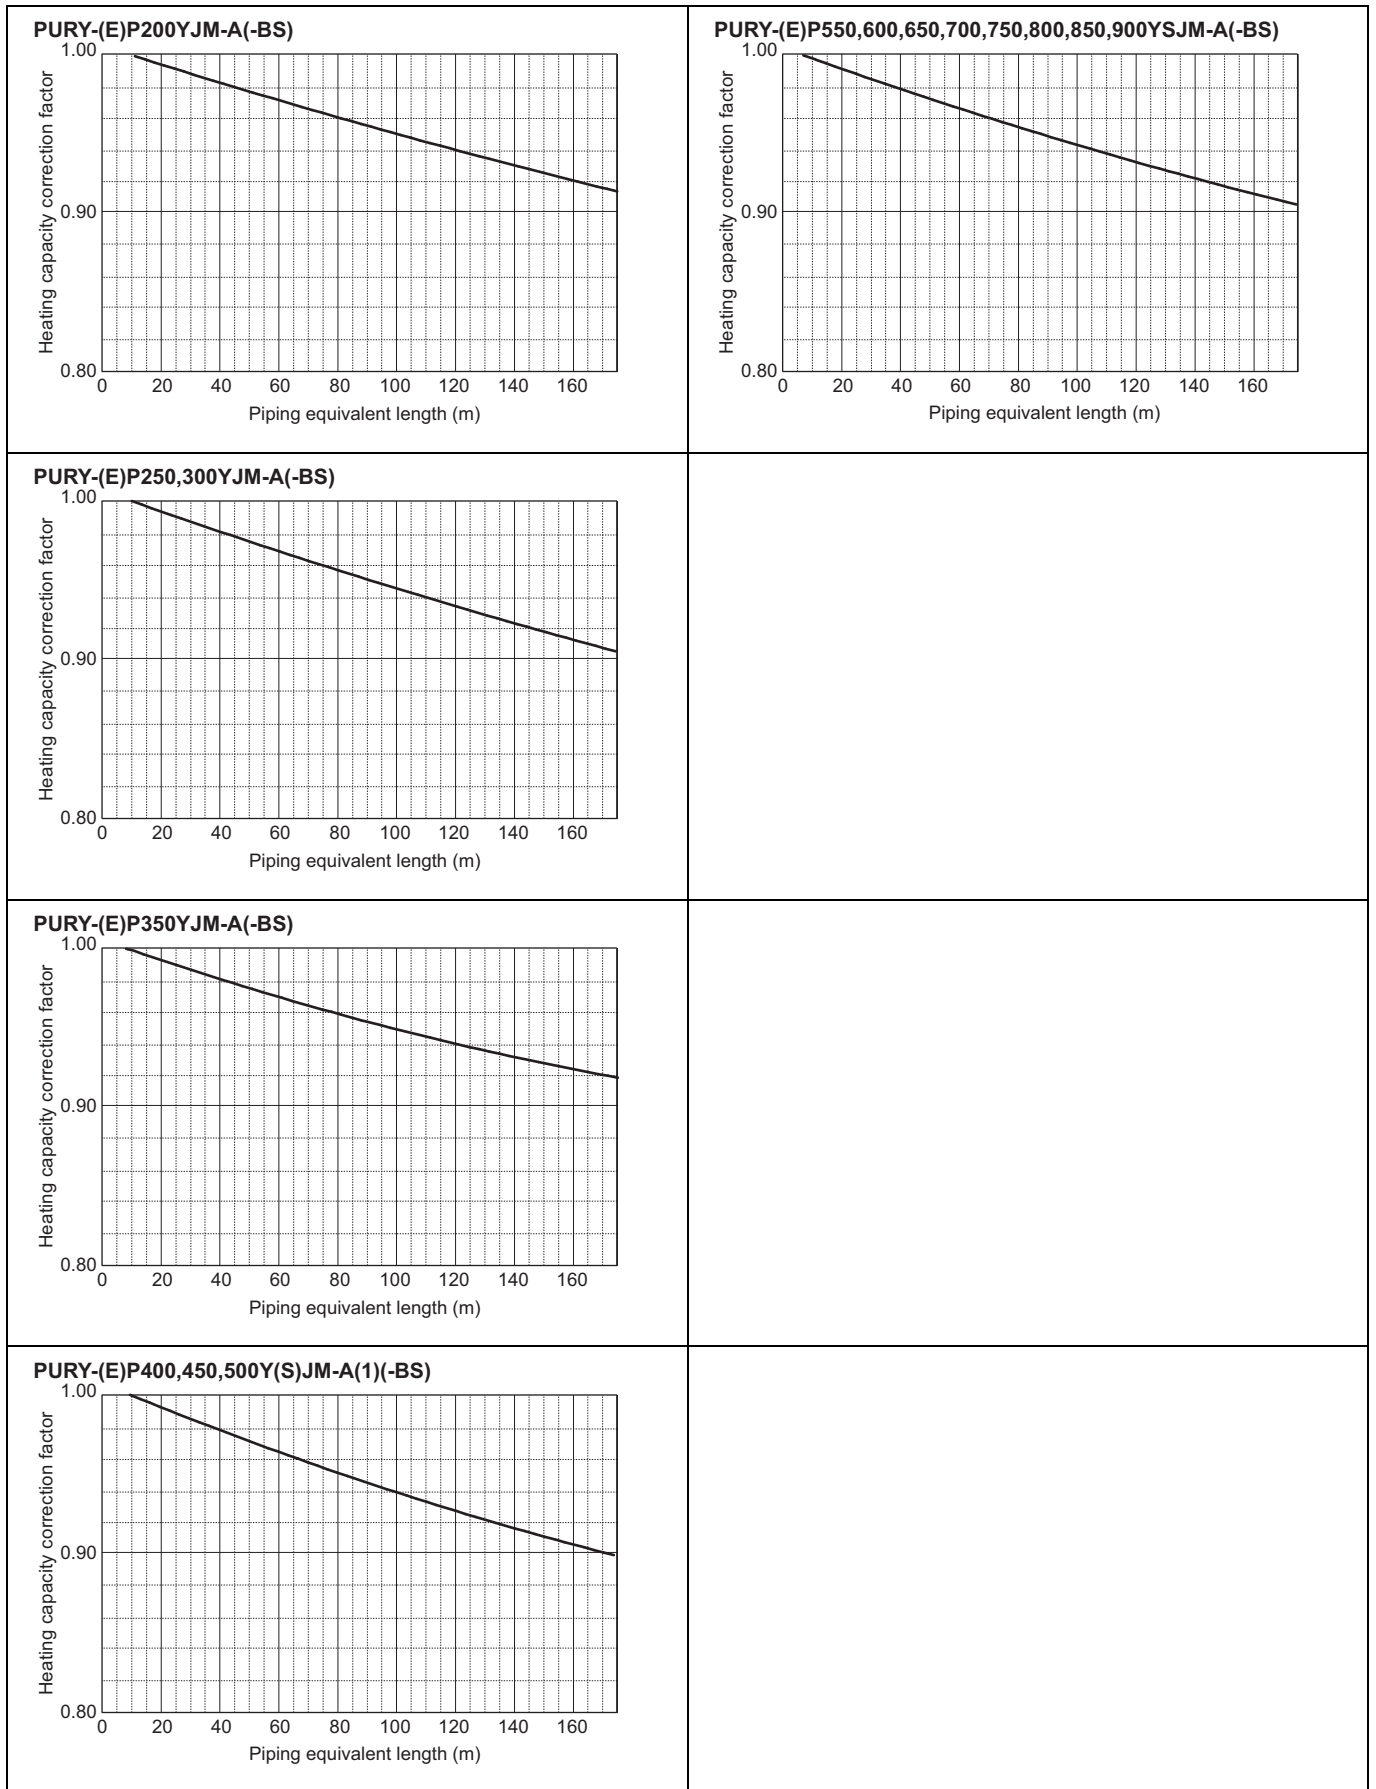

R2(HIGH COP)



### 6-3-3. How to obtain the equivalent piping length

- 1 **PURY-(E)P200YJM-A(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.35 x number of bends in the piping) m
- 2 **PURY-(E)P250,300YJM-A(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.42 x number of bends in the piping) m
- 3 **PURY-(E)P350YJM-A(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.47 x number of bends in the piping) m
- 4 **PURY-(E)P400,450,500,550,600,650Y(S)JM-A(1)(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.50 x number of bends in the piping) m
- 5 **PURY-(E)P700,750,800YSJM-A(1)(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.70 x number of bends in the piping) m
- 6 **PURY-P850,900YSJM-A(-BS)**  
Equivalent length = (Actual piping length to the farthest indoor unit) + (0.80 x number of bends in the piping) m

### 6-4. Correction by port counts of the BC controller

Indoor unit sizes P200 and P250 must be connected to 2 ports on the BC controller.

Indoor unit sizes from P100 to P140 should normally be connected to 2 ports on the BC controller (set BC controller DIP-SW 4-6 to its ON position).

In cases whereby indoor unit sizes from P100 to P140 are connected to only 1port on the BC controller (set BC controller DIP-SW 4-6 to its OFF position), the cooling capacity of the indoor unit should be multiplied by a correction factor of **0.97**.

### 6-5. Correction at frost and defrost

Due to frost at the outdoor heat exchanger and the automatic defrost operation, the heating capacity of the outdoor unit can be calculated by multiplying the correction factor shown in the table below.


Table of correction factor at frosting and defrosting

Outdoor inlet air temp. °C	6	4	2	1	0	-2	-4	-6	-8	-10	-20
Outdoor inlet air temp. °F	43	39	36	34	32	28	25	21	18	14	-4
PURY-(E)P200YJM-A(-BS)	1.00	0.95	0.84	0.83	0.83	0.87	0.90	0.95	0.95	0.95	0.95
PURY-(E)P250YJM-A(-BS)	1.00	0.95	0.84	0.83	0.83	0.87	0.90	0.95	0.95	0.95	0.95
PURY-(E)P300YJM-A(-BS)	1.00	0.93	0.82	0.80	0.82	0.86	0.90	0.90	0.95	0.95	0.95
PURY-(E)P350YJM-A(-BS)	1.00	0.93	0.85	0.83	0.84	0.86	0.90	0.90	0.95	0.95	0.95
PURY-(E)P400Y(S)JM-A(1)(-BS)	1.00	0.95	0.90	0.87	0.88	0.89	0.90	0.95	0.95	0.95	0.95
PURY-(E)P450Y(S)JM-A(1)(-BS)	1.00	0.98	0.89	0.87	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-(E)P500YSJM-A(1)(-BS)	1.00	0.98	0.89	0.86	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-(E)P550YSJM-A(-BS)	1.00	0.94	0.87	0.86	0.87	0.88	0.90	0.90	0.93	0.93	0.93
PURY-(E)P600YSJM-A(1)(-BS)	1.00	0.94	0.84	0.86	0.87	0.88	0.90	0.90	0.93	0.93	0.93
PURY-(E)P650YSJM-A(-BS)	1.00	0.94	0.84	0.86	0.87	0.88	0.90	0.90	0.93	0.93	0.93
PURY-(E)P700YSJM-A(1)(-BS)	1.00	0.98	0.89	0.88	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-P750YSJM-A(-BS)	1.00	0.98	0.89	0.88	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-P800YSJM-A(1)(-BS)	1.00	0.98	0.89	0.88	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-P850YSJM-A(-BS)	1.00	0.98	0.89	0.88	0.89	0.90	0.92	0.95	0.95	0.95	0.95
PURY-P900YSJM-A(-BS)	1.00	0.98	0.89	0.88	0.89	0.90	0.92	0.95	0.95	0.95	0.95




6-6. Operation temperature range

• Cooling

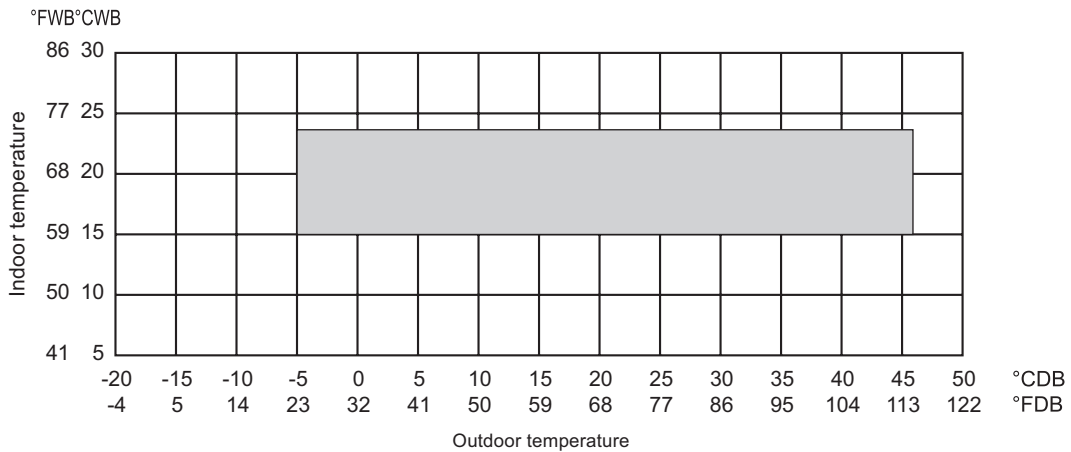

• Heating

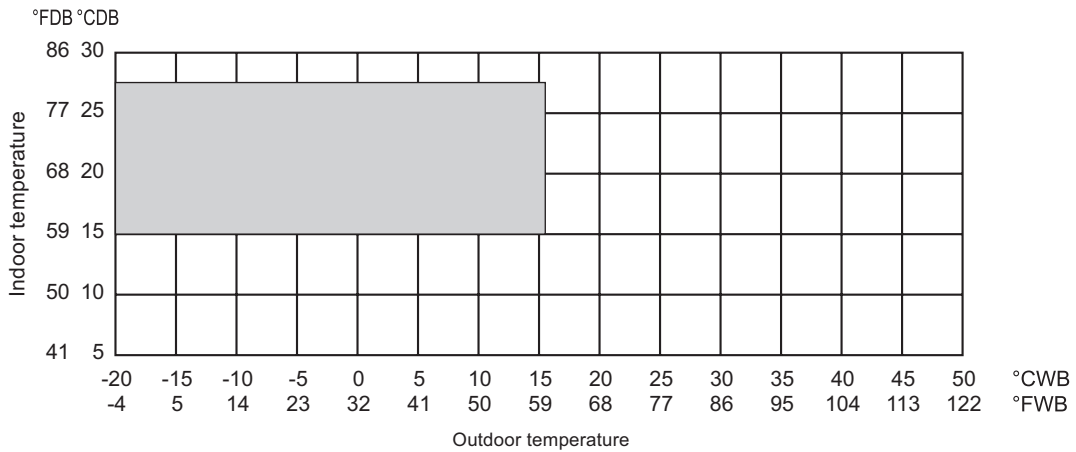

• Combination of cooling/heating operation (Cooling main or Heating main)

Outdoor temperature	Indoor temperature	
	Cooling	Heating
-5 to 21°CDB (23 to 70°FDB)	—	15 to 27°CDB (59 to 81°FDB)
-6 to 15.5°CWB (21 to 60°FWB)	15 to 24°CWB (59 to 75°FWB)	—

R2(HIGH COP)

## 7-1. JOINT

Piping for CITY MULTI can be easily done with Joints and headers provided by MITSUBISHI ELECTRIC CORP.. There are 3 sets of Joints selectable for piping. Details for applying the Joint sets are referable to System Design 3, or their own Installation Manual.

**CMY-Y102S-G2** Ref.: CMY\_Y102S\_G2\_EXD\_EUDB\_SI  
mm

**For Gas pipe:** **For Liquid pipe:**

<Deformed pipe(Accessory)>

ID: Inner Diameter    OD: Outer Diameter

**CMY-Y102L-G2** Ref.: CMY\_Y102L\_G2\_EXD\_EUDB\_SI  
mm

**For Gas pipe:** **For Liquid pipe:**

<Deformed pipe(Accessory)>

ID: Inner Diameter    OD: Outer Diameter

**CMY-Y202-G2** Ref.: CMY\_Y202\_G2\_EXD\_EUDB\_SI  
mm

**For Gas pipe:** **For Liquid pipe:**



<Deformed pipe(Accessory)>

ID: Inner Diameter    OD: Outer Diameter


R2(HIGH COP)

7-2. OUTDOOR TWINNING KIT

For PURY series, following optional Outdoor Twinning Kit is needed to use to combine to refrigerant flows of its PURY series. Details of selecting the proper kit should be referred to the System Design Section.

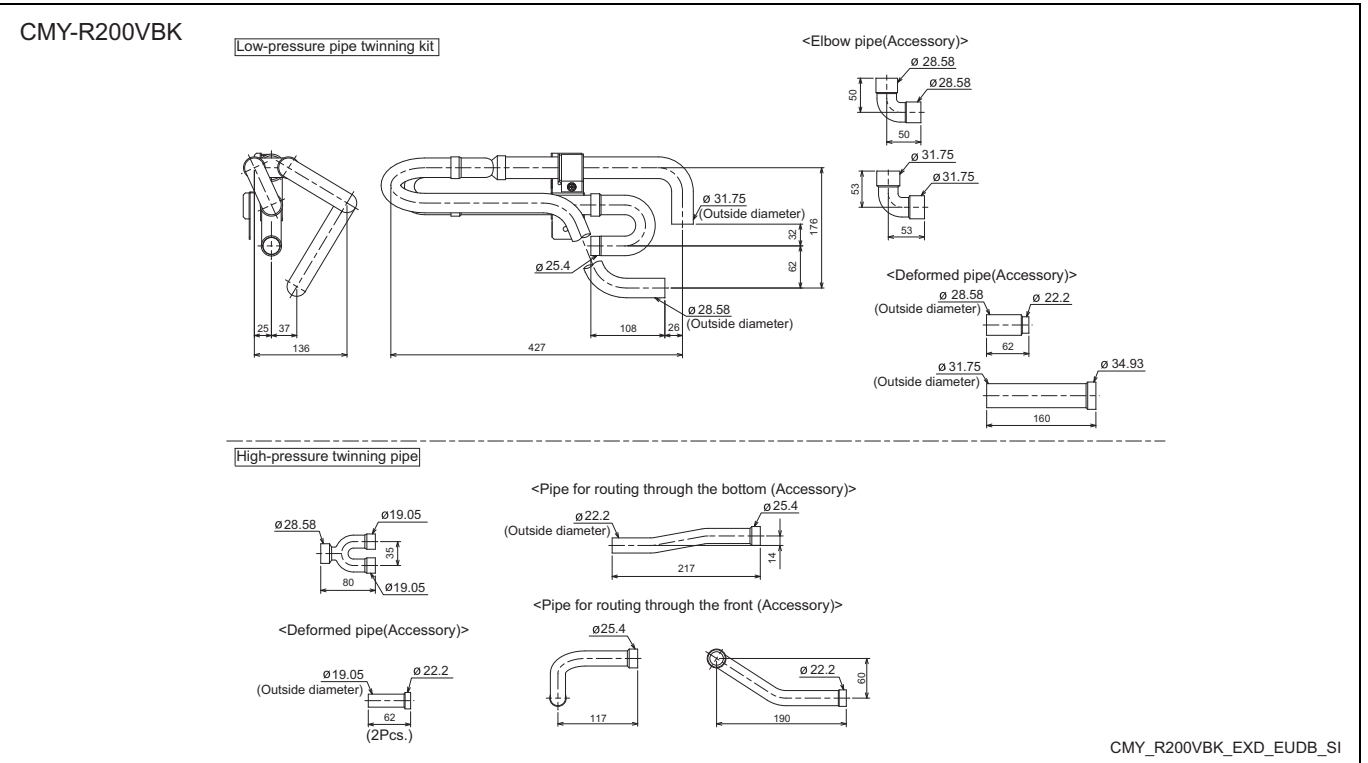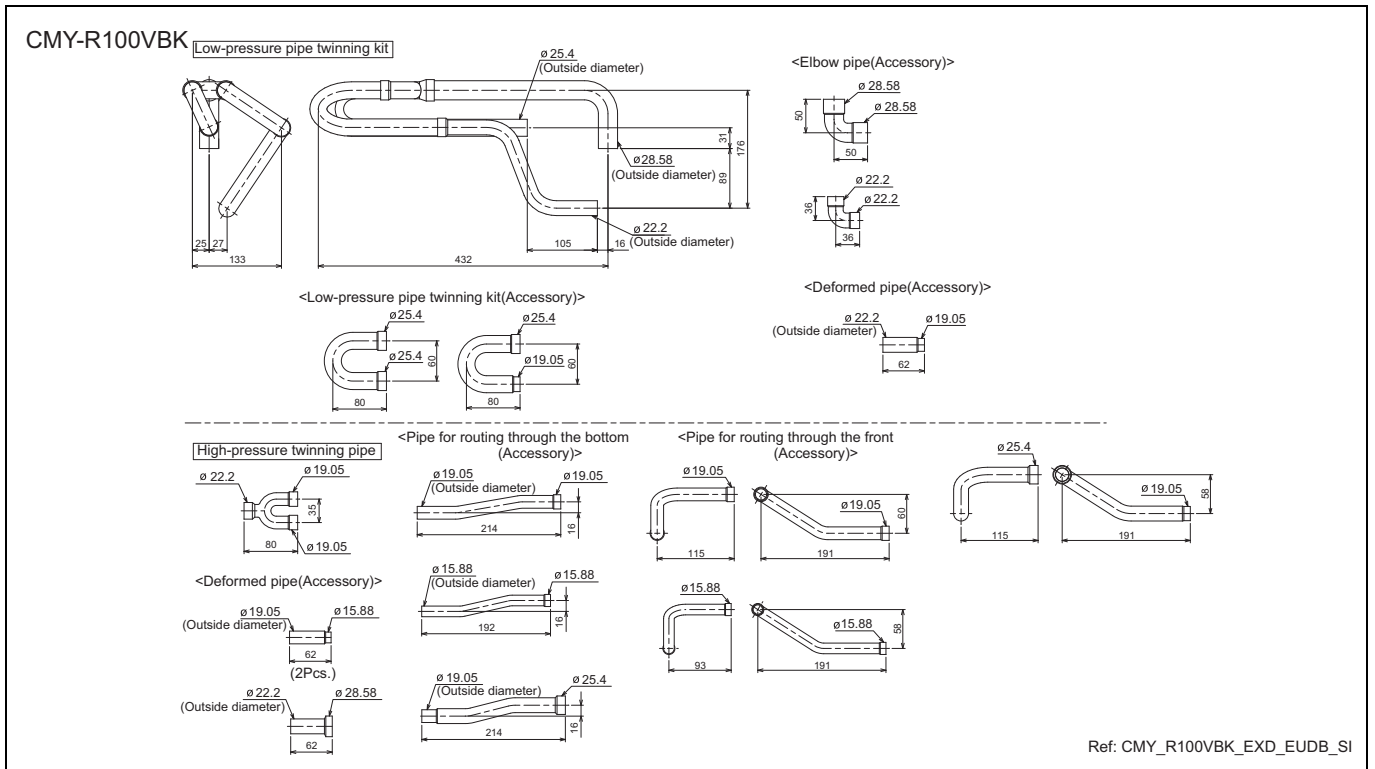

Note 1. Reference the attitude angle of the branch pipe below the fig.





The angle of the branch pipe for high pressure is within  $\pm 15^\circ$  against the horizontal plane.


2. Use the attached pipe to braze the port-opening of the distributor.
3. Pipe diameter is indicated by inside diameter.

## CMY-R100XLVBK

### Low-pressure pipe twinning kit

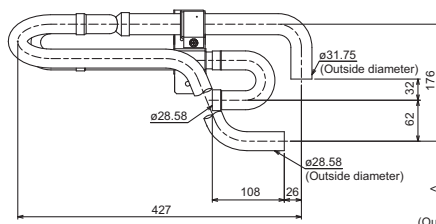


### <Elbow pipe(Accessory)>




- <Accessory> Fixing screw ... 1
- Pipe cover ... 1
- Cable tie ... 2
- Insulation cover ... 1


### <Deformed pipe(Accessory)>

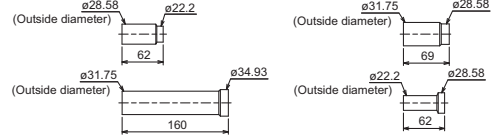


### High-pressure twinning pipe



### <Pipe for routing through the bottom (Accessory)>




Note 1. Refer to the figure below for the installation position of the high-pressure twinning pipe.




Inclination tolerance of the high-pressure twinning pipe is  $\pm 15^\circ$  relative to the ground.  
2. Pipe diameter is indicated by inside diameter.

### <Deformed pipe(Accessory)>





### <Pipe for routing through the front (Accessory)>




## CMY-R200XLVBK

### Low-pressure pipe twinning kit

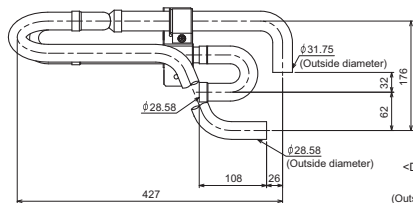


### <Elbow pipe (Accessory)>




- <Accessory> Fixing screw ... 1
- Pipe cover ... 1
- Cable tie ... 2
- Insulation cover ... 1


### <Deformed pipe (Accessory)>




### High-pressure twinning pipe



### <Pipe for routing through the bottom (Accessory)>




Note 1. Refer to the figure below for the installation position of the high-pressure twinning pipe.




Inclination tolerance of the high-pressure twinning pipe is  $\pm 15^\circ$  relative to the ground.  
2. Pipe diameter is indicated by inside diameter.


### <Deformed pipe (Accessory)>



### <Pipe for routing through the front (Accessory)>



Note 1. Reference the attitude angle of the branch pipe below the fig.



The angle of the branch pipe for high pressure is within  $\pm 15^\circ$  against the horizontal plane.

2. Use the attached pipe to braze the port-opening of the distributor.
3. Pipe diameter is indicated by inside diameter.
4. Only use the Twinning pipe by Mitsubishi (optional parts).

7-3. JOINT KIT CMY-R160-J1 FOR BC CONTROLLER

Joint kit "CMY-R160-J1" for BC controller is used to combine 2 ports of the BC controller at a PURY-(E)P-Y(S)JM-A system so as to enable down-stream Indoor capacity above P80 as shown in Fig. 1.

The Joint kit include following items:



① Instruction	② Joint pipe (Small)	③ Joint pipe (Large)	④ Cover 1	⑤ Cover 2	⑥ Cover 3	⑦ Band	⑧ Reducer 1	⑨ Reducer 2
This sheet 1pc	1pc	1pc	2pcs	1pc for gas side	1pc for liquid side	8pcs	OD19.05-ID22.2 1pc	OD19.05-ID15.88 1pc

Please prepare the following items in the field. ① Tape for insulation material sealing ② Extension pipe for refrigerant circuit Ref.: WT05840X01\_01

② Joint pipe (for liquid side)

③ Joint pipe (for gas side)

mm(in.)

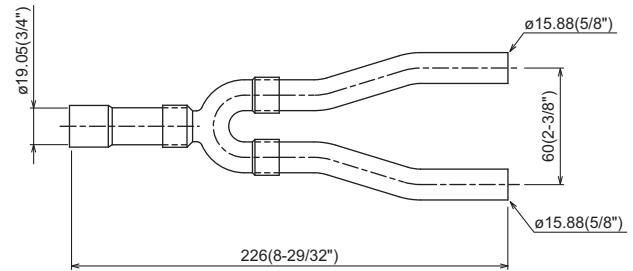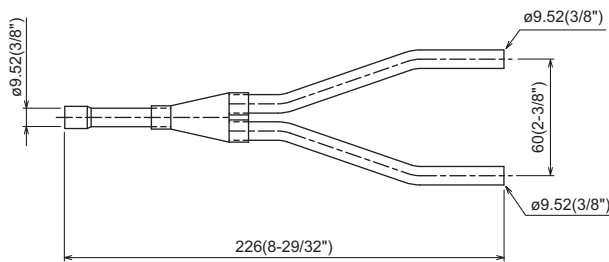

1. Designing CMY-R160-J1 to a PURY-(E)P-Y(S)JM-A system

The maximum down-stream Indoor capacity for 1 port of BC controller is P80. When the down-stream Indoor capacity is above P80, Joint kit CMY-R160-J1 is needed to combined 2 ports of BC controller to enlarge the capacity, like Group 2 and 3 in Fig. 1.

Maximum 3 Indoor units are allowed to connect to 1 port of BC controller or 2 combined ports of BC controller using CMY-R160-J1.

When connecting Indoor units to 1 port of BC controller or 2 combined ports of BC controller using CMY-R160-J1 or CMY-Y102S-G2 is applicable, like Group 1 and 2 in Fig. 1

Caution: Mixed cooling and heating mode at the same time for Indoor units connecting to 1 port or 2 combined ports is not available.

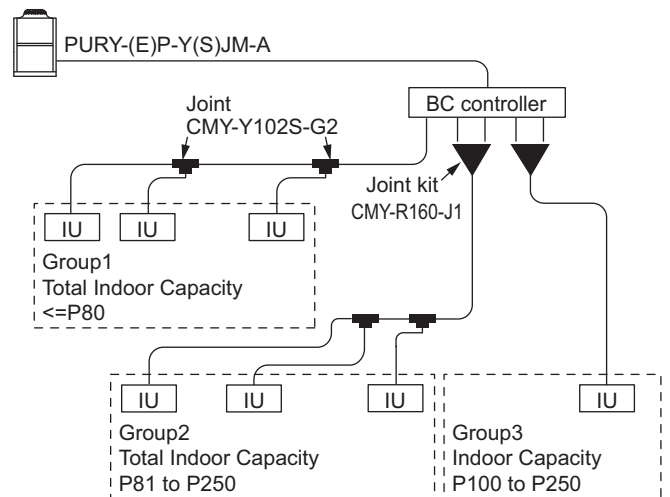


Fig.1. CMY-R160-J1 applying scheme

Ref.: WT05840X01\_02

2. Piping at the installation site

The connection of CMY-R160-J1 to BC controller and pipe leading to Indoor units is referable to Fig. 2. Non-oxidized brazing is necessary. All piping must be careful to avoid foreign material getting inside.

After piping and air-tight testing, insulation work to the Joint and pipe should be done. Details is available at the Installation Manual.

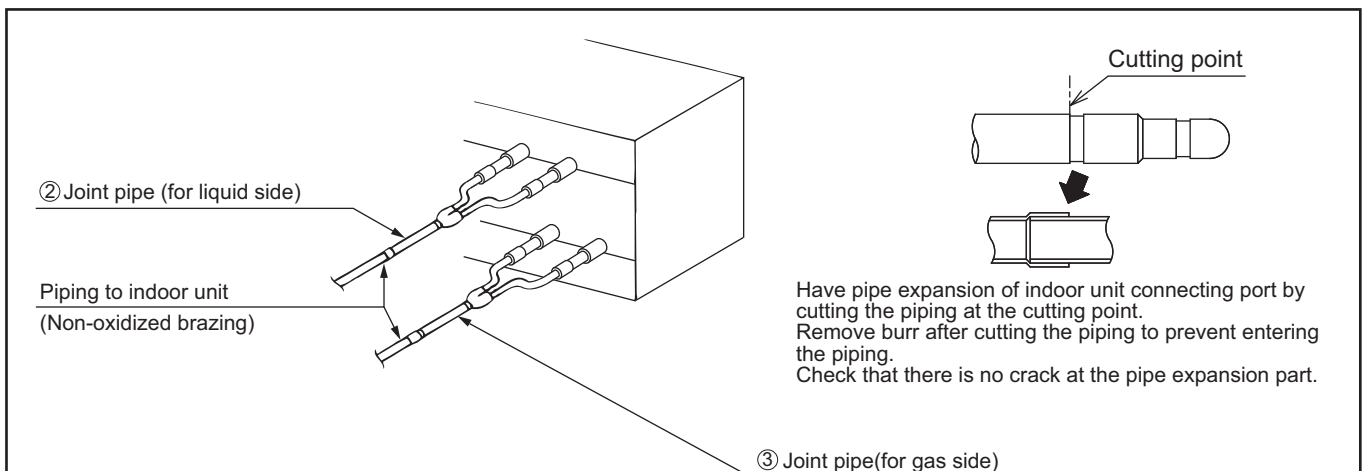


Fig.2. Connecting CMY-R160-J1

Ref.: WT05840X01\_03

Ref: CMY\_R160\_J\_DOC\_EUDB

